




**Public Services and
Procurement Canada**

Requisition No. EZ899-191024/A

**DRAWINGS & SPECIFICATIONS
For
Project No.: R.097978.001
Mission Medium Institution
Building M - Roof Improvement**


APPROVED BY:

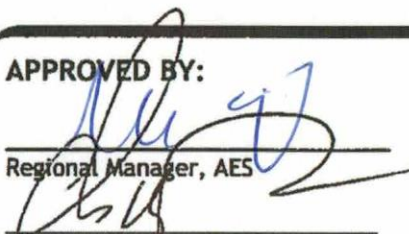

Regional Manager, AES

2018-07-16

Date




Construction Safety Coordinator

2015-07-05

Date

TENDER:



Project Manager

2018-07-17

Date

<u>Section No.</u>	<u>Section Title</u>	<u>No. of Pages</u>
Division 1 – General Requirements		
	Section 01 01 50 – General Instructions	16
	Section 01 14 10 – Security Requirements	7
	Section 01 35 33 – Health & Safety Requirements	9
Division 7 – Thermal and Moisture Protection		
	Section 07 56 10 – Cold Liquid Applied Roof Assembly	9

List of Drawings (Bound Separately):

A-01	Site plan
A-02	Roof plan and general notes
A-03	Roof aerial photo and general notes
A-04	Details
A-05	Photos of existing condition

END OF SECTION

PART 1 GENERAL

1.1 SUMMARY OF WORK

- .1 Work covered by Contract Documents:
 - .1 This Contract covers the following work at the Mission Medium Institution, Building M at 8751 Stave Lake Street, Mission BC V2V 4L8.
 - .1 Power wash existing metal roof cladding, canopies, overhang, flashing and gutters.
 - .2 Apply new roof assembly per specification section 07 56 10 over existing metal roof cladding, canopies and metal flashing.
 - .2 Work to be performed under this Contract includes, but not limited to, the following items covered further in the Contract documents:
 - .1 Provide a detailed work plan including a project schedule and phasing. This detailed work plan shall be submitted to the Departmental Representative for review to verify that there will be no interruption of service.
 - .2 Do not start work until all essential equipment is delivered to the site and the work can proceed without delays.
 - .3 Provide as-built drawings and closeout submittals.
- .3 Contractor's Use of Premises:
 - .1 Contractor has limited use of site for work of this contract until Substantial Completion:
 - .1 Contractor use of premises for storage and access, as approved by the Departmental representative.
 - .2 Obtain and pay for use of additional storage or work areas needed for operations under this Contract.
 - .2 Vehicular access through the Sally Port will be restricted during the inmate "count" at breakfast, lunch and dinner hours. Confirm times with Departmental Representative. Delays may occur when entering and exiting the Institution with vehicles due to security situations and heavy traffic.

1.2 WORK RESTRICTIONS

- .1 Notify Departmental Representative of intended interruption of power, communication and water services and provide schedule of interruption times.
- .2 Where Work involves breaking into or connecting to existing services, give departmental Representative 48 hours of notice for necessary interruption of services throughout course of work. Keep duration of interruptions to a minimum. Coordinate interruptions with local authority having jurisdiction and local residences and businesses affected by the disruption.
- .3 Provide for access by pedestrian and vehicular traffic on and around site where work is in progress.
- .4 Construct barriers in accordance with Section Temporary Barriers and Enclosures.
- .5 Security Requirements: refer to Section 01 14 10 - Security Requirements.

- .6 Hours of work:
 - .1 Perform work during normal working hours of the Institution 0730 to 1600, Monday through Friday except holidays.
 - .2 When it is necessary, arrange in advance with Departmental Representative to work outside of normal working hours.

1.3 CONSTRUCTION WORK SCHEDULE

- .1 Commence work immediately upon official notification of acceptance of offer and complete the work within 12 weeks from the date of such notification.
- .2 Ensure that it is understood that Award of Contract or time of beginning, rate of progress, Substantial Certificate and Final Certificate as defined times of completion are of essence of this contract.
- .3 Submittal:
 - .1 Submit to Departmental Representative within 10 working days of Award of Contract, a Bar (GANNT) Chart as Master Plan for planning, monitoring and reporting of construction progress.
 - .2 Identify each trade or operation.
 - .3 Show dates for delivery of items requiring long lead time.
 - .4 Departmental Representative will review schedule and return one copy.
 - .5 Re-submit two (2) copies of finalized schedule to Departmental Representative within five (5) working days after return of reviewed preliminary copy.
- .4 Project Scheduling Reporting:
 - .1 Update Project Schedule on bi-weekly basis reflecting activity changes and completions, as well as activities in progress.
 - .2 Include as part of Project Schedule, narrative report identifying Work status to date, comparing current progress to baseline, presenting current forecasts, defining problem areas, anticipated delays and impact with possible mitigation.
- .5 Project Meetings:
 - .1 Discuss Project Schedule at bi-weekly site meetings, identify activities that are behind schedule and provide measures to regain slippage. Activities considered behind schedule are those with projected start or completion dates later than current approved dates shown on baseline schedule.
 - .2 Weather related delays with their remedial measures will be discussed and negotiated.
 - .3 Before submitting first progress claim submit breakdown of Contract price in detail as directed by Departmental Representative and aggregating contract price. After approval by Departmental Representative cost breakdown will be used as basis for progress payments. Only PWGSC paper work is acceptable. The suggest breakdowns are listed as follows:
 - .1 General instructions
 - .2 Bond and insurance
 - .3 New roof Assembly
 - .4 Close-out submittals

1.4 SUBMITTAL PROCEDURES

- .1 Administrative:
 - .1 Submit to Departmental Representative submittal listed for review. Submit with reasonable promptness and in orderly sequence so as to not cause delay in Work. Failure to submit in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
 - .2 Work affected by submittal shall not proceed until review is complete.
 - .3 Present shop drawings, product data, samples and mock-ups in SI Metric units.
 - .4 Where items or information is not produced in SI Metric units converted values are acceptable.
 - .5 Review submittal prior to submission to Departmental Representative. This review represents that necessary requirements have been determined and verified, or will be, and that each submittal has been checked and co-ordinated with requirements of Work and Contract Documents. Submittal not stamped, signed, dated and identified as to specific project will be returned without being examined and shall be considered rejected.
 - .6 Notify Departmental Representative in writing at time of submission, identifying deviations from requirements of Contract Documents stating reasons for deviations.
 - .7 Verify field measurements and affected adjacent Work are coordinated.
 - .8 Contractor's responsibility for errors and omissions in submission is not relieved by Departmental Representative review of submittal.
 - .9 Contractor's responsibility for deviations in submission from requirements of Contract Documents is not relieved by Departmental Representative review.
 - 10 Keep one reviewed copy of each submission on site.
- .2 Shop Drawings:
 - .1 Drawings to be originals prepared by Contractor, Subcontractor, Supplier or Distributor, which illustrate appropriate portion of work; showing fabrication, layout, setting or erection details as specified in appropriate sections.
- .3 Product Data:
 - .1 Certain specification Sections specify that manufacturer's standard schematic drawings, catalogue sheets, diagrams, schedules, performance charts, illustrations and other standard descriptive data will be accepted in lieu of shop drawings, provided that the product concerned is clearly identified. Submit in sets, not as individual submissions.
- .4 Samples:
 - .1 Submit samples in sizes and quantities specified.
 - .2 Where colour is criterion, submit full range of colours.
 - .3 Submit all samples as soon as possible after the contract is awarded, to facilitate production of complete colour scheme by the Departmental Representative.

- .5 Mock-ups:
 - .1 Prepare mock-ups for Work specifically requested in specifications. Include for Work of all Sections required to provide mock-ups.
 - .2 Construct in location as specified in specific Section.
 - .3 Prepare mock-ups for Departmental Representative' review with reasonable promptness and in an orderly sequence, so as not to cause any delay in Work.
 - .4 Failure to prepare mock-ups in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
 - .5 Specification section identifies whether mock-up may remain as part of Work or if it is to be removed and when.
- .6 Progress Photographs:
 - .1 Provide construction photographs in accordance with procedures and submission requirements specified in this clause.
 - .2 Progress Photographs:
 - .1 Provide digital photographs with images of minimum 3.1 mega pixel resolution and stored in Jpeg format with minimal compression.
 - .2 Number of viewpoints: four (4), locations of viewpoints directed by Departmental Representative.
 - .3 Frequency: monthly, submitted on disk with monthly progress statement, sent via e-mail or as directed by Departmental Representative.
 - .4 Identify photos by location, date and sequential numbering system.
 - .3 Final Photographs:
 - .1 Provide digital photographs with images of minimum 3.1 mega pixel resolution and stored in Jpeg format with minimal compression. Where photos are e-mailed compression can be increased.
 - .2 Number of viewpoints:
 - .1 Each corner of building M roof for a total of 4.
 - .2 Locations of viewpoints determined by Departmental Representative.
 - .3 Submit final photographs in digital format on CD, before final acceptance of building.
 - .4 Label disks and identify with name and project number of project. Indicate exposure dates and viewpoints of each photo and photo number.
- .7 Submission Requirements:
 - .1 Schedule submissions at least ten days before dates reviewed submissions will be needed.
 - .2 Submit number of copies of product data, shop drawings which Contractor requires for distribution plus four (4) copies which will be retained by Departmental Representative.
 - .3 Accompany submissions with transmittal letter in duplicate.

- .4 Submit bond copies (hard copy) as directed by Departmental Representative.
- .8 Coordination of Submissions:
 - .1 Review shop drawings, product data and samples prior to submission.
 - .2 Coordinate with field construction criteria.
 - .3 Verify catalogue numbers and similar data.
 - .4 Coordinate each submittal with requirements of the work of all trades and contract documents.
 - .5 Responsibility for errors and omissions in submittal is not relieved by Departmental Representative's review of submittal.
 - .6 Responsibility for deviations in submittal from requirements of Contract documents is not relieved by Departmental Representative's review of submittal, unless Departmental Representative gives written acceptance of specified deviations.
 - .7 Notify Departmental Representative, in writing at time of submission, of deviations in submittal from requirements of Contract documents.
 - .8 Make any changes in submissions which Departmental Representative may require consistent with Contract Documents and re-submit as directed by Departmental Representative.
 - .9 After Departmental Representative's review, distribute copies.
 - .10 Shop Drawings Review:
 - .1 Review of shop drawings by Public Services and Procurement Canada (PSPC) is for the sole purpose of ascertaining conformance with the general concept.
 - .2 The Departmental Representative's review does not mean that PSPC approves the detail design inherent in the shop drawings, responsibility remains with the contractor submitting same, and such review will not relieve the Contractor of responsibility for errors or omissions in the shop drawings or of responsibility for meeting all requirements of the construction and contract documents.
 - .3 Without restricting the generality of the foregoing, the Contractor is responsible for dimensions to be confirmed and correlated at the job site, for information that pertains solely to fabrication processes or to techniques of construction and installation, and for co-ordination of the work of all subtrades.

1.5 HEALTH AND SAFETY

- .1 Specified in Section 01 35 33.

1.6 ENVIRONMENTAL PROCEDURES

- .1 Fires and burning of rubbish on site not permitted.
- .2 Do not bury rubbish and waste materials on site unless approved by Departmental Representative.
- .3 Do not dispose of waste or volatile materials such as oil, paint thinner or mineral spirits into waterways, storm or sanitary systems.

- .4 Provide temporary drainage and pumping as necessary to keep excavations and site free from water during excavation and grading activities.
- .5 Control disposal of run-off of water containing suspended materials or other harmful substances in accordance with local authority requirements. Construct settlement ponds and silt fences as required by the Provincial Environmental authority.
- .6 Cover or wet down dry materials and rubbish to prevent blowing dust and debris.
- .7 Under no circumstances dispose of rubbish or waste materials on adjoining property.

1.7 REGULATORY REQUIREMENTS

- .1 References and Codes:
 - .1 Perform Work in accordance with National Building Code of Canada (NBCC2015) and where applicable British Columbia Building Code (BCBC2012) including all amendments up to bid closing date and other codes of provincial or local application provided that in case of conflict or discrepancy, more stringent requirements apply.
- .2 Meet or exceed requirements of:
 - .1 Contract documents.
 - .2 Specified standards, codes and referenced documents.

1.8 QUALITY CONTROL

- .1 Inspection:
 - .1 Give timely notice requesting inspection if Work is designated for special tests, inspections or approvals by Departmental Representative instructions, or law of Place of Work.
 - .2 If Contractor covers or permits to be covered Work that has been designated for special tests, inspections or approvals before such is made, uncover such Work, have inspections or tests satisfactorily completed and make good such Work.
 - .3 Departmental Representative may order any part of Work to be examined if Work is suspected to be not in accordance with Contract Documents. If, upon examination such work is found not in accordance with Contract Documents, correct such Work and pay cost of examination and correction. If such Work is found in accordance with Contract Documents, Departmental Representative shall pay cost of examination and replacement.
- .2 Procedures:
 - .1 Notify appropriate agency and Departmental Representative in advance of requirement for tests, in order that attendance arrangements can be made.
 - .2 Submit samples and/or materials required for testing, as specifically requested in specifications. Submit with reasonable promptness and in an orderly sequence so as not to cause delay in Work.
 - .3 Provide labour and facilities to obtain and handle samples and materials on site. Provide sufficient space to store and cure test samples.
- .3 Rejected Work:
 - .1 Remove defective Work, whether result of poor workmanship, use of defective products or damage and whether incorporated in Work or not, which has been

- rejected by Departmental Representative as failing to conform to Contract Documents. Replace or re-execute in accordance with Contract Documents.
- .2 Make good other Contractor's work damaged by such removals or replacements promptly.
 - .4 Reports:
 - .1 Submit (4) four copies of inspection and test reports to Departmental Representative.
 - .5 Mock-ups:
 - .1 Prepare mock-ups for Work specifically requested in specifications. Include for Work of all Sections required to provide mock-ups.
 - .2 Construct in locations acceptable to Departmental Representative and as specified in specific Section.
 - .3 Prepare mock-ups for Departmental Representative review with reasonable promptness and in an orderly sequence, so as not to cause any delay in Work.
 - .4 Failure to prepare mock-ups in ample time is not considered sufficient reason for an extension of Contract Time and no claim for extension by reason of such default will be allowed.
 - .5 If requested, Departmental Representative will assist in preparing a schedule fixing dates for preparation.
 - .6 Specification section identifies whether mock-up may remain as part of Work or if it is to be removed and when.

1.9 TEMPORARY UTILITIES

- .1 Installation and Removal:
 - .1 Provide temporary utilities controls in order to execute work expeditiously.
 - .2 Remove from site all such work after use.
- .2 Dewatering:
 - .1 Provide temporary drainage and pumping facilities to keep excavations and site free from standing water.
- .3 Water Supply:
 - .1 Permanent water supply system may be used for construction requirements provided that guarantees are not affected thereby. Replace damaged components.
- .4 Temporary Power and Light:
 - .1 Electrical power and lighting may be used for construction purposes at no extra cost, provided that guarantees are not affected thereby and electrical components used for temporary power are replaced when damaged.
- .5 Temporary Communication Facilities:
 - .1 Provide and pay for temporary telephone and fax hook up, line(s) necessary for own use.
- .6 Fire Protection:
 - .1 Provide and maintain temporary fire protection equipment during performance of Work required by governing codes, regulations and bylaws.

1.10 CONSTRUCTION FACILITIES

- .1 Installation and Removal:
 - .1 Provide construction facilities in order to execute work expeditiously.
 - .2 Remove from site all such work after use.
- .2 Scaffolding:
 - .1 Design, construct and maintain scaffolding in rigid, secure and safe manner, in accordance with WorkSafeBC regulations and Section 01 35 33.
 - .2 Erect scaffolding independent of walls. Remove promptly when no longer required.
- .3 Hoisting:
 - .1 Provide, operate and maintain hoists required for moving of workers, materials and equipment. Make financial arrangements with Subcontractors for use thereof.
 - .2 Hoists to be operated by qualified operator.
- .4 Site Storage/Loading:
 - .1 Confine work and operations of employees by Contract Documents. Do not unreasonably encumber premises with products.
 - .2 Do not load or permit to load any part of Work with a weight or force that will endanger the Work.
- .5 Construction Parking:
 - .1 Make good damage to existing roads used for access to project site.
 - .2 Build and maintain temporary access where required and provide snow removal during period of Work.
 - .3 Park vehicles outside perimeter fence in designated parking areas.
- .6 Contractor's Site Office and enclosure:
 - .1 Provide office of size to accommodate Contractor's operations.
 - .2 Provide a clearly marked and fully stocked first-aid case in a readily available location.
 - .3 Provide temporary fenced area to enclose site and operations.
- .7 Equipment, Tools and Material Storage:
 - .1 Provide and maintain, in a clean and orderly condition, lockable weatherproof sheds for storage of tools, equipment and materials.
 - .2 Locate materials not required to be stored in weatherproof sheds on site in a manner to cause least interference with work activities.
- .8 Sanitary Facilities:
 - .1 Provide sanitary facilities for work force in accordance with governing regulations and ordinances.
 - .2 Permanent facilities may be used on approval of Departmental Representative.

1.11 TEMPORARY BARRIERS AND ENCLOSURES

- .1 Hoarding:
 - .1 Erect temporary site enclosure using new 1.8 m high temporary construction fencing. Provide lockable truck gate. Maintain fence in good repair.
- .2 Enclosure of Structure:
 - .1 Provide temporary weathertight enclosures and protection for exterior openings until permanently enclosed. Design enclosures to withstand wind pressure. Provide lockable entry as required for moving personnel equipment and materials.
 - .2 Provide temporary enclosures to secure building from entry of unauthorized personnel during construction period.
- .3 Guardrails and Excavations:
 - .1 Provide secure, rigid guard rails and barricades around open edges of floors and roofs etc.
 - .2 Provide as required by governing authorities.
- .4 Access to Site:
 - .1 Maintain immediate local access roads in clean condition used during work of this contract.
- .5 Protection for Off-Site and CSC Property:
 - .1 Protect surrounding CSC property from damage during performance of Work.
 - .2 Be responsible for damage incurred.
- .6 Protection of Building Finishes:
 - .1 Provide protection for finished and partially finished building finishes and equipment during performance of Work.
 - .2 Provide necessary screens, covers, and hoardings.
 - .3 Confirm with Departmental Representative locations and installation schedule 3 days prior to installation.
 - .4 Be responsible for damage incurred due to lack of or improper protection.

1.12 COMMON PRODUCT REQUIREMENTS

- .1 Reference Standards:
 - .1 If there is question as to whether any product or system is in conformance with applicable standards, Departmental Representative reserves right to have such products or systems tested to prove or disprove conformance.
 - .2 Cost for such testing will be born by Departmental Representative in event of conformance with Contract Documents or by Contractor in event of non-conformance.
 - .3 Conform to latest date of issue of referenced standards in effect on date of submission of Bids, except where specific date or issue is specifically noted.

- .2 Quality:
 - .1 Products, materials, equipment and articles (referred to as products throughout specifications) incorporated in Work shall be new, not damaged or defective, and of best quality (compatible with specifications) for purpose intended. If requested, furnish evidence as to type, source and quality of products provided.
 - .2 Defective products, whenever identified prior to completion of Work, will be rejected, regardless of previous inspections. Inspection does not relieve responsibility, but is precaution against oversight or error. Remove and replace defective products at own expense and be responsible for delays and expenses caused by rejection.
 - .3 Should any dispute arise as to quality or fitness of products, decision rests strictly with Departmental Representative based upon requirements of Contract Documents.
 - .4 Unless otherwise indicated in specifications, maintain uniformity of manufacture for any particular or like item throughout building.
 - .5 Permanent labels, trademarks and nameplates on products are not acceptable in prominent locations, except where required for operating instructions, or when located in mechanical or electrical rooms.
 - .6 The use of asbestos containing materials is prohibited in this project. Contractor shall provide a letter to the Departmental Representative prior to Substantial Completion confirming that asbestos containing materials are not used in this project.
- .3 Storage, Handling and Protection:
 - .1 Handle and store products in manner to prevent damage, adulteration, deterioration and soiling and in accordance with manufacturer's instructions when applicable.
 - .2 Store packaged or bundled products in original and undamaged condition with manufacturer's seal and labels intact. Do not remove from packaging or bundling until required in Work.
 - .3 Store products subject to damage from weather in weatherproof enclosures.
 - .4 Remove and replace damaged products at own expense and to satisfaction of Departmental Representative.
 - .5 Touch-up damaged factory finished surfaces to Departmental Representative's satisfaction. Use touch-up materials to match original. Do not paint over name plates.
- .4 Transportation:
 - .1 Pay costs of transportation of products required in performance of Work.
 - .2 Transportation cost of products supplied by Departmental Representative will be paid for by Departmental Representative. Unload, handle and store such products.
- .5 Manufacturer's Instructions:
 - .1 Unless otherwise indicated in specifications, install or erect products in accordance with manufacturer's instructions. Do not rely on labels or enclosures provided with products. Obtain written instructions directly from manufacturers.

- .2 Notify Departmental Representative in writing, of conflicts between specifications and manufacturer's instructions, so that Departmental Representative may establish course of action.
- .3 Improper installation or erection of products, due to failure in complying with these requirements, authorizes Departmental Representative to require removal and re-installation at no increase in Contract Price or Contract Time.
- .6 Quality of Work:
 - .1 Ensure Quality of Work is of highest standard, executed by workers experienced and skilled in respective duties for which they are employed. Immediately notify Departmental Representative if required Work is such as to make it impractical to produce required results.
 - .2 Do not employ anyone unskilled in their required duties. Departmental Representative reserves right to require dismissal from site, workers deemed incompetent or careless.
 - .3 Decisions as to standard or fitness of Quality of Work in cases of dispute rest solely with Departmental Representative, whose decision is final.
- .7 Co-ordination:
 - .1 Ensure cooperation of workers in laying out Work. Maintain efficient and continuous supervision.
- .8 Remedial Work:
 - .1 Perform remedial work required to repair or replace parts or portions of Work identified as defective or unacceptable. Coordinate adjacent affected Work as required.
 - .2 Perform remedial work by specialists familiar with materials affected. Perform in a manner neither to damage nor to put at risk any portion of Work.
- .9 Location of Fixtures:
 - .1 Consider location of mechanical fixtures indicated as approximate.
 - .2 Inform Departmental Representative of conflicting installation. Install as directed.
 - .3 Submit field drawings to indicate relative position of various services and equipment when required by Departmental Representative.
- .10 Fastenings:
 - .1 Provide metal fastenings and accessories in same texture, colour and finish as adjacent materials, unless indicated otherwise.
 - .2 Prevent electrolytic action between dissimilar metals and materials.
 - .3 Use non-corrosive hot dip galvanized steel fasteners and anchors for securing exterior work, unless stainless steel or other material is specifically requested in affected specification Section.
 - .4 Keep exposed fastenings to a minimum, space evenly and install neatly.
 - .5 Fastenings which cause spalling or cracking of material to which anchorage is made are not acceptable.

- .11 Protection of Work in Progress:
 - .1 Prevent overloading of any part of building. Do not cut, drill or sleeve any load bearing structural member, unless specifically indicated without written approval of Departmental Representative.
- .12 Existing Utilities:
 - .1 Where work involves breaking into or connecting to existing services, carry out work at times directed by governing authorities, with minimum of disturbance to pedestrian and vehicular traffic.
 - .2 Before commencing work, establish location and extent of service lines in areas of work and notify Departmental Representative of findings.
 - .3 Submit schedule to and obtain approval from Departmental Representative for any shut-down or closure of active service or facility. Adhere to approved schedule and provide notice to affected parties.
 - .4 Where unknown services are encountered, immediately advise Departmental Representative and confirm findings in writing.
 - .5 Record locations of maintained, capped and re-routed services lines.
- .13 Contractors Options for Selection of Products:
 - .1 Products specified by "**Prescriptive**" specifications: select any product meeting or exceeding specifications.
 - .2 Products specified under "**Acceptable Products**": select any one of the indicated manufacturers, or any other manufacturer meeting or exceeding the Prescriptive specifications and indicated Products.
 - .3 Products specified by performance and referenced standard: select any product meeting or exceeding the referenced standard.
 - .4 Products specified to meet particular design requirements or to match existing materials: use only material specified Approved Product. Alternative products may be considered provided full technical data is received in writing by Departmental Representative in accordance with "Instructions to Bidders".
 - .5 When products are specified by a referenced standard or by Performance specifications, upon request of Departmental Representative, obtain from manufacturer an independent laboratory report showing that the product meets or exceeds the specified requirements.
- .14 Substitution after award of Contract:
 - .1 No substitutions are permitted without prior written approval of the Departmental Representative.
 - .2 Proposals for substitution may only be submitted after Contract award. Such request must include statements of respective costs of items originally specified and the proposed substitution.
 - .3 Proposals will be considered by the Departmental Representative if:
 - .1 products selected by tenderer from those specified are not available;
 - .2 delivery date of products selected from those specified would unduly delay completion of Contract, or

- .3 alternative product to that specified, which is brought to the attention of and considered by Departmental Representative as equivalent to the product specified, and will result in a credit to the Contract amount.
- .4 Should the proposed substitution be accepted either in part or in whole, assume full responsibility and costs when substitution affects other work on the project. Pay for design or drawing changes required as result of substitution.
- .5 Amounts of all credits arising from approval of the substitutions will be determined by the Departmental Representative, and the Contract price will be reduced accordingly.

1.13 EXAMINATION AND PREPARATION

- .1 Existing Services:
 - .1 Before commencing work, establish location and extent of service lines in area of Work and notify Departmental Representative of findings.
- .2 Location of Equipment and Fixtures:
 - .1 Location of equipment, fixtures and outlets indicated or specified are to be considered as approximate.
 - .2 Inform Departmental Representative of impending installation and obtain approval for actual location.
 - .3 Submit field drawings to indicate relative position of various services and equipment when required by Departmental Representative.

1.14 EXECUTION REQUIREMENTS

- .1 Preparation:
 - .1 Inspect existing conditions, including elements subject to damage or movement during cutting and patching.
 - .2 After uncovering, inspect conditions affecting performance of Work.
 - .3 Beginning of cutting or patching means acceptance of existing conditions.
 - .4 Provide supports to assure structural integrity of surroundings; provide devices and methods to protect other portions of project from damage.
 - .5 Provide protection from elements for areas which may be exposed by uncovering work.
- .2 Execution:
 - .1 Execute cutting, fitting, and patching, to complete Work.
 - .2 Fit several parts together, to integrate with other Work.
 - .3 Uncover Work to install ill-timed Work.
 - .4 Remove and replace defective and non-conforming Work.
 - .5 Provide openings in non-structural elements of Work for penetrations of mechanical and electrical Work.
 - .6 Execute Work by methods to avoid damage to other Work, and which will provide proper surfaces to receive patching and finishing.

- .7 Employ original installer to perform cutting and patching for weather-exposed and moisture-resistant elements, and sight-exposed surfaces.
- .8 Cut rigid materials using purpose made saw or core drill. Pneumatic or impact tools not allowed on brittle materials without prior approval.
- .9 Restore work with new products in accordance with requirements of Contract Documents.
- .10 At penetration of fire rated wall, ceiling, or floor construction, completely seal voids with firestopping material, full thickness of the construction element.
- .11 Refinish surfaces to match adjacent finishes: For continuous surfaces refinish to nearest intersection; for an assembly, refinish entire unit.

1.15 CLEANING

- .1 Project Cleanliness:
 - .1 Maintain Work in tidy condition, free from accumulation of waste products and debris.
 - .2 Remove waste materials from site at regularly scheduled times or dispose of as directed by Departmental Representative. Do not burn waste materials on site, unless approved by Departmental Representative.
 - .3 Clear snow and ice from access to building.
 - .4 Provide on-site containers for collection of waste materials and debris.
 - .5 Provide and use clearly marked separate bins for recycling. Refer to Construction/Demolition Waste Management And Disposal.
 - .6 Store volatile waste in covered metal containers, and remove from premises at end of each working day.
 - .7 Provide adequate ventilation during use of volatile or noxious substances. Use of building ventilation systems is not permitted for this purpose.
 - .8 Use only cleaning materials recommended by manufacturer of surface to be cleaned, and as recommended by cleaning material manufacturer.
- .2 Final Cleaning:
 - .1 When Work is Substantially Performed, remove surplus products, tools, construction machinery and equipment not required for performance of remaining Work.
 - .2 Remove waste products and debris other than that caused by others, and leave Work clean and suitable for occupancy.
 - .3 Prior to final review, remove surplus products, tools, construction machinery and equipment.
 - .4 Clean roofs, downspouts, and drainage systems.

1.16 CONSTRUCTION/DEMOLITION WASTE MANAGEMENT AND DISPOSAL

- .1 Provide on-site facilities for collection, handling, and storage of anticipated quantities of reusable and/or recyclable materials and waste.
 - .1 Separate non-salvageable materials from salvaged items.

- .2 Handle waste materials not reused, salvaged, or recycled in accordance with appropriate regulations and codes.
- .3 Transport and deliver non-salvageable items to licensed disposal facility.
- .2 Provide containers to deposit reusable and/or recyclable materials. Locate containers in locations, to facilitate deposit of materials without hindering daily operations. Provide containers to deposit reusable and/or recyclable materials.
- .3 Collect, handle, store on-site and transport off-site, salvaged materials in separate condition. Transport to approved and authorized recycling facility and/or users of material for recycling.
- .4 Locate waste and salvage bins on site as directed by Departmental Representative.

1.17 CLOSEOUT PROCEDURES

- .1 Inspection and Declaration:
 - .1 Contractor's Inspection: Conduct an inspection of Work with all subcontractors, identify deficiencies and defects, and repair as required to conform to Contract Documents.
 - .2 Notify Departmental Representative in writing of satisfactory completion of Contractor's Inspection and that corrections have been made.
 - .3 Request Departmental Representative's Inspection.
- .2 Inspection: Departmental Representative and Contractor will perform inspection of Work to identify obvious defects or deficiencies. Contractor shall correct Work accordingly.
- .3 Substantial Completion: submit written certificate that following have been performed:
 - .1 Work has been completed and inspected for compliance with Contract Documents.
 - .2 Defects have been corrected and deficiencies have been completed.
 - .3 Required new roof assembly warranties and bonds.
- .4 Final Inspection: when items noted above are completed, request final inspection of Work by Departmental Representative. If Work is deemed incomplete by Departmental Representative, complete outstanding items and request re-inspection.

1.18 CLOSEOUT SUBMITTAL

- .1 Record Drawings:
 - .1 As work progresses, maintain accurate records to show all deviations from the Contract Drawings. Note on as-built drawings as changes occur. At completion supply:
 - .1 Four (4) sets of CD's in AutoCad file format (version: 2010) and PDF format with all as-built information on the diskettes.
 - .2 Four (4) sets of printed as-built drawings.
 - .3 Submit one copy of check plots to Departmental Representative prior to final printing of as-built drawings.
 - .4 Departmental Representative will supply copies of the original AutoCad files.

- .5 Retain original logo and title block on the as-built drawings. Contractor may place on the upper right-hand title block area a small company logo, the text "AS-BUILT" and the date.
- .2 Costs for transferring as-built information from marked up working set of drawings to electronic format using ACAD and plotting service is included in the Contract.
- .2 Operation and Maintenance Manuals:
 - .1 On completion of project submit to Departmental Representative four (4) CD R/disk copies and four (4) paper copies (in loose leaf type binder) of Operation and Maintenance Manual, made up as follows:
 - .1 Provide maintenance manual on CDs using pdf, or other approved format for descriptive writing, page size images and page size drawings. Organize manuals into industry standard maintenance manual tabs with links in index to each descriptive section describing the component or maintenance procedure etc.
 - .2 Organize files into CSI Masterformat numbering system or other approved descriptive titles.
 - .3 Label disk "Operation and Maintenance Data", project name, date, names of Contractor, subcontractors, consultants and subconsultants.
 - .4 Include scanned guarantees, diagrams and drawings.
 - .5 Organize contents into applicable sections of work to parallel project specification break-down. Mark each section by labeled tabs (navigational buttons).
 - .6 Drawings, diagrams and manufacturer's literature must be legible.
- .3 Maintenance Materials, Special Tools and Spare Parts:
 - .1 Specific requirements for maintenance materials, tools and spare parts are specified in individual sections.
- .4 Warranties and Bonds:
 - .1 Separate each warranty or bond with index tab sheets keyed to Table of Contents listing in maintenance manual.
 - .2 List subcontractor, supplier, and manufacturer, with name, address, and telephone number of responsible principal.
 - .3 Obtain warranties and bonds, executed in duplicate by subcontractors, suppliers, and manufacturers, within ten days after completion of the applicable item of work.
 - .4 Except for items put into use with Departmental Representative's permission, leave date of beginning of time of warranty until the Date of Interim Completion is determined.
 - .5 Verify that documents are in proper form, contain full information, and are notarized.
 - .6 Retain warranties and bonds until time specified for submittal

END OF SECTION

PART 1 GENERAL

1.1 Purpose

- .1 To ensure that both the construction project and the institutional operations may proceed without undue disruption or hindrance and that the security of the Institution is maintained at all times.

1.2 Purpose

- .1 "Contraband" means:
 - .1 an intoxicant, including alcoholic beverages, drugs and narcotics
 - .2 a weapon or a component thereof, ammunition for a weapon, and anything that is designed to kill, injure or disable a person or that is altered so as to be capable of killing, injuring or disabling a person, when possessed without prior authorization,
 - .3 an explosive or a bomb or a component thereof,
 - .4 currency over any applicable prescribed limit, \$25.00, and
 - .5 any item not described in paragraphs (a) to (d) that could jeopardize the security of a Penitentiary or the safety of persons, when that item is possessed without prior authorization.
- .2 Unauthorized smoking and related article 1.15 herein the section means all smoking items including, but not limited to, cigarettes, cigars, tobacco, chewing tobacco, cigarette making machines, matches and lighters.
- .3 "Commercial Vehicle" means any motor vehicle used for the shipment of material, equipment and tools required for the construction project.
- .4 "CSC" means Correctional Service Canada.
- .5 "Director" means Director or Warden of the Institution as applicable or their representative.
- .6 "Construction employees" means persons working for the general contractor, the sub-contractors, equipment operators, material suppliers, testing and inspection companies and regulatory agencies.
- .7 "Departmental Representative" means the Public Works and Government Services Canada representative defined in General Conditions.
- .8 "Perimeter" means the fenced or walled area of the institution that restrains the movement of the inmates.
- .9 "Construction zone" means the area, as indicated in the contract documents, that the contractor will be allowed to work". This area may or may not be isolated from the security area of the institution. Limits to be confirmed at construction start-up meeting.

1.3 Preliminary Proceedings

- .1 At construction start-up meeting:
 - .1 Discuss the nature and extent of all activities involved in the Project.
 - .2 Establish mutually acceptable security procedures in accordance with this instruction and the institution's particular requirements.

- .2 The Contractors' responsibilities:
 - .1 Ensure that all construction employees are aware of the CSC security requirements.
 - .2 Ensure that a copy of the CSC security requirements is always prominently on display at the job site.
 - .3 Co-operate with institutional personnel in ensuring that security requirements are observed by all construction employees.

1.4 Construction Employees

- .1 Submit scanned copy of government issued ID for each employee to the Departmental Representative.
- .2 Allow 10 working days for processing of security clearances. Employees will not be admitted to the Institution without a valid security clearance in place and a recent picture identification such as a provincial driver's license. Security clearances obtained from other CSC institutions are not valid at this institution except as approved otherwise.
- .3 The Director may require that facial photographs may be taken of construction employees and these photographs may be displayed at appropriate locations in the institution or in an electronic database for identification purposes. The Director may require that Photo ID cards be provided for all construction workers. ID cards will then be left at the designated entrance to be picked upon arrival at the institution and shall be displayed prominently on the construction employees clothing at all time while employees are at the institution.
- .4 Entry to Institutional Property will be refused to any person there may be reason to believe may be a security risk.
- .5 Any person employed on the construction site will be subject to immediate removal from Institutional Property if they:
 - .1 appear to be under the influence of alcohol, drugs or narcotics.
 - .2 behave in an unusual or disorderly manner.
 - .3 are in possession of contraband.

1.5 Vehicles

- .1 All unattended vehicles on CSC property must have windows closed; fuel caps locked, doors and trunks locked and keys removed. The keys must be securely in the possession of the owner or an employee of the company that owns the vehicle.
- .2 The director may limit at any time the number and type of vehicles allowed within the Institution.
- .3 Drivers of delivery vehicles for material required by the project will require security clearances and must remain with their vehicle the entire time that the vehicle is in the Institution. The director may require that these vehicles be escorted by Institutional staff or PSPC Construction Escorts while in the Institution.
- .4 If the Director permits trailers to be left inside the secure perimeter of the Institution, the trailer doors must be locked at all times. All windows must be securely locked bars when left unoccupied. Cover all windows with expanded metal mesh. When not in use lock all storage trailers located inside and outside the perimeter. All storage trailers inside and outside the perimeter must be locked when not in use.

1.6 Parking

- .1 The parking area(s) to be used by construction employees will be designated by the Director. Parking in other locations will be prohibited and vehicles may be subject to removal.

1.7 Shipments

- .1 To avoid confusion with the institution's own shipments, address all shipments of project material, equipment and tools in the Contractor's name and have a representative on site to receive any deliveries or shipments. CSC or PSPC staff will **NOT** accept receipt of deliveries or shipments of any material equipment or tools for the contractor.

1.8 Telephones

- .1 The installation of telephones, facsimile machines and computers with Internet connections is not permitted within the Institution perimeter unless prior approved by the Director.
- .2 The Director will ensure that approved telephones, facsimile machine and computers with Internet connections are located where they are not accessible to inmates. All computers will have an approved password protection that will stop an Internet connection to unauthorized personnel.
- .3 Wireless cellular and digital telephones, including but not limited to devices for telephone messaging, pagers, Blackberries, PDAs, telephone used as 2-way radios are not permitted within the Institution unless approved by the Director. If wireless cellular telephones are permitted, the user will not permit their use by any inmate.
- .4 The Director may approve but limit the use of 2-way radios.

1.9 Work Hours

- .1 Work hours within the Institution are: conform to General Instructions Section 01 01 50.
- .2 Work is not permitted during weekends and statutory holidays without the permission of the Director. A minimum of seven days advance notice will be required to obtain the required permission. In case of emergencies or other special circumstances, this advance notice may be waived by the Director.

1.10 Overtime Work

- .1 Conform to Section 01 01 50.
- .2 Provide 48 hours advance notice to Director for all work to be performed after normal working hours of the Institution. Notify Director immediately if emergency work is required, such as to complete a concrete pour or make the construction site safe and secure.

1.11 Tools and Equipment

- .1 Maintain a complete list of all tools and equipment to be used during the construction project. Make this inventory available for inspection when required by the Institution.
- .2 Throughout the construction project maintain up-to-date the list of tools and equipment specified above.

- .3 Keep all tools and equipment under constant supervision, particularly power-driven and cartridge-driven tools, cartridges, files, saw blades, rod saws, wire, rope, ladders and any sort of jacking device.
- .4 Store all tools and equipment in approved secure locations.
- .5 Lock all tool boxes when not in use. Keys to remain in the possession of the employees of the contractor. Secure and lock scaffolding when not erected and when erected Secure in a manner agreed upon with the Institution designate.
- .6 Report all missing or lost tools or equipment immediately to the Departmental Representative/Director.
- .7 The Director will ensure that the security staff members carry out checks of the Contractor's tools and equipment against the list provided by the Contractor. These checks may be carried out at the following intervals:
 - .1 At the beginning and conclusion of every work day or shift upon entering and exiting the Institution.
 - .2 At any time when contractor is on Institution property.
- .8 Certain tools/equipment such as cartridges and hacksaw blades are highly controlled items. The contractor will be given at the beginning of the day, a quantity that will permit one day's work. Used blades/cartridges will be returned to the Director's representative at the end of each day. Maintain up to date inventory of all used blades/cartridges.
- .9 If propane or natural gas is used for heating the construction, the institution will require that the contractor supervise the construction site during non-working hours.

1.12 Keys

- .1 Use standard construction cylinders for locks for his use during the construction period.
- .2 Issue instructions to employees and sub-trades, as necessary, to ensure safe custody of the construction set of keys.

1.13 Security Hardware

- .1 Turn over all removed security hardware to the Director of the Institution for disposal or for safekeeping until required for re-installation.

1.14 Prescription Drugs

- .1 Employees of the contractor who are required to take prescription drugs during the workday shall obtain approval of the Director to bring a one day supply only into the Institution.

1.15 Smoking Restrictions

- .1 Smoking is not permitted inside correctional facilities or outdoors within the perimeter of a correctional facility and persons must not possess unauthorized smoking items within the perimeter of a correctional facility.
- .2 Persons in violation of this policy will be requested to immediately cease smoking or dispose of any unauthorized smoking items and, if they persist will be directed to leave the Institution.

- .3 Smoking is permitted outside the perimeter of a correctional facility in an area designated by the Director.

1.16 Contraband

- .1 Weapons, ammunition, explosives, alcoholic beverages, drugs and narcotics are prohibited on institutional property.
- .2 The discovery of contraband on the construction site and the identification of the person(s) responsible for the contraband shall be reported immediately to the Director.
- .3 Contractors should be vigilant with both their staff and the staff of their sub-contractors and suppliers that the discovery of contraband may result in cancellation of the security clearance of the affected employee. Serious infractions may result in the removal of the company from the Institution for the duration of the construction.
- .4 Presence of arms and ammunition in vehicles of contractors, sub-contractors and suppliers or employees of these will result in the immediate cancellation of security clearances for the driver of the vehicle.

1.17 Searches

- .1 All vehicles and persons entering institutional property may be subject to search.
- .2 When the Director suspects, on reasonable grounds, that an employee of the Contractor is in possession of contraband, he may order that person to be searched.
- .3 All employees entering the Institution may be subject to screening of personal effects for traces of contraband drug residue.

1.18 Access and Removal from Institution Property

- .1 Construction personnel and commercial vehicles will not be admitted to the institution after normal working hours, unless approved by the Director.

1.19 Movement Vehicles

- .1 Construction vehicles are not to leave the Institution until an inmate count is completed. Escorted commercial vehicles will be allowed to enter or leave the institution through the vehicle access gate during the following hours:
 - .1 AM: 0745 hrs. to 1100 hrs.
 - .2 PM: 1300hrs. to 1530 hrs.
- .2 The contractor will advise the Director twenty four (24) hours in advance to the arrival on the site of heavy equipment such as concrete trucks, cranes, etc.
- .3 Vehicles being loaded with soil or other debris, or any vehicle considered impossible to search, must be under continuous supervision by CSC staff or PSPC construction escorts working under the authority of the Director.
- .4 Commercial vehicles will only be allowed access to institutional property when their contents are certified by the Contractor or his representative as being strictly necessary to the execution of the construction project.
- .5 Vehicles will be refused access to institutional property if, in the opinion of the Director, they contain any article which may jeopardize the security of the institution. Arrange with Director for parking of contractor's vehicles at minimum security Institutions.

- .6 Private vehicles of construction employees will not be allowed within the security wall or fence of medium or maximum security institutions without the authorization of the Director.
- .7 With the approval of the Director, certain equipment may be permitted to remain on the construction site overnight or over the weekend. This equipment must be securely locked, with the battery removed. The Director may require that the equipment be secured with a chain and padlock to another solid object.

1.20 Movement of Construction Employees on Institutional Property

- .1 Subject to the requirements of good security, the Director will permit the Contractor and his employees as much freedom of action and movement as is possible.
- .2 However, notwithstanding paragraph above, the Director may:
 - .1 Prohibit or restrict access to any part of the institution.
 - .2 Require that in certain areas of the institution, either during the entire construction project or at certain intervals, construction employees only be allowed access when accompanied by a member of the CSC security staff or PSPC Construction Escort Officer.
- .3 During the lunch and coffee/health breaks, all construction employees will remain within the construction site. Construction employees are not permitted to eat in the Institution cafeteria and dining room.

1.21 Surveillance and Inspection

- .1 Construction activities and all related movement of personnel and vehicles will be subject to surveillance and inspection by CSC security staff members to ensure that established security requirements are met.
- .2 CSC staff members will ensure that an understanding of the need to carry out surveillance and inspections, as specified above, is established among construction employees and maintained throughout the construction project.

1.22 Stoppage of Work

- .1 The director may request at any time that the contractor, his employees, sub-contractors and their employees not enter or leave the work site immediately due to a security situation occurring within the Institution. The contractor's site supervisor will note the name of the staff member giving the instruction, the time of the request and obey the order as quickly as possible.
- .2 The contractor shall advise the Departmental Representative of this interruption of the work within 24 hours.

1.23 Contact with Inmates

- .1 Unless specifically authorized, it is forbidden to come into contact with inmates, to talk with them, to receive objects from them or to give them objects. Any employee doing any of the above will be removed from the site and his security clearance revoked.
- .2 Digital cameras (or any other type) are not allowed on CSC property.
- .3 Notwithstanding the above paragraph, if the director approves of the use of cameras, it is strictly forbidden to take pictures of inmates, of CSC staff members or of any part of the Institution other than those required as part of this contract.

1.24 Completion of Construction Project

- .1 Upon completion of the construction project or, when applicable, the takeover of a facility, the Contractor shall remove all remaining construction material, tools and equipment that are not specified to remain in the Institution as part of the construction contract.

END OF SECTION

PART 1 - GENERAL

1.1 References

- .1 Government of Canada.
 - .1 Canada Labour Code - Part II
 - .2 Canada Occupational Health and Safety Regulations.
- .2 National Building Code of Canada (NBC 2015):
 - .1 Part 8, Safety Measures at Construction and Demolition Sites.
- .3 The Canadian Electric Code (as amended)
- .4 Canadian Standards Association (CSA) as amended:
 - .1 CSA Z797-2009 Code of Practice for Access Scaffold
 - .2 CSA S269.1-1975 (R2003) Falsework for Construction Purposes
 - .3 CSA S350-M1980 (R2003) Code of Practice for Safety in Demolition of Structures
 - .4 CSA Z1006-10 Management of Work in Confined Spaces.
 - .5 CSA Z462- Workplace Electrical Safety Standard
- .5 National Fire Code of Canada 2015 (as amended)
 - .1 Part 5 – Hazardous Processes and Operations and Division B as applicable and required.
- .6 American National Standards Institute (ANSI):
 - .1 ANSI A10.3, Operations – Safety Requirements for Powder-Actuated Fastening Systems.
- .7 Province of British Columbia:
 - .1 Workers Compensation Act Part 3-Occupational Health and Safety.
 - .2 Occupational Health and Safety Regulation

1.2 Related Sections

- .1 Refer to the following current NMS sections as required:
 - .1 Section 01 01 50 General Instructions

1.3 Workers' Compensation Board Coverage

- .1 Comply fully with the Workers' Compensation Act, regulations and orders made pursuant thereto, and any amendments up to the completion of the work.
- .2 Maintain Workers' Compensation Board coverage during the term of the Contract, until and including the date that the Certificate of Final Completion is issued.

1.4 Compliance with Regulations

- .1 PSPC may terminate the Contract without liability to PSPC where the Contractor, in the opinion of PSPC, refuses to comply with a requirement of the Workers' Compensation Act or the Occupational Health and Safety Regulations.
- .2 It is the Contractor's responsibility to ensure that all workers are qualified, competent and certified to perform the work as required by the Workers' Compensation Act or the Occupational Health and Safety Regulations.

1.5 Submittals

- .1 Submit to Departmental Representative submittals listed for review in accordance with Section 01 01 50.
- .2 Work effected by submittal shall not proceed until review is complete.
- .3 Submit the following:
 - .1 Health and Safety Plan.
 - .2 Copies of reports or directions issued by Federal and Provincial health and safety inspectors.
 - .3 Copies of incident and accident reports.
 - .4 Complete set of Material Safety Data Sheets (MSDS), and all other documentation required by Workplace Hazardous Materials Information System (WHMIS) requirements.
 - .5 Emergency Procedures.
- .4 The Departmental Representative will review the Contractor's site-specific project Health and Safety Plan and emergency procedures, and provide comments to the Contractor within 10 days after receipt of the plan. Revise the plan as appropriate and resubmit to Departmental Representative.
- .5 Medical surveillance: where prescribed by legislation, regulation or safety program, submit certification of medical surveillance for site personnel prior to commencement of work, and submit additional certifications for any new site personnel to Departmental Representative.
- .6 Submission of the Health and Safety Plan, and any revised version, to the Departmental Representative is for information and reference purposes only. It shall not:
 - .1 Be construed to imply approval by the Departmental Representative.
 - .2 Be interpreted as a warranty of being complete, accurate and legislatively compliant.
 - .3 Relieve the Contractor of his legal obligations for the provision of health and safety on the project.

1.6 Responsibility

- .1 Assume responsibility as the Prime Contractor for work under this contract.
- .2 Be responsible for health and safety of persons on site, safety of property on site and for protection of persons adjacent to site and environment to extent that they may be affected by conduct of Work.

- .3 Comply with and enforce compliance by employees with safety requirements of Contract documents, applicable Federal, Provincial, Territorial and local statutes, regulations, and ordinances, and with site-specific Health and Safety Plan.

1.7 Health and Safety Coordinator

- .1 The Health and Safety Coordinator (Registered Occupational Hygienist, Certified Industrial Specified Hygienist) must:
 - .1 Be responsible for completing all health and safety training, and ensuring that personnel that do not successfully complete the required training are not permitted to enter the site to perform work.
 - .2 Be responsible for implementing, daily enforcing, and monitoring the site specific Health and Safety Plan.
 - .3 Be on site during execution of work.

1.8 General Conditions

- .1 Provide safety barricades and lights around work site as required to provide a safe working environment for workers and protection for pedestrian and vehicular traffic.
- .2 Ensure that non-authorized persons are not allowed to circulate in designated construction areas of the work site.
 - .1 Provide appropriate means by use of barricades, fences, warning signs, traffic control personnel, and temporary lighting as required.
 - .2 Secure site at night time or provide security guard as deemed necessary to protect site against entry.

1.9 Project/Site Conditions

- .1 Work at site will involve contact with:
 - .1 Multi-employer work site.
 - .2 Federal employees and general public.
 - .3 Energized electrical services.
 - .4 Working from heights
 - .5 Persons incarcerated in the federal institutional system

1.10 Utility Clearances

- .1 The Contractor is solely responsible for all utility detection and clearances prior to starting the work.
- .2 The Contractor will not rely solely upon the Reference Drawings or other information provided for utility locations.

1.11 Regulatory Requirements

- .1 Comply with specified codes, acts, bylaws, standards and regulations to ensure safe operations at site.

- .2 In event of conflict between any provision of the above authorities, the most stringent provision will apply. When a dispute arise in determining the most stringent requirement, the Departmental Representative will advise on the course of action to be followed.

1.12 Work Permits

- .1 Obtain specialty permit related to project before start of work.

1.13 Filing of Notice

- .1 The General Contractor is to complete and submit a Notice of Project as required by Provincial authorities.
- .2 Provide copies of all notices to the Departmental Representative.

1.14 Site Specific Health and Safety Plan

- .1 Conduct a site-specific hazard assessment based on review of Contract documents, required work, and project site. Identify any known and potential health risks and safety hazards.
- .2 Prepare and comply with a Site-Specific Health and Safety Plan based on hazard assessment, including, but not limited to, the following:
 - .1 Primary requirements:
 - .1 Contractor's safety policy.
 - .2 Identification of applicable compliance obligations.
 - .3 Definition of responsibilities for project safety/organization chart for project.
 - .4 General safety rules for project.
 - .5 Job-specific safe work, procedures.
 - .6 Inspection policy and procedures.
 - .7 Incident reporting and investigation policy and procedures.
 - .8 Occupational Health and Safety Committee/Representative procedures.
 - .9 Occupational Health and Safety meetings.
 - .10 Occupational Health and Safety communications and record keeping procedures.
 - .2 Summary of health risks and safety hazards resulting from analysis of hazard assessment, with respect to site tasks and operations which must be performed as part of the work.
 - .3 List hazardous materials to be brought on site as required by work.
 - .4 Indicate Engineering and administrative control measures to be implemented at the site for managing identified risks and hazards.
 - .5 Identify personal protective equipment (PPE) to be used by workers.
 - .6 Identify personnel and alternates responsible for site safety and health.
 - .7 Identify personnel training requirements and training plan, including site orientation for new workers.

- .3 Develop the plan in collaboration with all subcontractors. Ensure that work/activities of subcontractors are included in the hazard assessment and are reflected in the plan.
- .4 Revise and update Health and Safety Plan as required, and re-submit to the Departmental Representative.
- .5 Departmental Representative's review: the review of Health and Safety Plan by Public Services and Procurement Canada (PSPC) shall not relieve the Contractor of responsibility for errors or omissions in final Health and Safety Plan or of responsibility for meeting all requirements of construction and Contract documents.

1.15 Emergency Procedures

- .1 List standard operating procedures and measures to be taken in emergency situations. Include an evacuation plan and emergency contacts (i.e. names/telephone numbers) of:
 - .1 Designated personnel from own company.
 - .2 Regulatory agencies applicable to work and as per legislated regulations.
 - .3 Local emergency resources.
 - .4 Departmental Representative.
- .2 Include the following provisions in the emergency procedures:
 - .1 Notify workers and the first-aid attendant, of the nature and location of the emergency.
 - .2 Evacuate all workers safely.
 - .3 Check and confirm the safe evacuation of all workers.
 - .4 Notify the fire department or other emergency responders.
 - .5 Notify adjacent workplaces or residences which may be affected if the risk extends beyond the workplace.
 - .6 Notify Departmental Representative.
- .3 Provide written rescue/evacuation procedures as required for, but not limited to:
 - .1 Work at high angles.
 - .2 Work in confined spaces or where there is a risk of entrapment.
 - .3 Work with hazardous substances.
 - .4 Underground work.
 - .5 Work on, over, under and adjacent to water.
 - .6 Workplaces where there are persons who require physical assistance to be moved.
- .4 Design and mark emergency exit routes to provide quick and unimpeded exit.
- .5 Revise and update emergency procedures as required, and re-submit to the Departmental Representative.

1.16 Hazardous Products

- .1 Comply with requirements of Workplace Hazardous Materials Information System (WHMIS) regarding use, handling, storage and disposal of hazardous materials, and

regarding labeling and provision of Material Safety Data Sheets (MSDS) acceptable to the Departmental Representative and in accordance with the Canada Labour Code.

- .2 Where use of hazardous and toxic products cannot be avoided:
 - .1 Advise Departmental Representative beforehand of the product(s) intended for use. Submit applicable MSDS and WHMIS documents as per Section 01 01 50.
 - .2 In conjunction with Departmental Representative, schedule to carry out work during "off hours" when tenants have left the building.
 - .3 Provide adequate means of ventilation for flooring installation.
 - .4 The contractor shall ensure that the product is applied as per manufacturers recommendations.
 - .5 The contractor shall ensure that only pre-approved products are brought onto the work site in an adequate quantity to complete the work.

1.17 Asbestos Hazard

- .1 Carry out any activities involving asbestos in accordance with applicable Provincial Regulations.
- .2 Removal and handling of asbestos will be performed as indicated in Division 2 specifications.

1.18 PCB Removals

- .1 Mercury-containing fluorescent tubes and ballasts which contain polychlorinated biphenyls (PCBs) are classified as hazardous waste.
- .2 Remove, handle, transport and dispose of as indicated in Division 2 specifications.

1.19 Removal of Lead-Containing Paint

- .1 All paints containing TCLP lead concentrations above 5 ppm are classified as hazardous.
- .2 Carry out demolition activities involving lead-containing paints in accordance with applicable provincial regulations.
- .3 Work with lead containing paints shall be completed as per provincial and federal regulations.

1.20 Electrical Safety Requirements

- .1 Comply with authorities and ensure that, when installing new facilities or modifying existing facilities, all electrical personnel are completely familiar with existing and new electrical circuits and equipment and their operation.
 - .1 Before undertaking any work, coordinate required energizing and de-energizing of new and existing circuits with Departmental Representative.
 - .2 Maintain electrical safety procedures and take necessary precautions to ensure safety of all personnel working under this Contract, as well as safety of other personnel on site.

1.21 Electrical Lockout

- .1 Develop, implement and enforce use of established procedures to provide electrical lockout and to ensure the health and safety of workers for every event where work must be done on any electrical circuit or facility.
- .2 Prepare the lockout procedures in writing, listing step-by-step processes to be followed by workers, including how to prepare and issue the request/authorization form. Have procedures available for review upon request by the Departmental Representative.
- .3 Keep the documents and lockout tags at the site and list in a log book for the full duration of the Contract. Upon request, make such data available for viewing by Departmental Representative or by any authorized safety representative.

1.22 Overloading

- .1 Ensure no part of work is subjected to a load which will endanger its safety or will cause permanent deformation.

1.23 Falsework

- .1 Design and construct falsework in accordance with CSA S269.1-1975 (R2003).

1.24 Scaffolding

- .1 Design, construct and maintain scaffolding in a rigid, secure and safe manner, in accordance with CSA Z797-2009 Code of Practice for Access Scaffold and BC Occupational Health and Safety Regulations.

1.25 Confined Spaces

- .1 Carry out work in confined spaces in compliance with Provincial regulations.

1.26 Power-Actuated Devices

- .1 Use powder-actuated devices in accordance with ANSI A10.3 only after receipt of written permission from the Departmental Representative.

1.27 Fire Safety and Hot Work

- .1 Obtain Departmental Representative's authorization before any welding, cutting or any other hot work operations can be carried out on site.
- .2 Hot work includes cutting/melting with use of torch, flame heating roofing kettles, or other open flame devices and grinding with equipment which produces sparks.

1.28 Fire Safety Requirements

- .1 Store oily/paint-soaked rags, waste products, empty containers and materials subject to spontaneous combustion in ULC approved, sealed containers and remove from site on a daily basis.
- .2 Handle, store, use and dispose of flammable and combustible materials in accordance with the National Fire Code of Canada.
- .3 Portable gas and diesel fuel tanks are not permitted on most federal work sites. Approval from the Departmental Representative is required prior to any gas or diesel tank being brought onto the work site.

1.29 Fire Protection and Alarm System

- .1 Fire protection and alarm systems shall not be:
 - .1 Obstructed.
 - .2 Shut off.
 - .3 Left inactive at the end of a working day or shift.
- .2 Do not use fire hydrants, standpipes and hose systems for purposes other than firefighting.
- .3 Be responsible/liable for costs incurred from the fire department, the building owner and the tenants, resulting from false alarms.

1.30 Unforeseen Hazards

- .1 Should any unforeseen or peculiar safety-related factor, hazard or condition become evident during performance of the work, immediately stop work and advise the Departmental Representative verbally and in writing.

1.31 Posted Documents

- .1 Post legible versions of the following documents on site:
 - .1 Health and Safety Plan.
 - .2 Sequence of work.
 - .3 Emergency procedures.
 - .4 Site drawing showing project layout, locations of the first-aid station, evacuation route and marshalling station, and the emergency transportation provisions.
 - .5 Notice of Project.
 - .6 Floor plans or site plans. Must be posted in a non-inmate access area and locked up when not being used.
 - .7 Notice as to where a copy of the Workers' Compensation Act and Regulations are available on the work site for review by employees and workers.
 - .8 Workplace Hazardous Materials Information System (WHMIS) documents.
 - .9 Material Safety Data Sheets (MSDS).
 - .10 List of names of Joint Health and Safety Committee members, or Health and Safety Representative, as applicable.
- .2 Post all Material Safety Data Sheets (MSDS) on site, in a common area, visible to all workers and in locations accessible to tenants when work of this Contract includes construction activities adjacent to occupied areas.
- .3 Postings should be protected from the weather, and visible from the street or the exterior of the principal construction site shelter provided for workers and equipment, or as approved by the Departmental Representative.

1.32 Meetings

- .1 Attend health and safety pre-construction meeting and all subsequent meetings called by the Departmental Representative.

1.33 Correction of Non-Compliance

- .1 Immediately address health and safety non-compliance issues identified by the Departmental Representative.
- .2 Provide Departmental Representative with written report of action taken to correct non-compliance with health and safety issues identified.
- .3 The Departmental Representative may issue a "stop work order" if non-compliance of health and safety regulations is not corrected immediately or within posted time. The General Contractor/subcontractors will be responsible for any costs arising from such a "stop work order".

PART 2 - PRODUCTS

- 2.1 Not Used**

PART 3 - EXECUTION

- 3.1 Not Used**

END OF SECTION

PART 1 GENERAL

1.1 SUMMARY OF WORK

- .1 Section includes: provide new cold liquid applied elastomeric roofing membrane over existing metal roof cladding and flashing including but not limited to following:
 - .1 Substrate preparation.
 - .2 Cold liquid applied elastomeric roofing membrane and flashings.
- .2 Related sections:
 - 01 01 50 General instructions

1.2 REFERENCES

- .1 Abbreviations and Acronyms:
 - CaGBC: Canadian Green Building Council; www.cagbc.org.
 - CRCA: Canadian Roofing Contractors' Association; www.roofingcanada.com.
 - LEED®: Leadership in Energy and Environmental Design; www.cagbc.org.
 - LTTR: Long Term Thermal Resistance.
 - SBS: Styrene-butadiene-styrene.
 - ULC: Underwriters Laboratories of Canada; www.ulc.ca.
 - ULE: UL Environment; www.ulenvironment.com.
 - VOC: Volatile Organic Compound.
- .2 Definitions: Conform to ASTM D1079 for glossary of terms and definitions of roofing terminology.
- .3 Reference Standards:
 - .1 ASTM C920-11 - Standard Specification for Elastomeric Joint Sealants
 - .2 ASTM C1177/C1177M-08 - Standard Specification for Glass Mat Gypsum Sub-strate for Use as Sheathing.
 - .3 ASTM D570-98(05) - Standard Test Method for Water Absorption of Plastics.
 - .4 ASTM D638-08 - Standard Test Method for Tensile Properties of Plastics.
 - .5 ASTM D1004-08 - Standard Test Method for Tear Resistance (Graves Tear) of Plastic Film and Sheeting.
 - .6 ASTM D1079-10 - Standard Terminology Relating to Roofing, Waterproofing, and Bituminous Materials
 - .7 ASTM D1204-08 - Standard Test Method for Linear Dimensional Changes of Non-rigid Thermoplastic Sheeting or Film at Elevated Temperature
 - .8 ASTM D2136-02(07) - Standard Test Method for Coated Fabric-Low-Temperature Bend Test
 - .9 ASTM D3045-92(03) - Standard Practice for Heat Aging of Plastics Without Load

- .10 ASTM D5602-98(06) - Standard Test Method for Static Puncture Resistance of Roofing Membrane Specimens
- .11 ASTM D5635-04a - Standard Test method for Dynamic Puncture Resistance of Roofing Membrane Specimens
- .12 ASTM E84-10b - Standard Test Method for Surface Burning Characteristics of Building Materials
- .13 ASTM E108 - 17 - Standard Test Methods for Fire Tests of Roof Coverings
- .14 ASTM E96/E96M-05 - Standard Test Methods for Water Vapor Transmission of Materials
- .15 CSA B111-74(03) - Wire Nails, Spikes and Staples
- .16 CAN/ULC-S102-03 - Standard Method of Test for Surface Burning Characteristics of Building Materials and Assemblies
- .17 CAN/ULC-S107-03 - Standard Methods of Fire Tests of Roof Coverings
- .18 CAN/ULC-S114-05 - Standard Method of Test for Determination of Non- Combustibility in Building Materials
- .19 CAN/ULC-S126-06 - Standard Method of Test for Fire Spread Under Roof-Deck Assemblies

1.3 ADMINISTRATION REQUIRMENTS

- .1 Pre-installation Meetings:
 - .1 Arrange pre-installation meeting 1 week prior to commencing work with all parties associated with trade as designated in Contract Documents or as requested by Departmental Representative. Presided over by Contractor, Sub-contractor performing work of this trade, Departmental Representative, testing company's representative. Review Contract Documents for work included under this trade and determine complete understanding of requirements and responsibilities relative to work included, storage and handling of materials, materials to be used, installation of materials, sequence and quality control, Project staffing, restrictions on areas of work and other matters affecting construction, to permit compliance with intent of work of this Section.
 - .2 Review installation procedures and coordination required with related work including roofing requirements for interfacing with roof accessories and roof mounted equipment.
 - .3 Review methods and procedures related to roofing installation, including manufacturer's written instructions.
 - .4 Review and finalize construction schedule and verify availability of materials, installer's personnel, equipment and facilities needed to make progress and avoid delays.
 - .5 Examine existing substrate conditions for compliance with requirements, including flatness and compatibility with the specified new roof.

- .6 Review structural loading limitations of roof deck during roofing.
 - .7 Review base flashings, special roofing details, roof drainage, roof penetrations, equipment curbs, and condition of other construction that will affect roofing system.
 - .8 Review temporary protection requirements for roofing system during and after installation.
 - .9 Review roof observation and repair procedures after roofing installation.
- .2 Scheduling:
- .1 Co-operate fully with other Subcontractors on the Work and promptly proceed with this work as rapidly as job conditions permit.
 - .2 Supply items to be built in, in ample time to be incorporated into work of other Sub-contractors as it is carried up.

1.4 SUBMITTALS

- .1 Product Data: Submit Product data on membrane, insulation and flashing materials
- .2 Shop drawings:
 - .1 Submit Shop Drawings in accordance with Section 01 01 50 showing method of installation and layout of each layer, over existing flashing and tie-in details with existing mechanical vents, plumbing stacks and gutters.
 - .2 Ensure Shop Drawings are approved and signed by manufacturer's representative.
- .3 Test and evaluation reports:
 - .1 Provide Product test reports based on evaluation of comprehensive test performed by manufacturer and witnessed by a qualified independent testing agency for components of roofing system.
 - .2 Indicate components of roofing system comply with requirements of these Specifications including quantity, statistical and descriptive data for each Product.

1.5 CLOSEOUT SUBMITTALS

- .1 Operation and maintenance manual:
 - .1 Supply necessary maintenance data and repair instructions for binding into maintenance manuals described in Section 01 01 50.
 - .2 Bind into each maintenance manual, Project name, location, dated and executed copy of manufacturer's guarantee, described herein and name, address and phone number of nearest manufacturer's representative. Include recommendations for periodic inspections, care and maintenance. Identify common causes of damage with instructions for temporary patching until permanent repair can be made.

1.6 QUALITY ASSURANCE

- .1 Qualifications:
 - .1 Ensure manufacturer of membrane is able to provide existing operational roof system that has been operational for a minimum of 20 years.
 - .2 Ensure roofing applicator is a member in good standing with CRCA.

- .3 Ensure applicator is trained and approved by manufacturer of system being installed.
- .2 Conform to manufacturer's "Roofing Specifications" manual as amended to date of this Specification, except where indicated or specified otherwise. More stringent requirements govern. Manufacturer's Qualifications: Manufacturer shall demonstrate qualifications to supply materials.
- .3 Roofing membrane:
 - .1 Roofing membrane is not intended to be exposed or in contact with a constant temperature below -22°F (-30°C) or in excess of 176°F (80°C). See technical data sheets for limitations, i.e., hot pipes and vents or direct steam venting.
 - .2 Specified roofing membrane is resistant to gasoline, paraffin, fuel oil, mineral spirits, and moderate solutions of acids and alkalis, acid rain and detergents. Some low molecular weight alcohols can soften. Any exposure to foreign materials or chemical discharges shall be presented to membrane manufacturer for evaluation to determine any impact on the waterproof membrane assembly performance prior to warranty issuance.
- .4 Contractor shall ensure adequate protection during installation of the roofing system.

1.7 DELIVERY, STORAGE AND HANDLING

- .1 Delivery and Acceptance Requirements: Deliver materials undamaged in original containers with manufacturer's labels and seals intact.
- .2 Storage and handling requirements:
 - .1 Store materials undamaged in original containers with manufacturer's labels and seals intact. Store membrane rolls flat and protected from moisture.
 - .2 Store solvent-based liquids, adhesives and sealants away from excessive heat and open flames, and at temperatures between 15 deg C (59 deg F) and 26 deg C (79 deg F). Contact adhesives and cleaning fluids are extremely flammable, avoid open flame and sparks. Smoking is prohibited in area of roofing application. Contact adhesives contain petroleum distillates; avoid breathing vapors and provide adequate ventilation when using same within enclosed areas.
 - .3 Store materials at site within temporary sheds or trailers; such facilities must be well sealed and kept at least 3 deg C (5 deg F) warmer than exterior ambient temperature to ensure materials remain dry in terms of roofing. Do not use wet, damp, frozen or damaged materials.
 - .4 Do not store more than 1 Day's supply of materials on the roof at any time. On roof, stack materials on pallets and completely cover with incombustible waterproof tarpaulin whenever work is interrupted, or when there is precipitation of any kind. Securely tie covering to pallets in such way as to be weathertight. Plastic covers and shrink wrap covers by manufacturers are not acceptable for site storage and be re-moved upon delivery to roof.
 - .5 Distribute materials stored on roof to stay within designated live load limits of the roof construction. Provide ample bases under equipment and materials to

distribute weight to conform to these live-load limits. Do not store materials on, or transport materials across, completed roof areas.

- .6 Provide fire extinguishers at each installation and storage location, of proper type for materials being used and stored.

1.8 SITE CONDITIONS

- .1 Ambient Conditions: Do not install materials in rain, moisture, frost, snow or other climatic conditions which could jeopardize proper application of materials. Refer to and comply with manufacturer's recommendations and limitations relative to this subject.
- .2 Proceed with roofing only when existing and forecasted weather conditions permit. Membrane application can not proceed when precipitation is imminent.

1.9 WARRENTY

- .1 Manufacturer warranty:
 - .1 Warrant work of this Section using manufacturer's standard form of warranty for a period of 10 years against defects and/or deficiencies (total membrane system warranty; labour, material and workmanship) in accordance with General Conditions of the Contract. Promptly correct any defects or deficiencies resulting in water leakage within warranty period and render roofing membrane to a watertight condition, to satisfaction of Departmental Representative and at no expense to Departmental Representative.
 - .2 In addition to above, the installer to provide to Departmental Representative a written warranty covering defects of workmanship for a period of 2 years commencing from date of Substantial Performance of the Work and agree to Make Good promptly any defects which occur or become apparent within warranty period in conjunction with membrane manufacturer's warranty. Ensure warranty is on CRCA's "Standard Form of Warranty."

PART 2 PRODUCT

2.1 MATERIALS

- .1 Liquid property requirements:
 - .1 Viscosity, ASTM D2196: 5 to 30 Pa.s (pascal.seconds).
 - .2 Volume Solids, ASTM D2697: 76% minimum.
 - .3 Weight Solids: ASTM D1644: 83% minimum.
 - .4 Sag Resistance, ASTM D4400: No sag at 700 micrometers (0.028 in. / 28 mil).
- .2 Film property requirements:

- .1 Tensile Strength (Tension): ASTM D412: Minimum 1.86 MPa (270lb/in²).
 - .2 Elongation: ASTM D412: MIN 200%.
 - .3 Accelerated Weathering FL/UV – 5000 Hours, ASTM G 154, No cracking or checking.
 - .4 Water Vapor Transmission, Permeability / Permeance: ASTM E96: Maximum 8.5 gms/m²/ day (0.033 perm-inches).
 - .5 Flexibility – Mandrel Bend, ASTM D522: Pass, no cracking or flaking.
 - .6 Tear Resistance, ASTM D625: Minimum 5.8 kN/m (33 lbf/in).
 - .7 Indentation Hardness, ASTM D2240: 82 Durometer Units (+/- 5 units).
 - .8 Dynamic Puncture Resistance, ASTM D5635: Minimum 15 joules (357 ft.pounds).
 - .9 Static Puncture Resistance, ASTM D5602: Minimum 20.7 kg. (45.5 lbs.).
- .3 Acceptable roof membrane: Sikalastic 601 / 621 Systems:
- .1 Sikalastic RoofPro 10, (10 Year Warranty), 1.3 mm (52 mil) dry membrane thickness:
 - .1 Base Layer: Sikalastic 601 or 621, application rate of 0.89 mm (35 mil) wet film thickness.
 - .2 Reinforcement: Standard Reemat.
 - .3 Top Layer: Sikalastic 621, application rate of 0.76 mm (30 mil) wet film thickness.
 - .4 Finish colour – white.
 - .5 Ensure complete roof meets ASTM E 108 requirements for Class C.
- .4 Acceptable primer:
- .1 Sikalastic EP Primer/Sealer: metal and Modified Bitumen. A two-component, cycloaliphatic, amine cured material with a high level of corrosion resistance for metal, modified bitumen surfaces, and chemically treated wood.
- .5 Additional products as required by the roof membrane supplier to meet warranty requirements.

PART 3 EXECUTION

3.1 EXAMINATION

- .1 Verification of existing conditions:
 - .1 Report any defects or irregularities in existing metal roof cladding and mechanical equipment detrimental to roof application. Do not proceed until corrected.
 - .2 Ensure openings, mechanical equipment curbs and projections through existing metal roof cladding are completed and affixed and reglets and nailing strips are in place prior to membrane installation. Replace existing flashing and counter flashing with same gauge sheet metal if existing flashing detrimental to the roof application.

- .3 Ensure existing roof substrate scheduled to receive roof system is smooth, dry, clean and free of sharp projections and of sufficient strength to withstand construction traffic and equipment.
 - .4 Departmental Representative and Applicator shall determine the condition of the existing metal roof cladding system. Areas with deteriorated decking or wet materials are to be removed and replaced. Acceptable existing roof cladding must be sound, well adhered and free of any trapped moisture.
- .2 Preparation:
- .1 Immediately before any roofing materials are applied, clean substrate (existing metal roof cladding) in accordance with roofing manufacturer's recommendations. Remove ice and snow and dry substrate. Do not use salt or calcium to remove snow or ice.
 - .2 Do no roofing work during rain, fog, sleet or snow, or upon surfaces covered with dust, water, dew, ice, frost, snow and similar detrimental conditions.
 - .3 Before commencing work, ensure environmental and site conditions are suitable for installation of material in accordance with manufacturer's recommendations.
 - .4 Prevent debris from blocking gutters and downspouts during work of this Section.
 - .5 Low-pressure power wash existing roof cladding and gutter and blow clean by using an air compressor to remove any remaining loose debris before roof application.
 - .6 All cracks and voids greater than 1 mm (0.040") shall be routed and caulked with a polyurethane sealant. Allow to cure per roofing membrane manufacturer's technical data sheets prior to over-coating with the specified roofing membrane system.
 - .7 At all inside corners, gaps or voids at the juncture of roof substrate and penetrations, apply a minimum 19 mm (3/4") fillet bead of polyurethane sealant and allow to cure per roofing membrane manufacturer's technical data sheets prior to installing the roofing membrane system.
 - .8 At all moving cracks, moving joints between dissimilar materials, and similar conditions, create a minimum 25 mm (1") wide bond break utilizing bond breaker tape, centered over the crack or joint.
 - .9 Membrane terminations shall be established prior to project start-up and documented in shop drawings. Terminations shall occur in raked-out mortar joints, saw cut terminations or under installed counter-flashing materials.
- .3 Installation:
- .1 Perform work per roof membrane manufacturer's printed installation instructions for the specified system, except where indicated or specified otherwise. More stringent requirements govern.

- .2 Immediately before any roofing materials are applied, clean deck in accordance with roofing manufacturer's recommendations. Remove ice and snow and dry decks. Do not use salt or calcium to remove snow or ice.
- .3 Apply specified primer for metal surfaces by brush or roller at the application rate shown on the technical data sheet to achieve an overall wet film thickness of 20 mm (8 mil). High porosity and roughness of the substrate will decrease coverage rates. Allow to cure and dry in accordance with manufacturer's technical data sheets.
- .4 Install roofing membrane system in accordance with current technical data sheets and in accordance with warranty guideline requirements.
- .5 Apply base embedment coat to horizontal substrate and vertical flashing surfaces by brush or with 12.7 mm (1/2") – 19 mm (3/4") nap roller to achieve a continuous and uniform minimum wet film thicknesses as specified in warranty guideline requirements.
- .6 Immediately lay specified conformable reinforcement into the wet base embedment resin coat. Reemat reinforcement is typically pre-cut before application.
- .7 Apply pressure to the membrane reinforcement with a roller as appropriate to fully embed and saturate the membrane reinforcement into liquid roofing material. Re-move air pockets from under the membrane by rolling them out.
- .8 Apply additional liquid material as required to ensure the membrane reinforcement is fully embedded and has conformed to the substrate without tenting or visible pin-holes.
- .9 Overlap sheets of Reemat membrane reinforcement a minimum of 51 mm (2") in all directions.
- .10 Extend membrane reinforcement vertically at adjacent wall, flashing surfaces in accordance with project details and specifications.
- .11 When using fiberglass mat reinforcement, allow the base embedment coat to fully cure dry prior to the placement of top coat or other applications of the specified roofing material.
- .12 Apply top coat by nap roller or brush to achieve a continuous and uniform minimum wet film thickness as specified in warranty guideline requirements.
- .13 Install all flashings in accordance with manufacturer's construction details.
- .14 Cold Liquid Applied Elastomeric Flashing Membrane Application:
 - .1 Clean, prepare and prime flashing substrate surfaces ready to receive membrane flashing applications.
 - .2 All parapet, wall, and curb flashings shall be provided with a sealant cant with Flexi-tape reinforcement prior to flashing application.
 - .3 Terminate roofing membrane system at raked-out mortar joints, termination saw cut joint, or under installed counter-flashing materials. Seal all mortar joints and saw cut joints with Sikaflex polyurethane sealant.

- .4 Metal flanges are typically encapsulated between two membrane layers, usually by providing membrane flashing as a stripping ply over the metal flange, with the field or flashing membrane extending beneath the metal flange. It is also acceptable to install the stripping ply under the metal flange and extend the field or flashing membrane over the metal flange.
- .15 Protect completed portions of roof from damage:
 - .1 Provide adequate protection of materials and work of this Section from damage by weather, traffic and other causes. At the end of each Day's work provide temporary water cutoff between finished roofing membrane and roof deck substrate to prevent weather damage and water from entering finished roof assembly. Remove such temporary cutoff strip completely prior to commencing with work.
 - .2 Provide protection covering out of 13 mm (1/2") [19 mm (3/4")] thick plywood under laid with 25 mm (1") thick polystyrene insulation board adhered to it, over roofed areas when working from, or over, such roof surfaces. Ensure to place a separator sheet between temporary protection covering and roof membrane. Provide such protection below hoist rigs, ladders, pallets of material, and in other circumstances where the roofing membrane is exposed to potential damage. Secure protection boards mechanically against wind storm loss.
 - .3 At conclusion of each Day's work, seal exposed edges of roof insulation. Remove when resuming work.
 - .4 Protect work of other trades from damage resulting from work of this Section. Make good such damage at no cost to Departmental Representative.
- .16 Inspections:
 - .1 Contractor shall call for Departmental Representative inspection after power wash and before roof membrane installation.
 - .2 Contractor shall call for Departmental Representative inspection every 3000 ft² roof installation.
 - .3 Contractor shall call for Departmental Representative inspection before Substantial Completion Request.

END OF SECTION