GENERAL NOTES

1. DUCT SHOWN CROSS HATCHED TO BE OF 3 MM WALL THICKNESS.
ALL TERMINAL ENDS TO BE NON-COMBUSTIBLE.

2. MAIN INLETS & OUTLETS OF ALL VENTILATION SYSTEMS TO BE CAPABLE OF BEING CLOSED FROM OUTSIDE THE SPACE BEING VENTILATED.

HEATING, VENTILATION & AIR COND P.O. 107-33-00-H1-70

ALL DIFFUSERS, ATTENUATOR BOXES, CONVECTOR HEATERS & ALL CIRCULAR DUCTWORK, INSULATED & UNINSULATED INCL. FITTINGS HANGERS & SLEEVES, FLEXIBLE DUCTWORK & TAPE & SEALER ARE SUPPLIED BY NORRIS WARMING LTD.

ALL SUPPLY DUCTING IS INSULATED SANDWICH TYPE. DIMENSIONS SHOWN ON DRAWING ARE INSIDE DIAM. WALL THICKNESS OF DUCTING 5/8"

RECTANGULAR DUCTING TO BE 20 GA. GALV. S.M.
FOR DUCTING OVER 16" IN WIDTH, 18 GA.
ALL RECT. DUCTING BY B.Y.C.

REFERENCES

REF. No.	DRAWING TITLE	DWG. No.

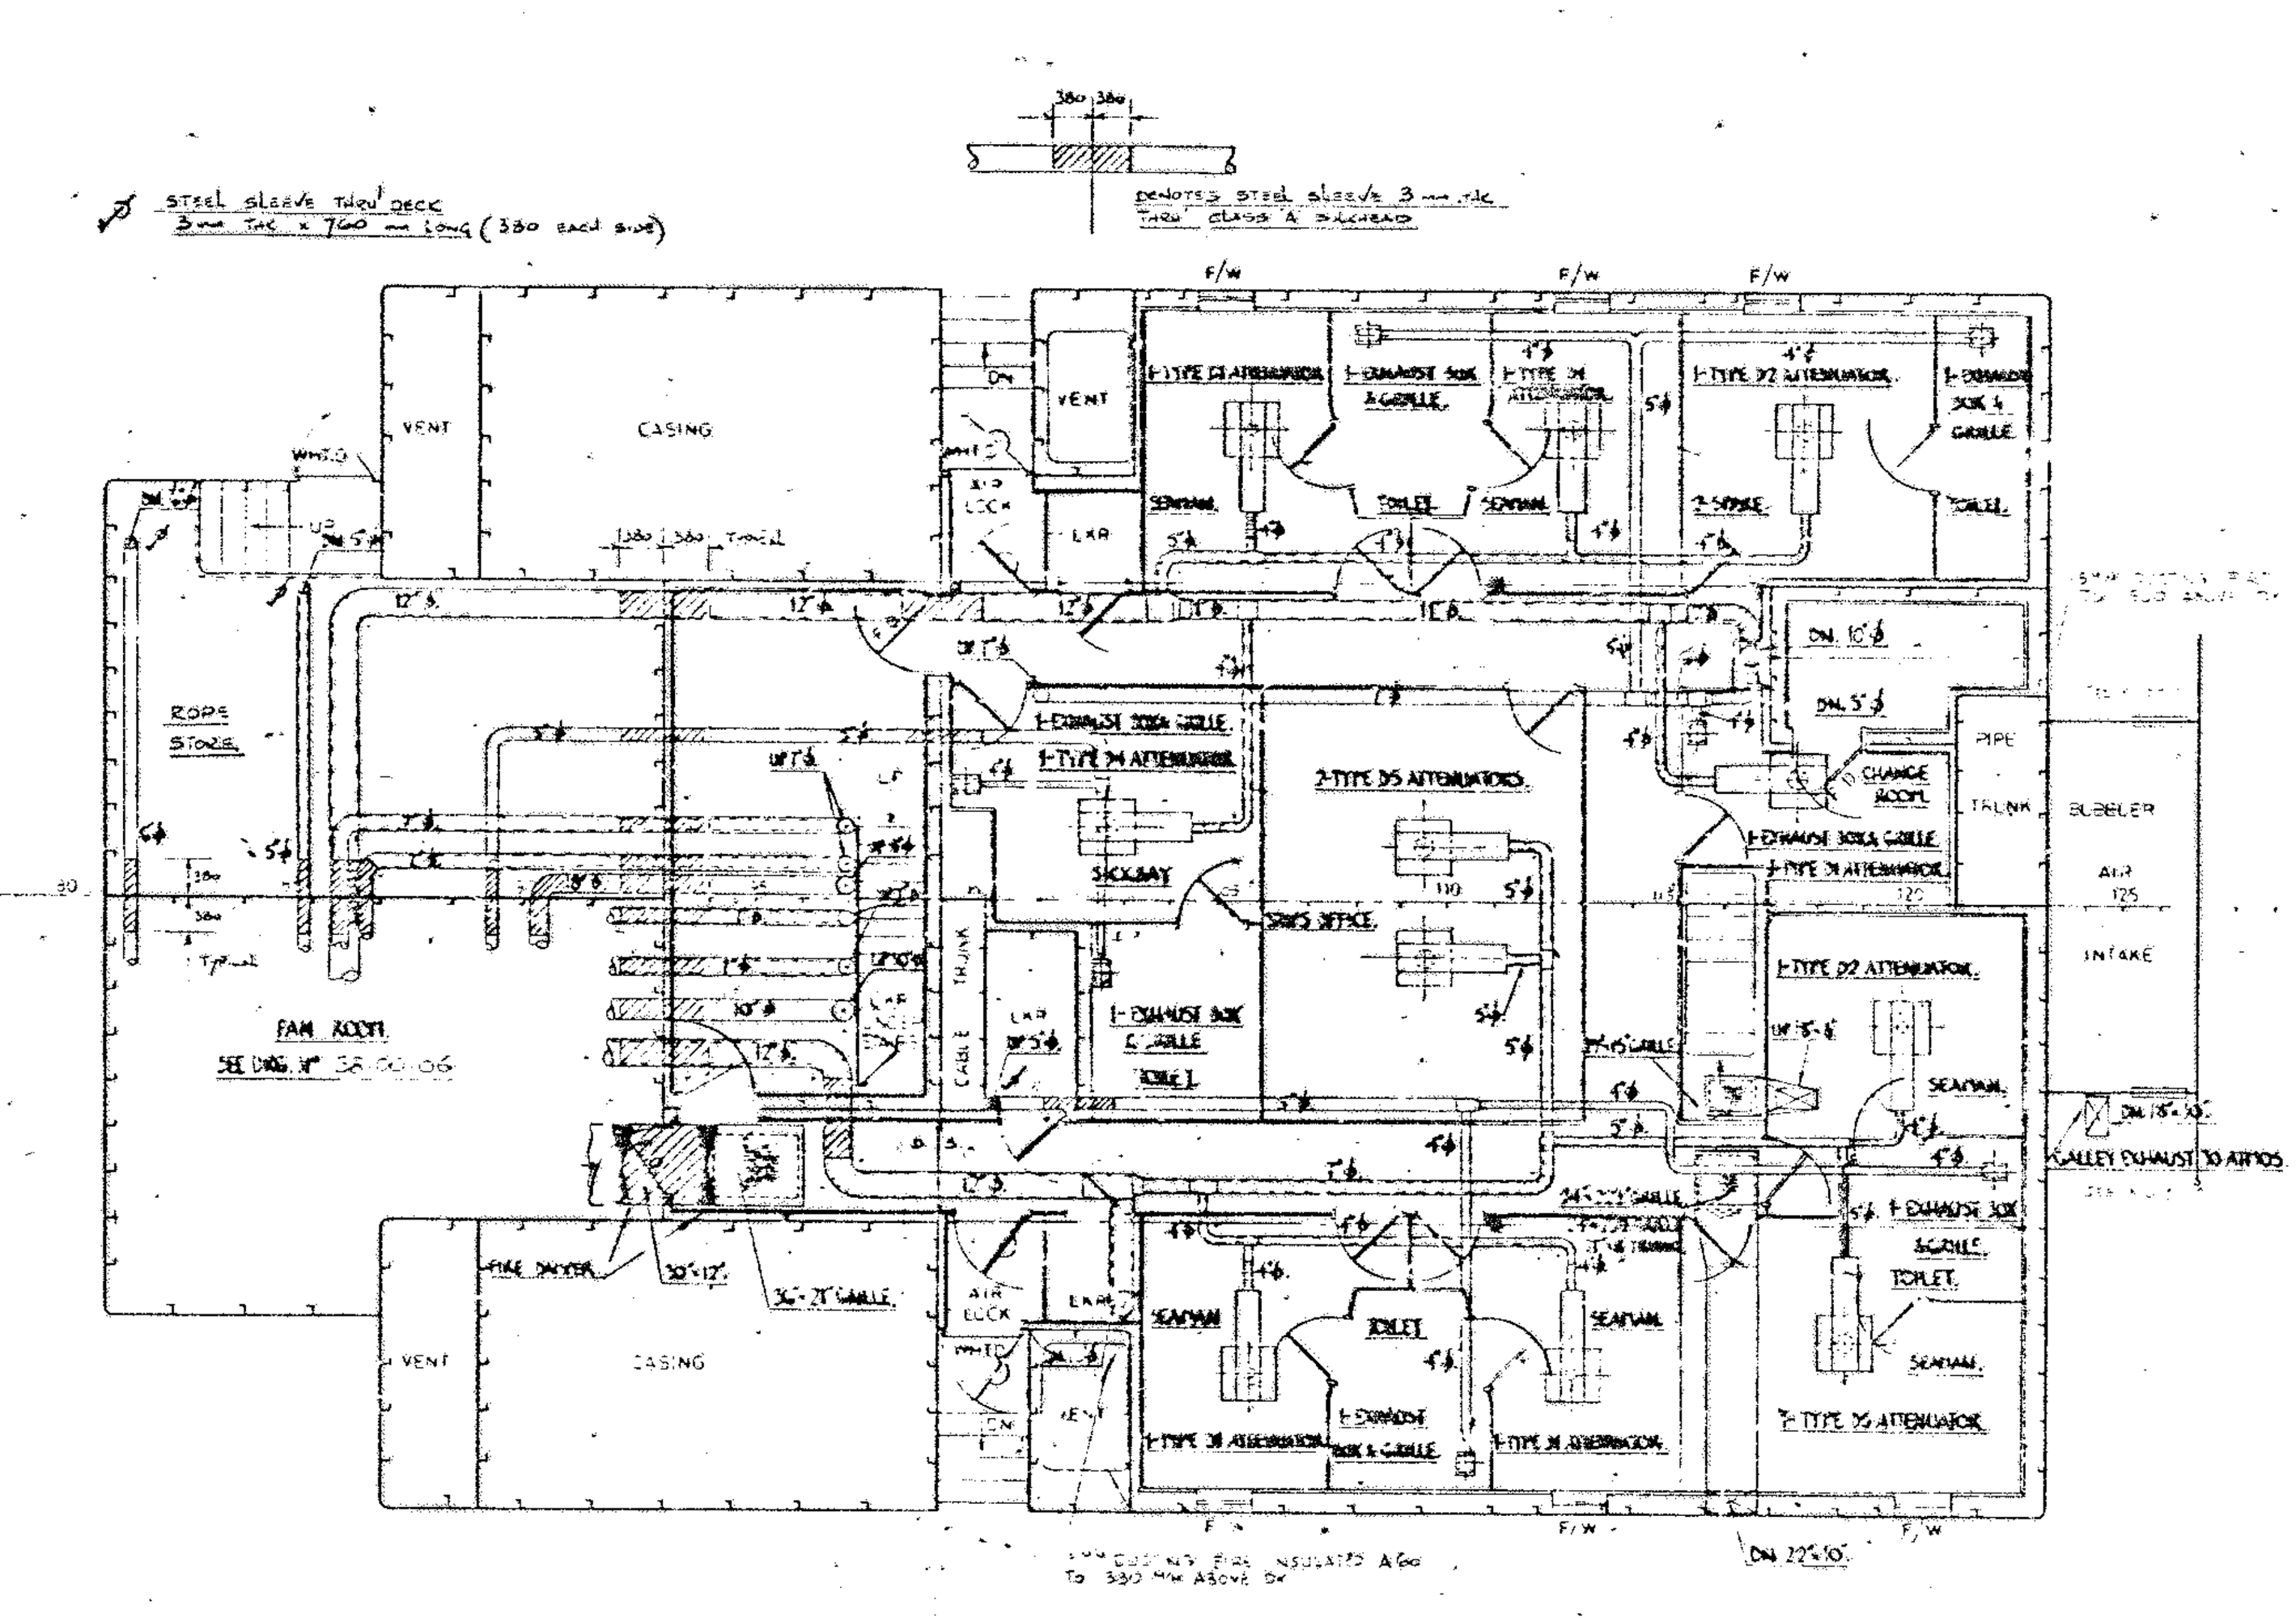

RAISED FOCSLE DECK
SCALE 1:50

5-TYPE D4 ATTENUATOR BOXES
2 - " D7 " "
1 - " D4 " "
3 - " D5 " "
7-EXHAUST BOXES 5/4 5"-6" GRILLES, 5" Ø CONN.

No.	REVISION	BY	DATE
B	REVISED TO COMPLY W/ H & C.G. TELEX NOV 24/82	H.D.S.	NOV 24/82
A	GENERALLY UPDATED	N.W.	OCT [illegible]

DISTRIBUTION

DEPARTMENT	QTY	DEPARTMENT	QTY	DEPARTMENT	QTY	DEPARTMENT	QTY
OWNERS		OPERATIONS MANAGER		LOFT		PIPE FITTER	
CLASSIFICATION		NEW CONST. SUPT.		PLATER		MACHINE SHOP	
C.C.&S.S.B.		REPAIR SUPT.		WELDER		ENGINE FITTER	
VICTORIA	[illegible]	STEEL SUPT.		SHIPWRIGHT		SHEET METAL	[illegible]
NORRIS WARMING	N	WELDING ENGINEER		RIGGER		ELECTRIC SHOP	
HULL D.O.	1			JOINER			
MACHINERY D.O.	1						
ELECTRICAL D.O.	1						

NORRIS WARMING C1255/52972

Burrard Yarrows Corporation
SHIPBUILDERS, SHIP REPAIRERS, GENERAL ENGINEERS
Vancouver Division, P.O. Box 86099 North Vancouver, British Columbia, Canada V7L 4J6
Victoria Division, P.O. Box 1030 Victoria, British Columbia V8W 2S9

DIVISION: VANCOUVER
HULL 107 554 JOB No. 33.0
OWNERS: GULF CANADA

TITLE: VENTILATION & AIR COND. RAISED FO'C'SLE DECK

APPROVALS	REPRESENTS	DATE
[illegible]		[illegible]
[illegible]		[illegible]

DRAWN: NORRIS WARMING
CHECKED
APPROVED
SCALE 1:50 DATE OCT/82
DWG. No. 33-0̸1 C2 REV. B