




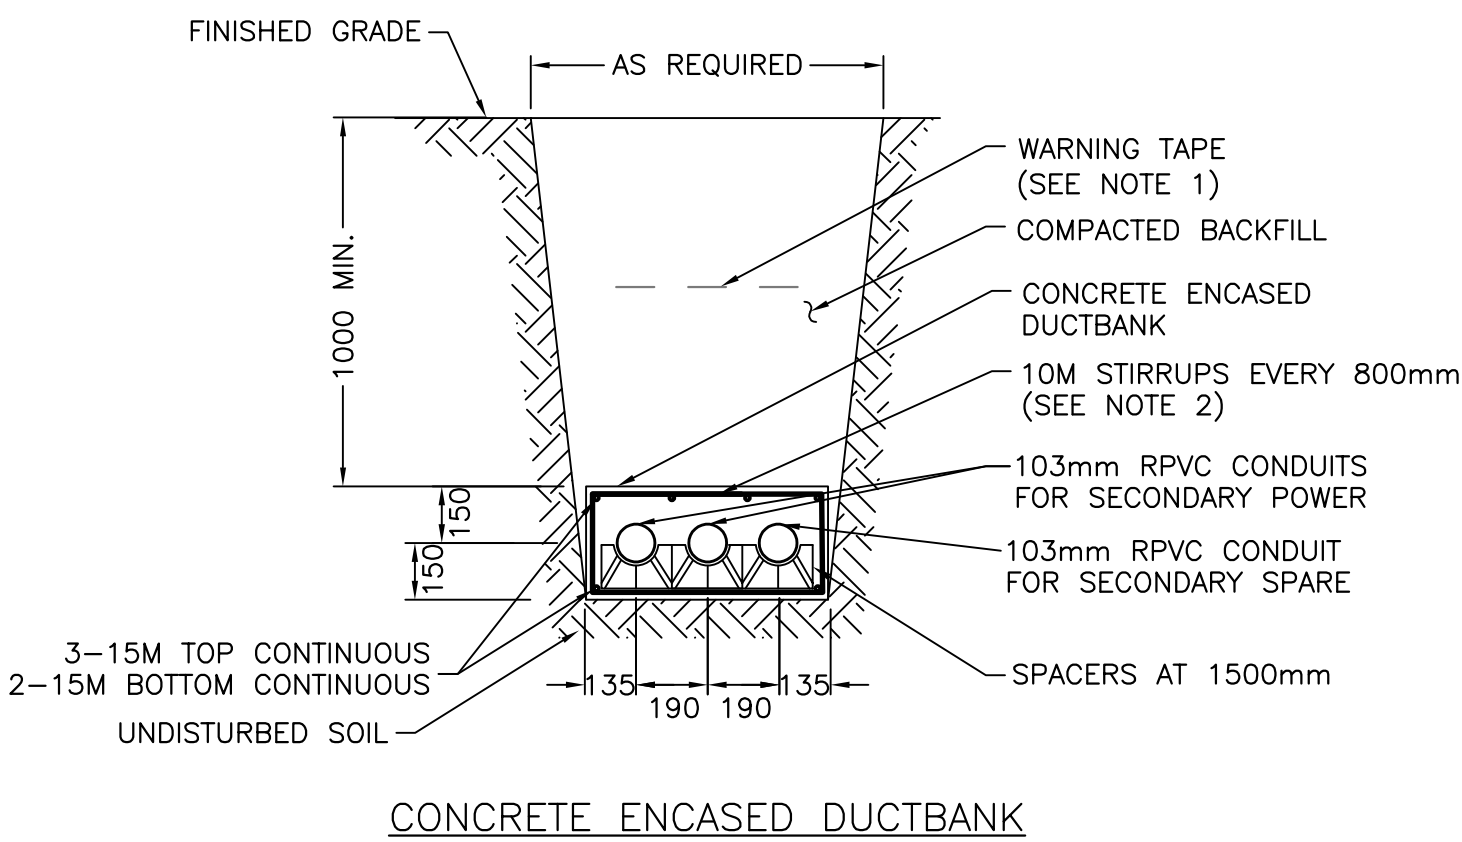
C01	18/10/18	ISSUED FOR TENDER	L.M.	NS
No.	Date	Description	Drawn by Dessiné par	Approved Approuvé

<div><div>A</div><div>B</div></div>	Detail number Sheet number	A Numéro de détail B Numéro de la feuille
Linear dimensions in millimètres		Dimensions linéaires en millimètres
Consultant's Name Nom de l'expert-conseil		Eng. Stamp Sceau de l'ingénieur
 SNC • LAVALIN SNC • LAVALIN Inc. Halifax, Nova Scotia, Canada Member of the SNC • LAVALIN Group		

Project title/Titre du projet
TERRA NOVA VISITOR CENTRE REHABILITATION UPGRADES
GLOVERTOWN, NL


Drawing title/Titre du dessin
ELECTRICAL SITE DETAILS

Designed by/Concept par S.M.	Date 2018/03/28
Drawn by/Dessiné par S.M.	Date 2018/03/28
Checked by/Vérifié par D.C. / J.L.	Date —
Project No./No. du projet 1326	Scale/Echelle N.T.S.
Drawing Set No./No. de série du dessin E-09	Sheet No./ N° de la feuille




- NOTES:
- RED WARNING TAPE WITH WARNING "CAUTION ELECTRICAL BURIED BELOW". WARNING TAPE SHALL BE BURIED APPROXIMATELY HALFWAY BETWEEN TOP OF DUCTBANK AND FINISHED GRADE LEVEL.
 - INSTALL STIRRUPS ONLY AT THE TOP AND SIDES (NO STIRRUP AT THE BOTTOM).

A
E-02 SECTION – CONCRETE ENCASED DUCTBANK

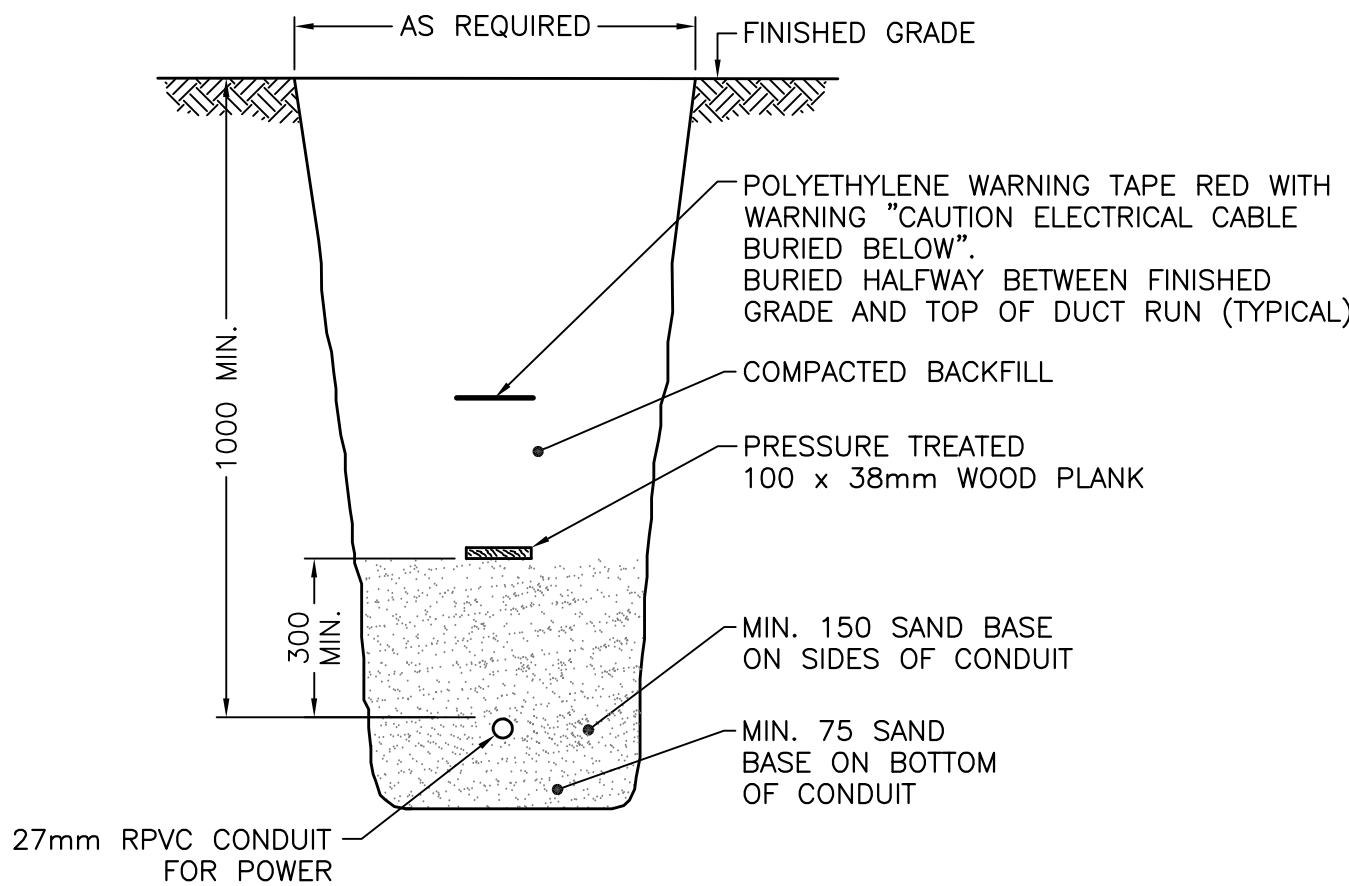

B
E-02 SECTION – DIRECT BURIED CONDUIT

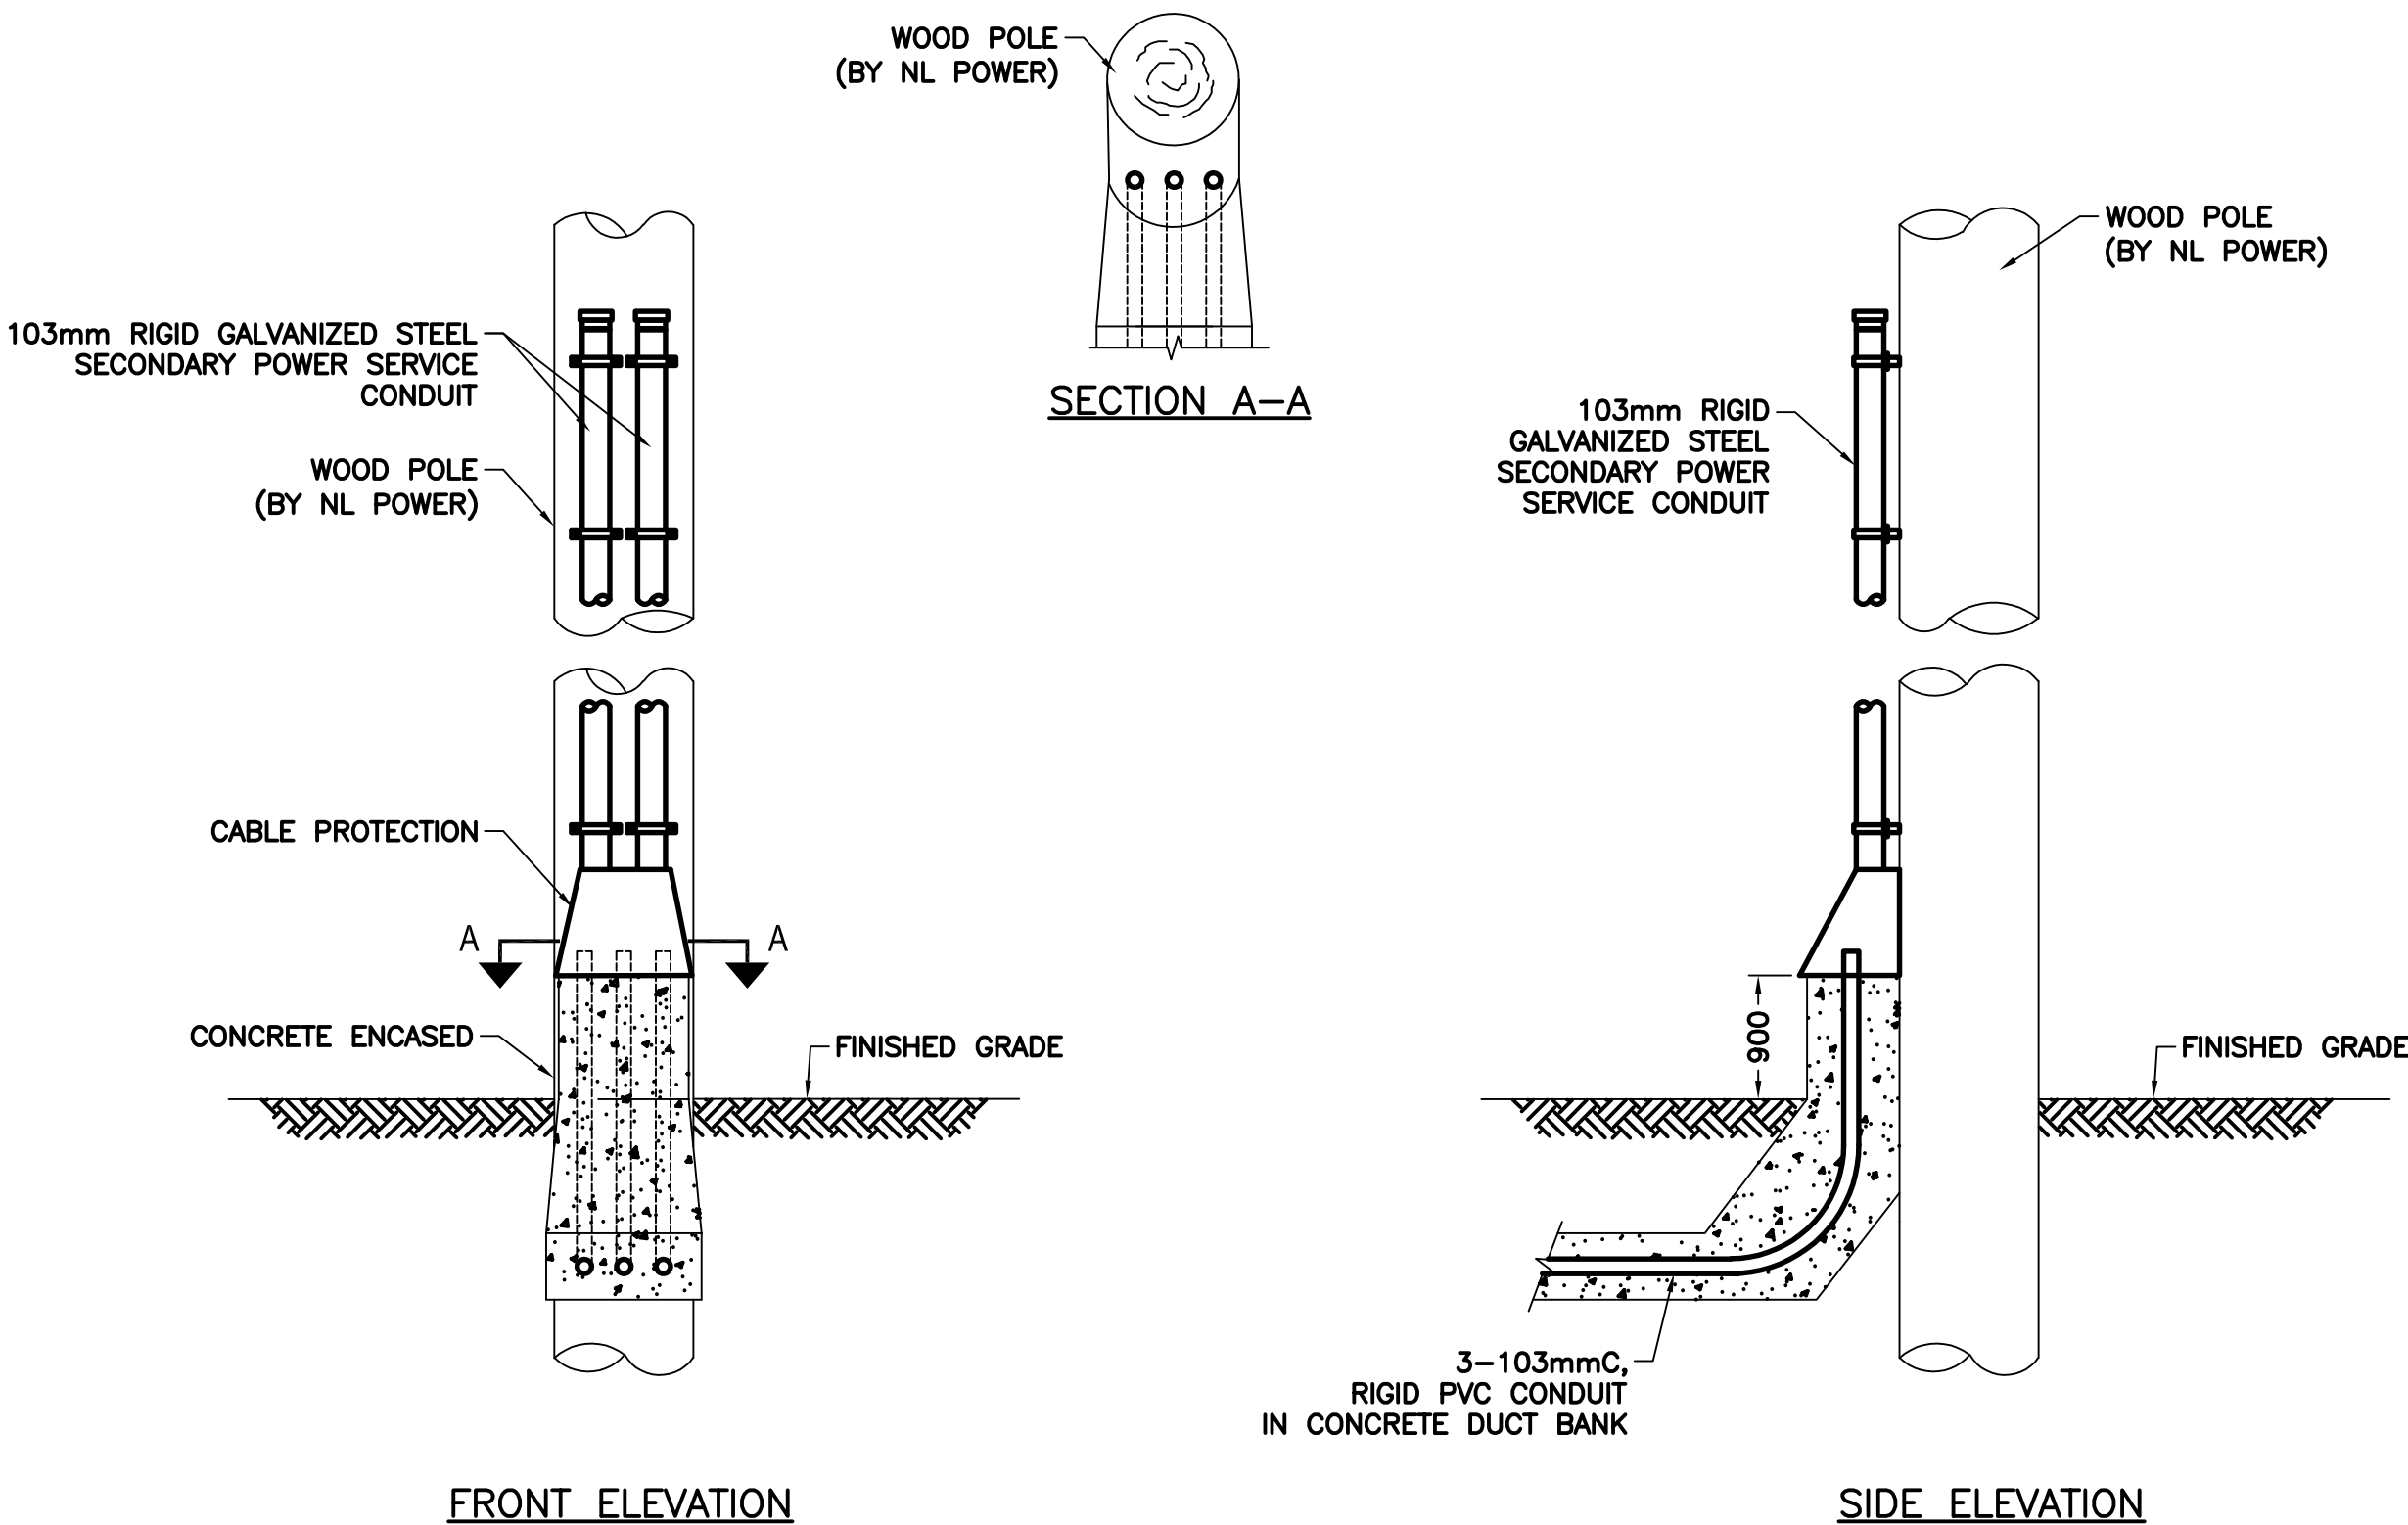

- NOTES:
- INSTALLATION SHALL COMPLY WITH NL POWER STANDARD CONSTRUCTION PRACTICES.
 - APPLICABLE FOR POWER SERVICES.

1
- DETAIL – U/G TO POLE TRANSITION & CABLE PROTECTION (TYP.)