


PRELIMINARY  
NOT FOR CONSTRUCTION


ADDENDUM TO FOLLOW

C01	2018/10/15	ISSUED FOR TENDER	D.B.	
No.	Date	Description	Drawn by Dessiné par	Approved Approuvé

<div><div>A</div><div>B</div></div>	<div>Detail number</div> <div>Sheet number</div>	<div>A Numéro de détail</div> <div>B Numéro de la feuille</div>
	<div>Linear dimensions in millimetres</div>	<div>Dimensions linéaires en millimètres</div>
<div>Consultant's Name</div> <div>Nom de l'expert-conseil</div> <div> <b>SNC • LAVALIN</b></div> <div>SNC • LAVALIN Inc.</div> <div>Halifax, Nova Scotia, Canada</div> <div>Member of the SNC • LAVALIN Group</div>		<div>Eng. Stamp</div> <div>Sceau de l'ingénieur</div>

<div>Project title/Titre du projet</div> <div>TERRA NOVA VISITOR CENTRE REHABILITATION UPGRADES</div> <div>GLOVERTOWN, NL</div>	
---	--

<div>Drawing title/Titre du dessin</div> <div>NEW CONTROLS PLAN</div>	
<div>Designed by/Concept par</div> <div>D.M.</div>	<div>Date</div> <div>2018/03/28</div>
<div>Drawn by/Dessiné par</div> <div>D.B.</div>	<div>Date</div> <div>2018/03/28</div>
<div>Checked by/Vérifié par</div>	<div>Date</div>
<div>Project No./No. du projet</div> <div>1326</div>	<div>Scale/Echelle</div> <div>AS SHOWN</div>
<div>Drawing Set No./No. de série du dessin</div> <div>H-12</div>	<div>Sheet No./ N° de la feuille</div>

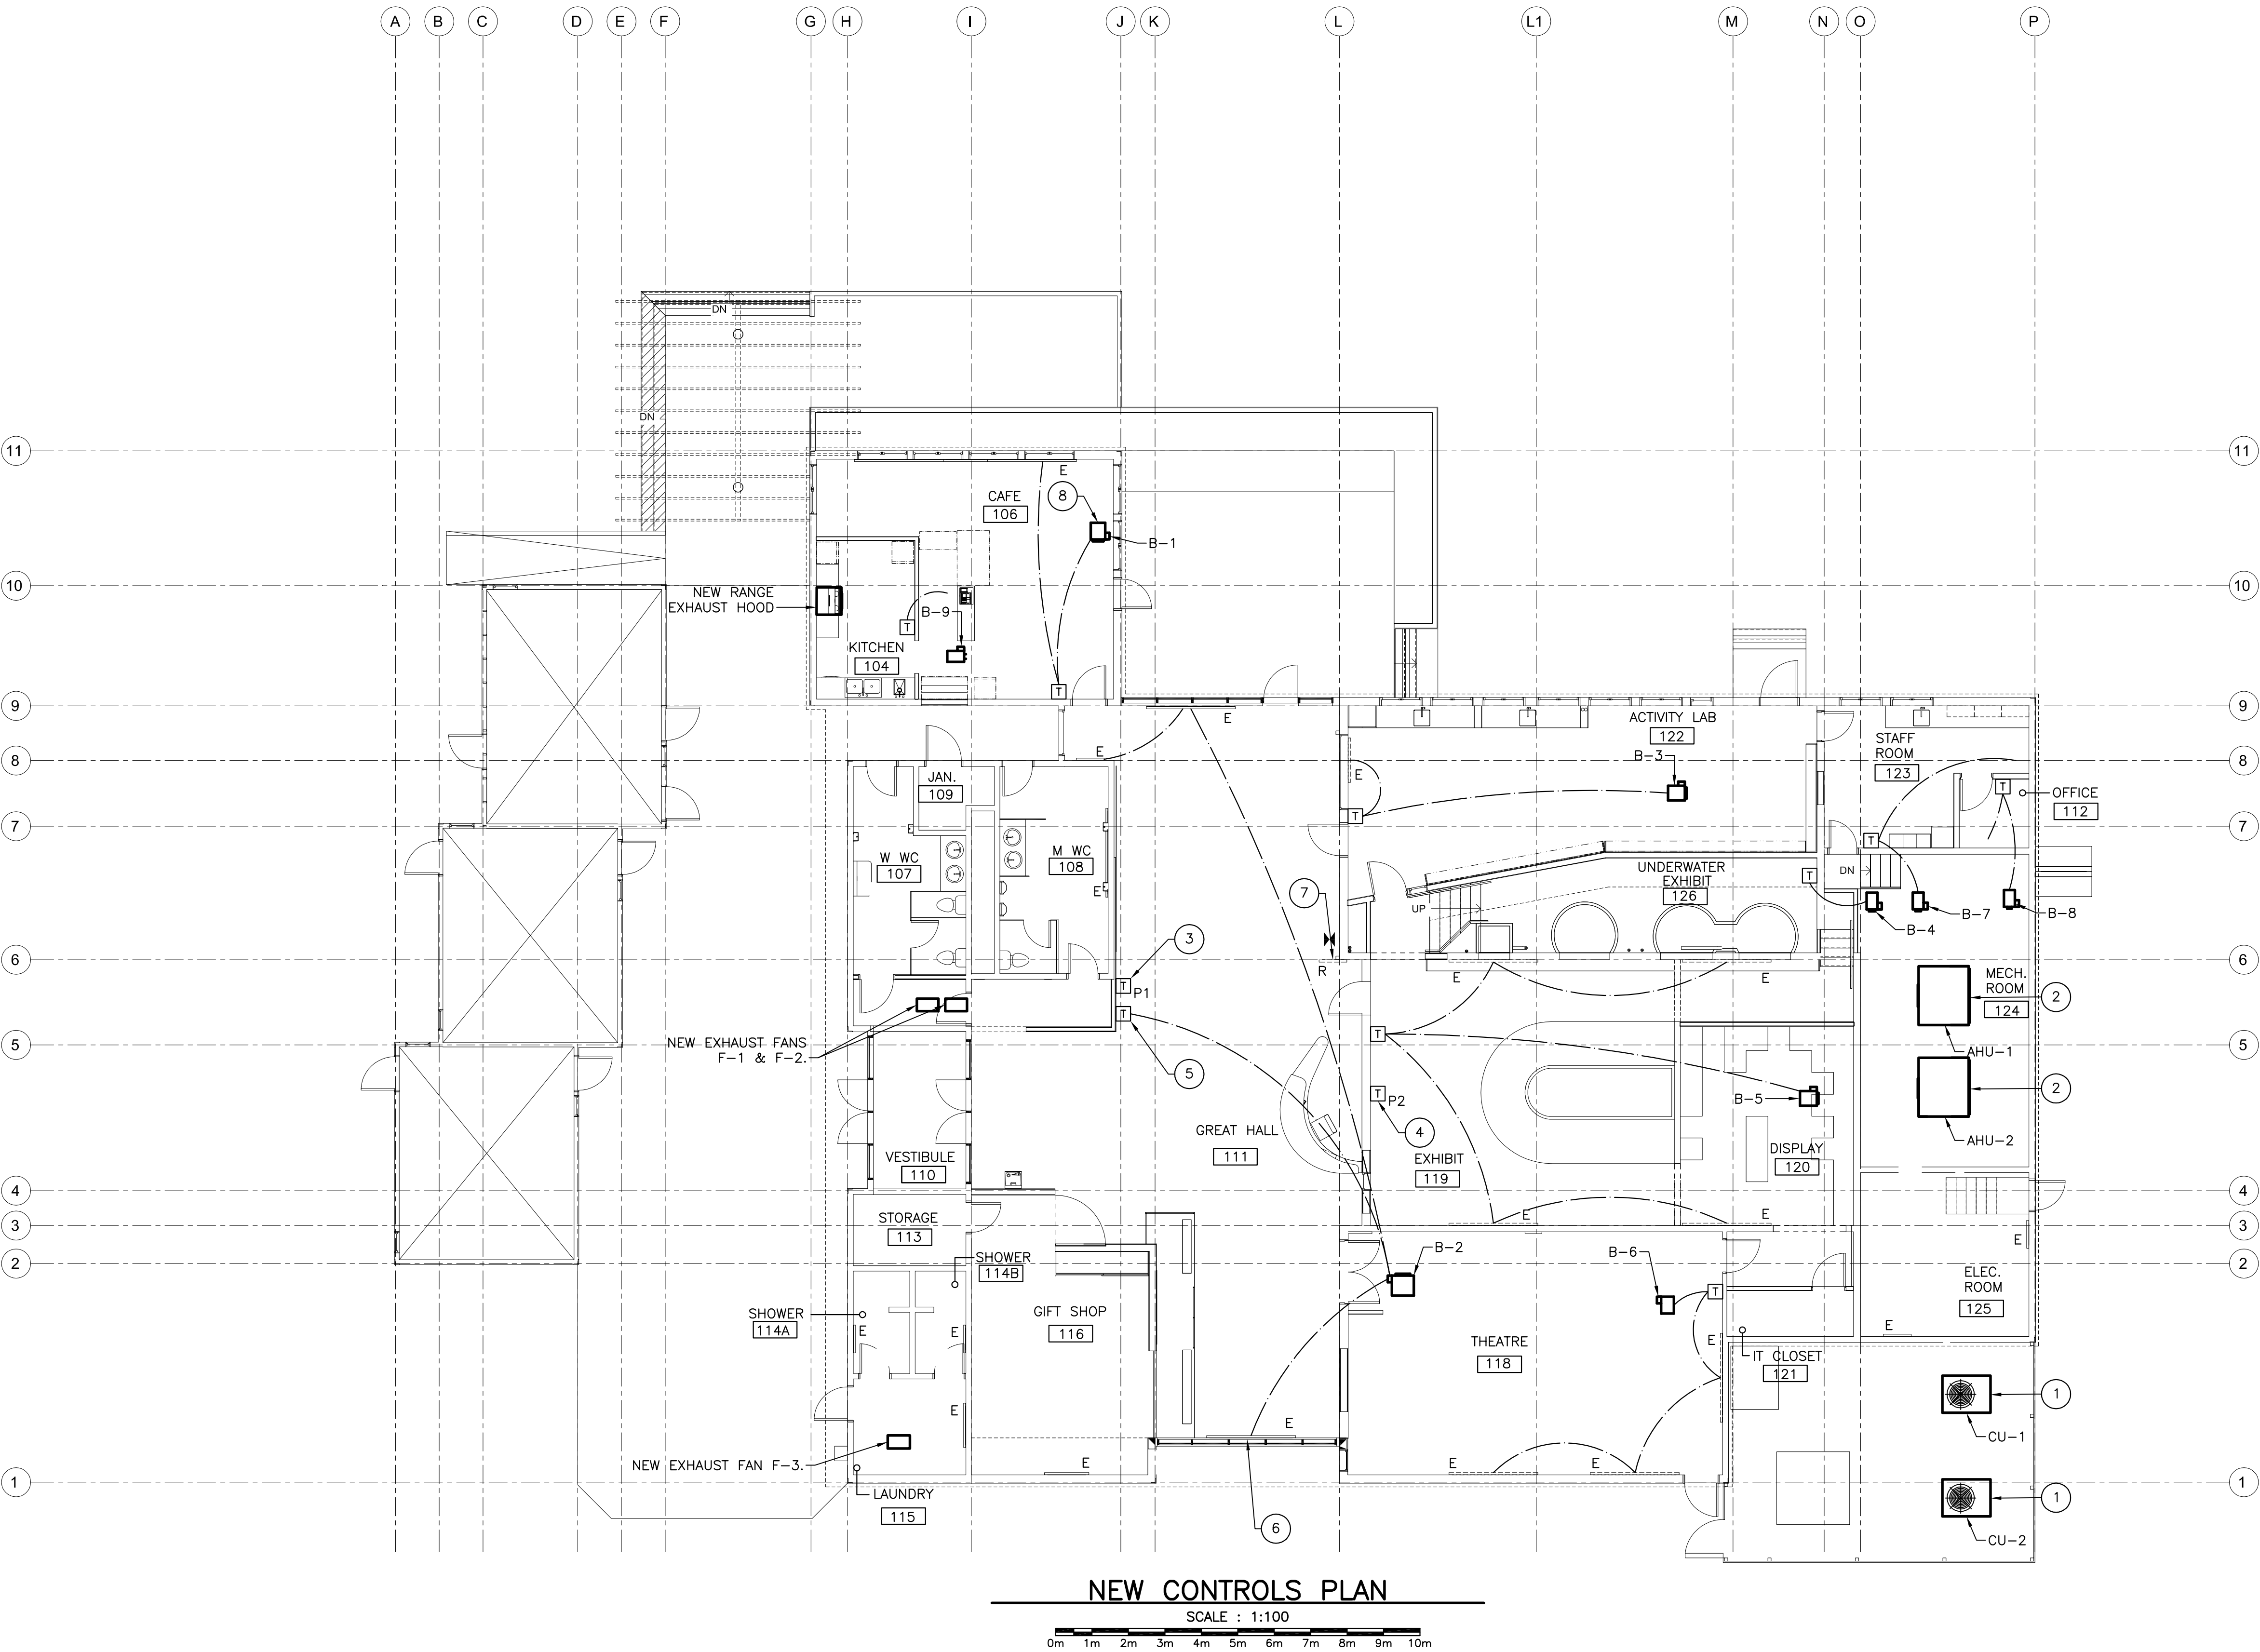

DRAWING NOTES:

- OUTSIDE CONDENSING UNIT.
- INDOOR AIR HANDLING UNIT.
- PROGRAMMABLE THERMOSTAT SERVING AHU-1.
- PROGRAMMABLE THERMOSTAT SERVING AHU-2.
- LOW VOLTAGE THERMOSTAT SUPPLIED AND INSTALLED BY MECHANICAL CONTRACTOR.
- EXISTING HEATER TO REMAIN. SEE ELECTRICAL DRAWINGS. (TYPICAL).
- EXISTING HEATER REMOVED. SEE ELECTRICAL DRAWINGS. (TYPICAL).
- VAV BOX (TYPICAL).