


EQUIPMENT/MATERIALS LIST - ELECTRICAL SHROUD:

- 30 AMP, 125 VOLT, SINGLE, LOCKING RECEPTACLE. CSA CONFIGURATION L5-30R. CORROSION RESISTANT, YELLOW NYLON FACE c/w HINGED AND GASKETTED WEATHERPROOF COVERPLATE, YELLOW IN COLOR. MOUNTED IN STANDARD NON-METALLIC FD DEVICE BOX
- 20 AMP, 125 VOLT, T-SLOT GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLE, CSA CONFIGURATION 5-20R, CORROSION RESISTANT, c/w HINGED & GASKETTED 'IN-USE' COVER. MOUNTED IN STANDARD TYPE FD NON-METALLIC DEVICE BOX.
- MOLDED PVC JUNCTION BOX, EEMAC 4X RATED, c/w MOUNTING FEET, GASKETTED SCREW DOWN COVER WITH STAINLESS STEEL SCREWS. 305mm x 305mm x 150mm Dp.


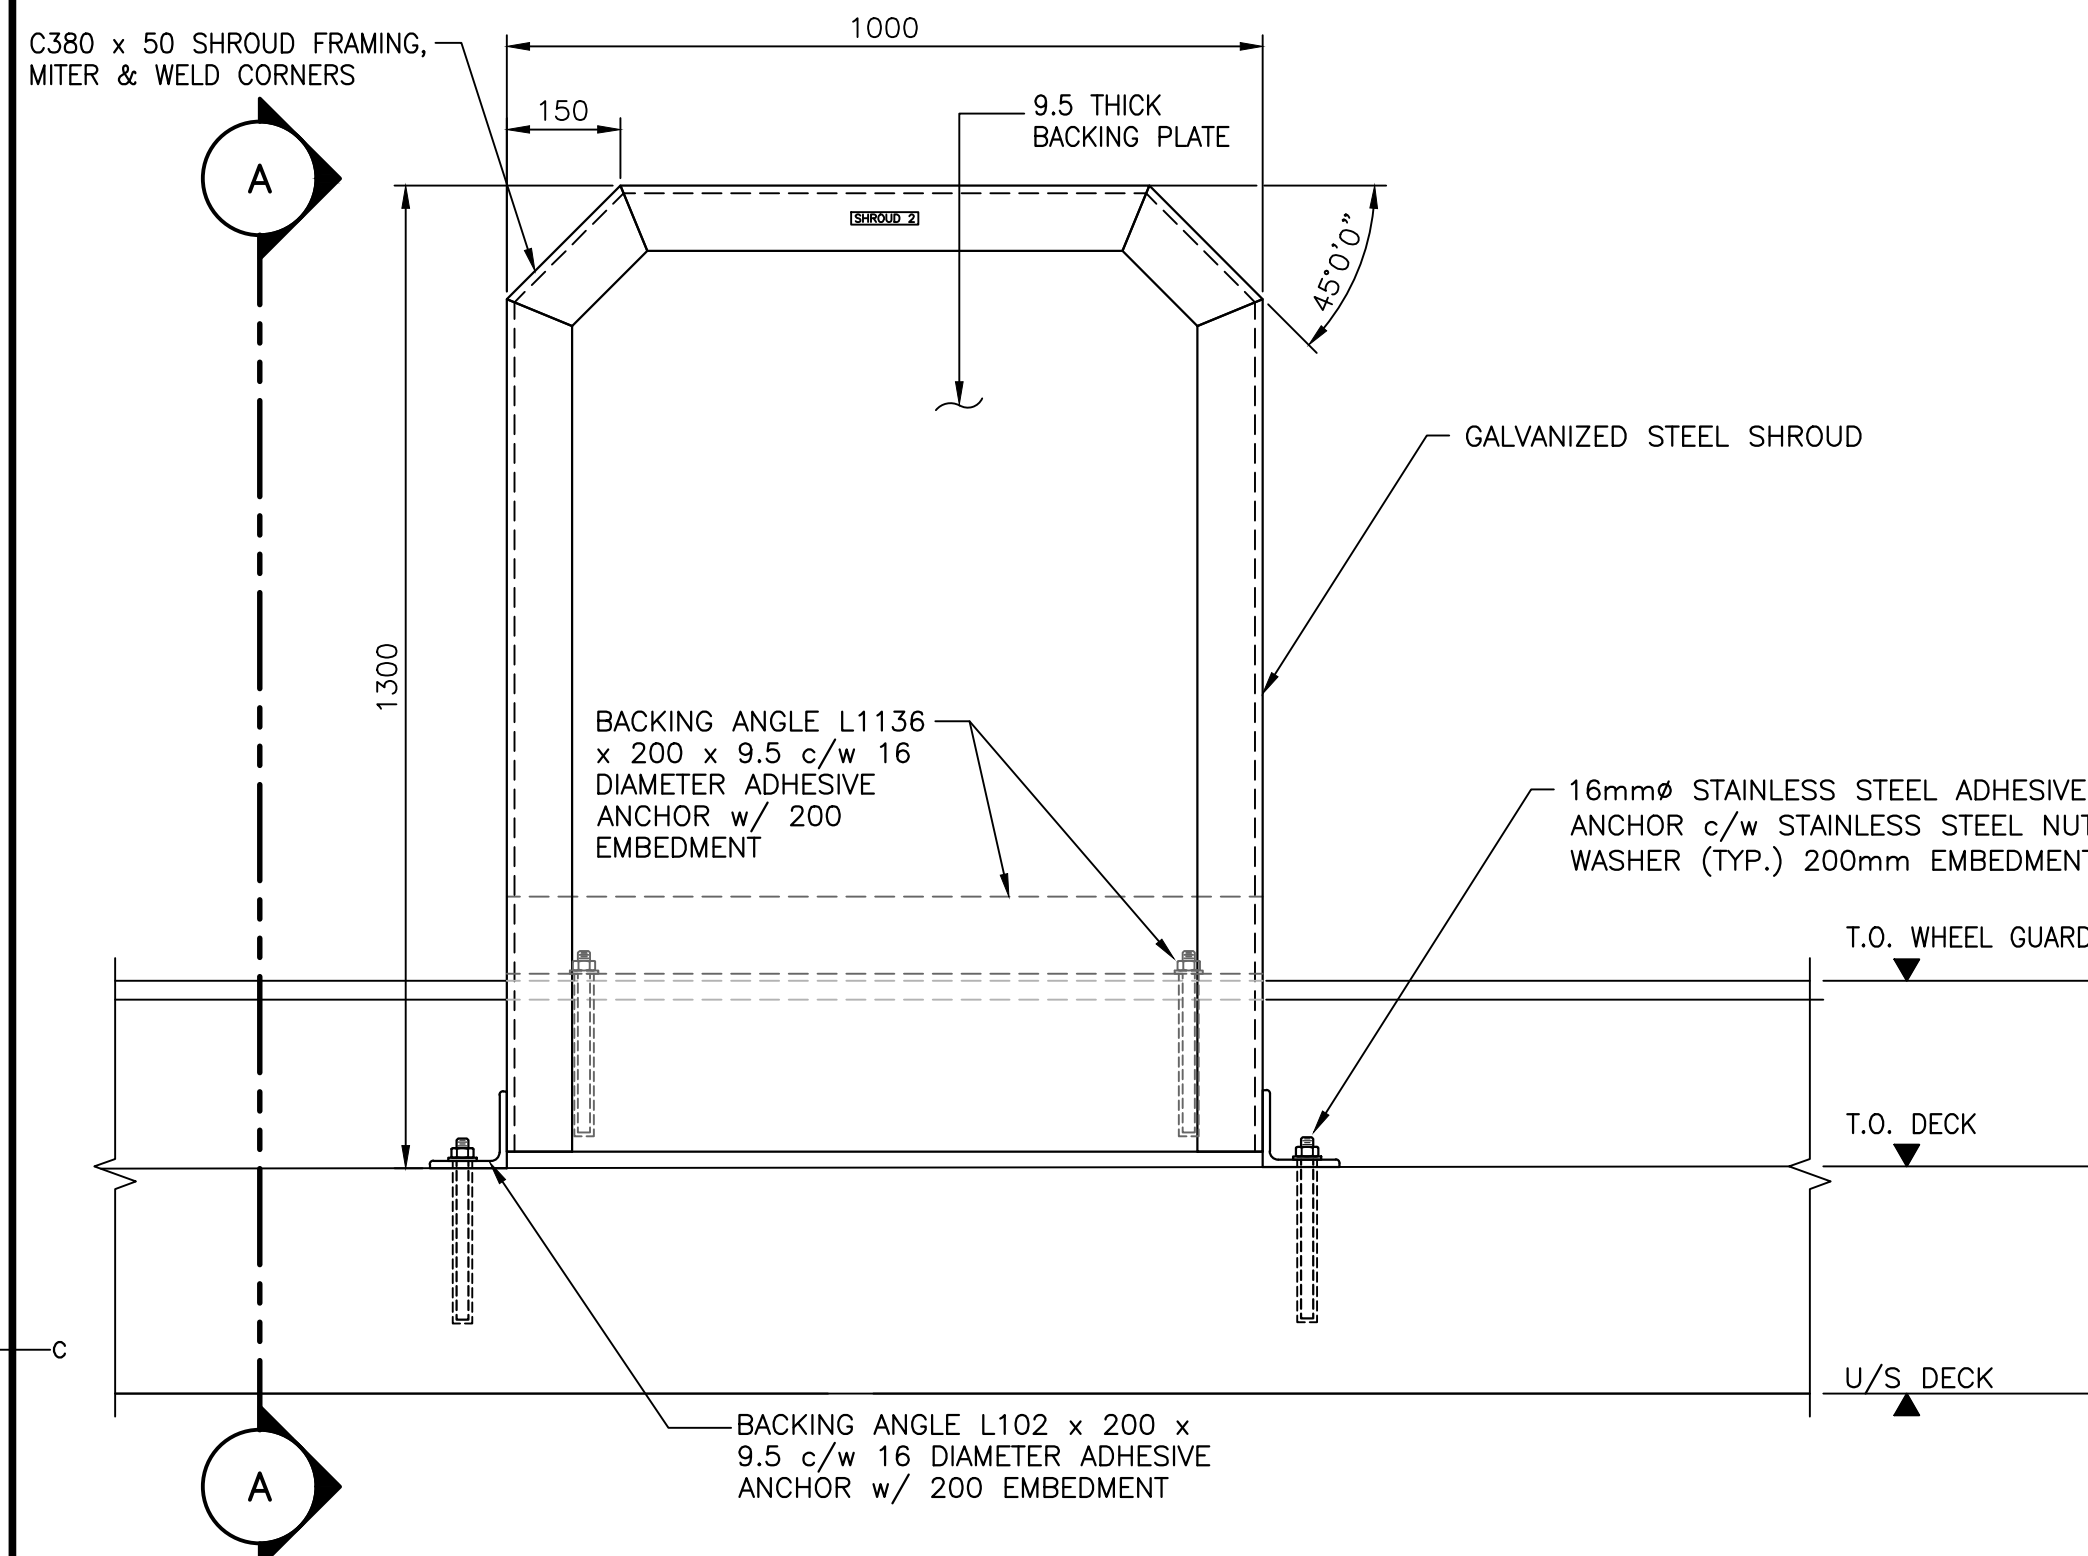


NOTES:


- ALL DIMENSIONS ARE IN MILLIMETERS.
- CONTRACTOR TO CONSTRUCT A PLYWOOD MOCK UP OF EACH SHROUD TYPE TO ENSURE EQUIPMENT FITS PROPERLY.
- ALL METAL TO BE GALVANIZED.

NOTES:


- SPLICES IN ALL ELECTRICAL SHROUD JUNCTION BOXES ARE TO BE MADE USING MECHANICAL BOLTED CONNECTORS AND HEAT SHRINK BOOTS.
- EACH SHROUD TO BE BONDED.

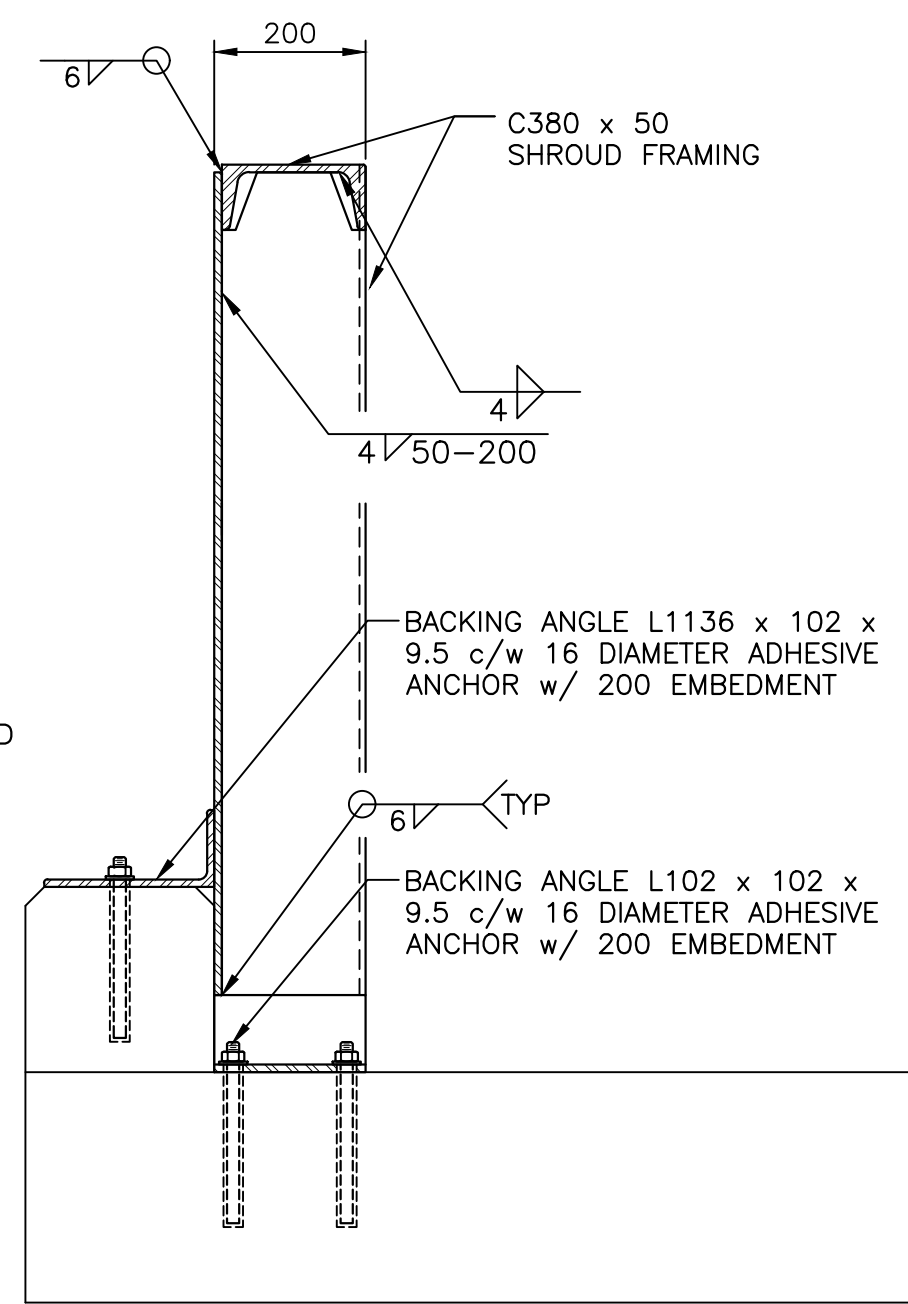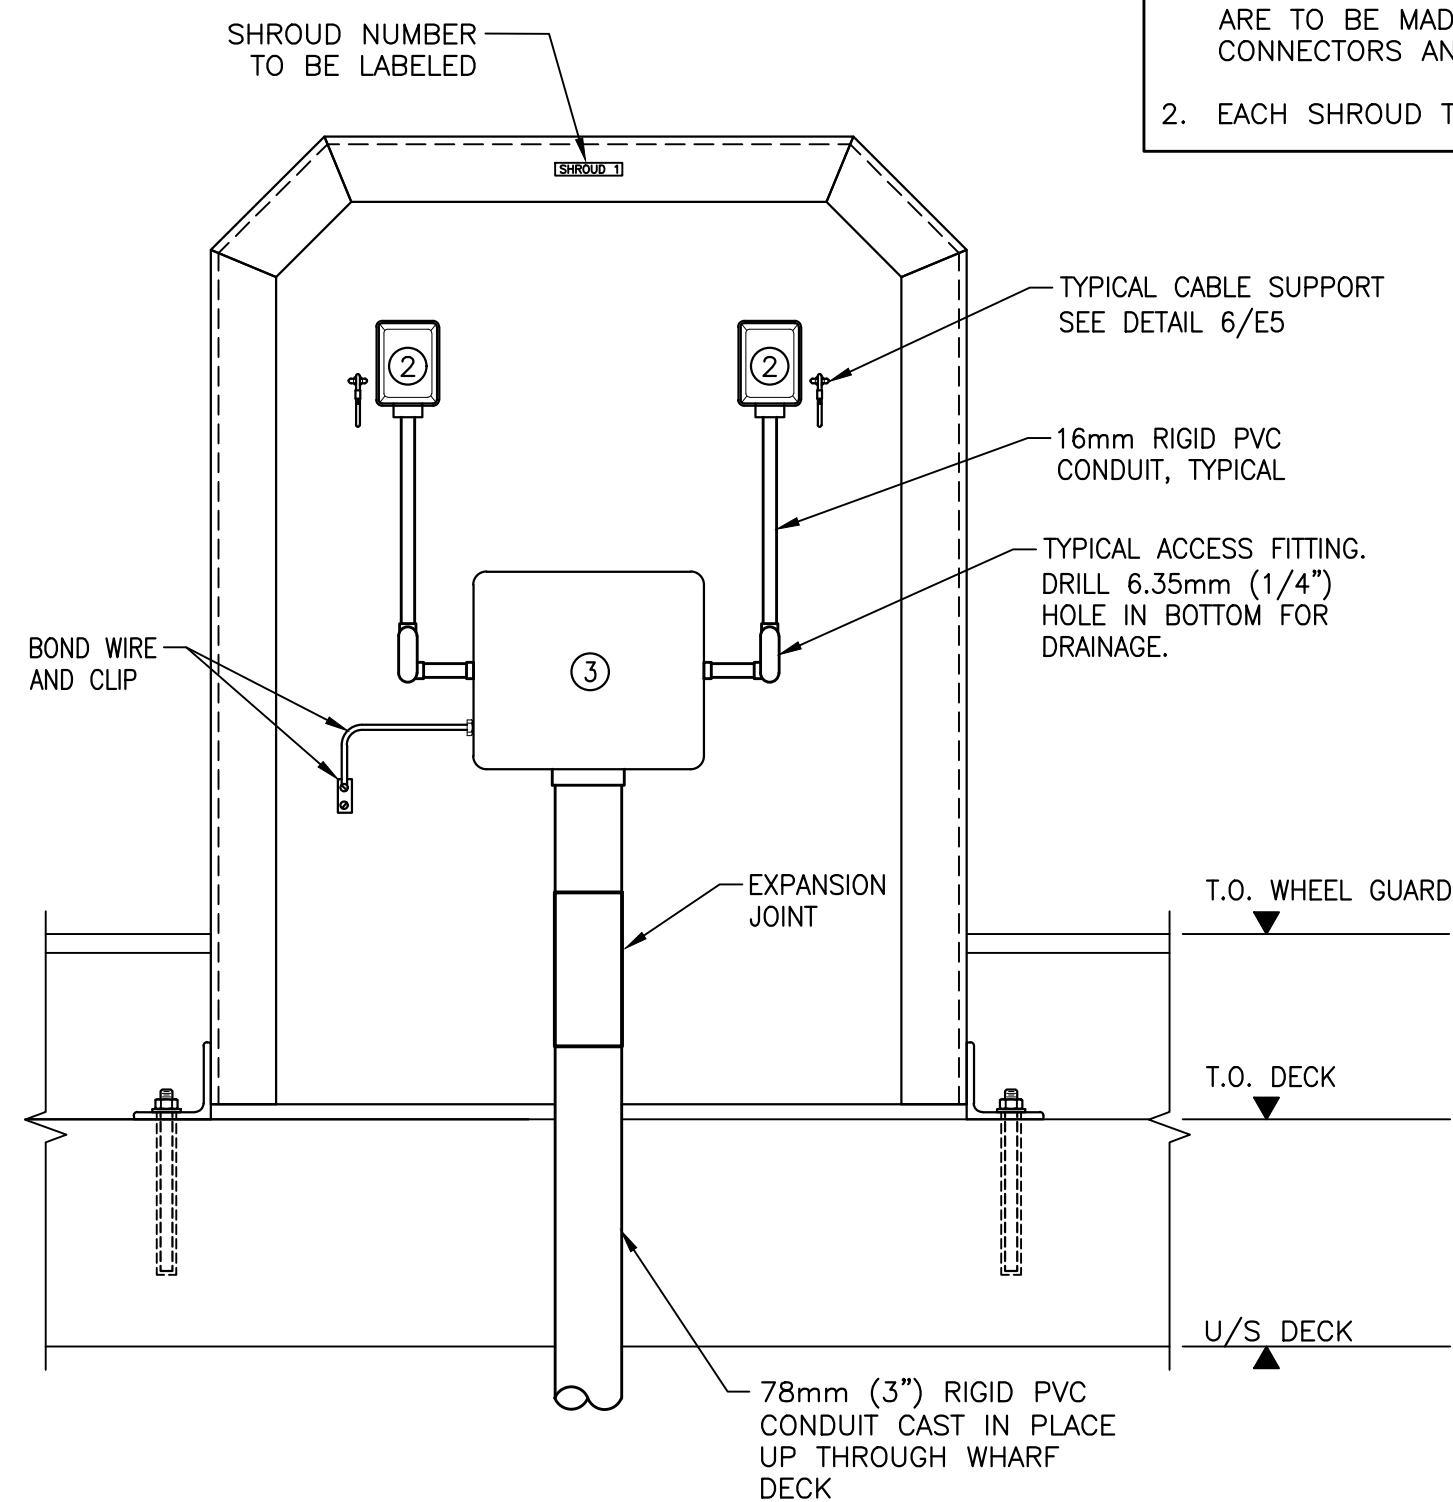



NOTE: ALL DIMENSIONS ARE IN MILLIMETERS.

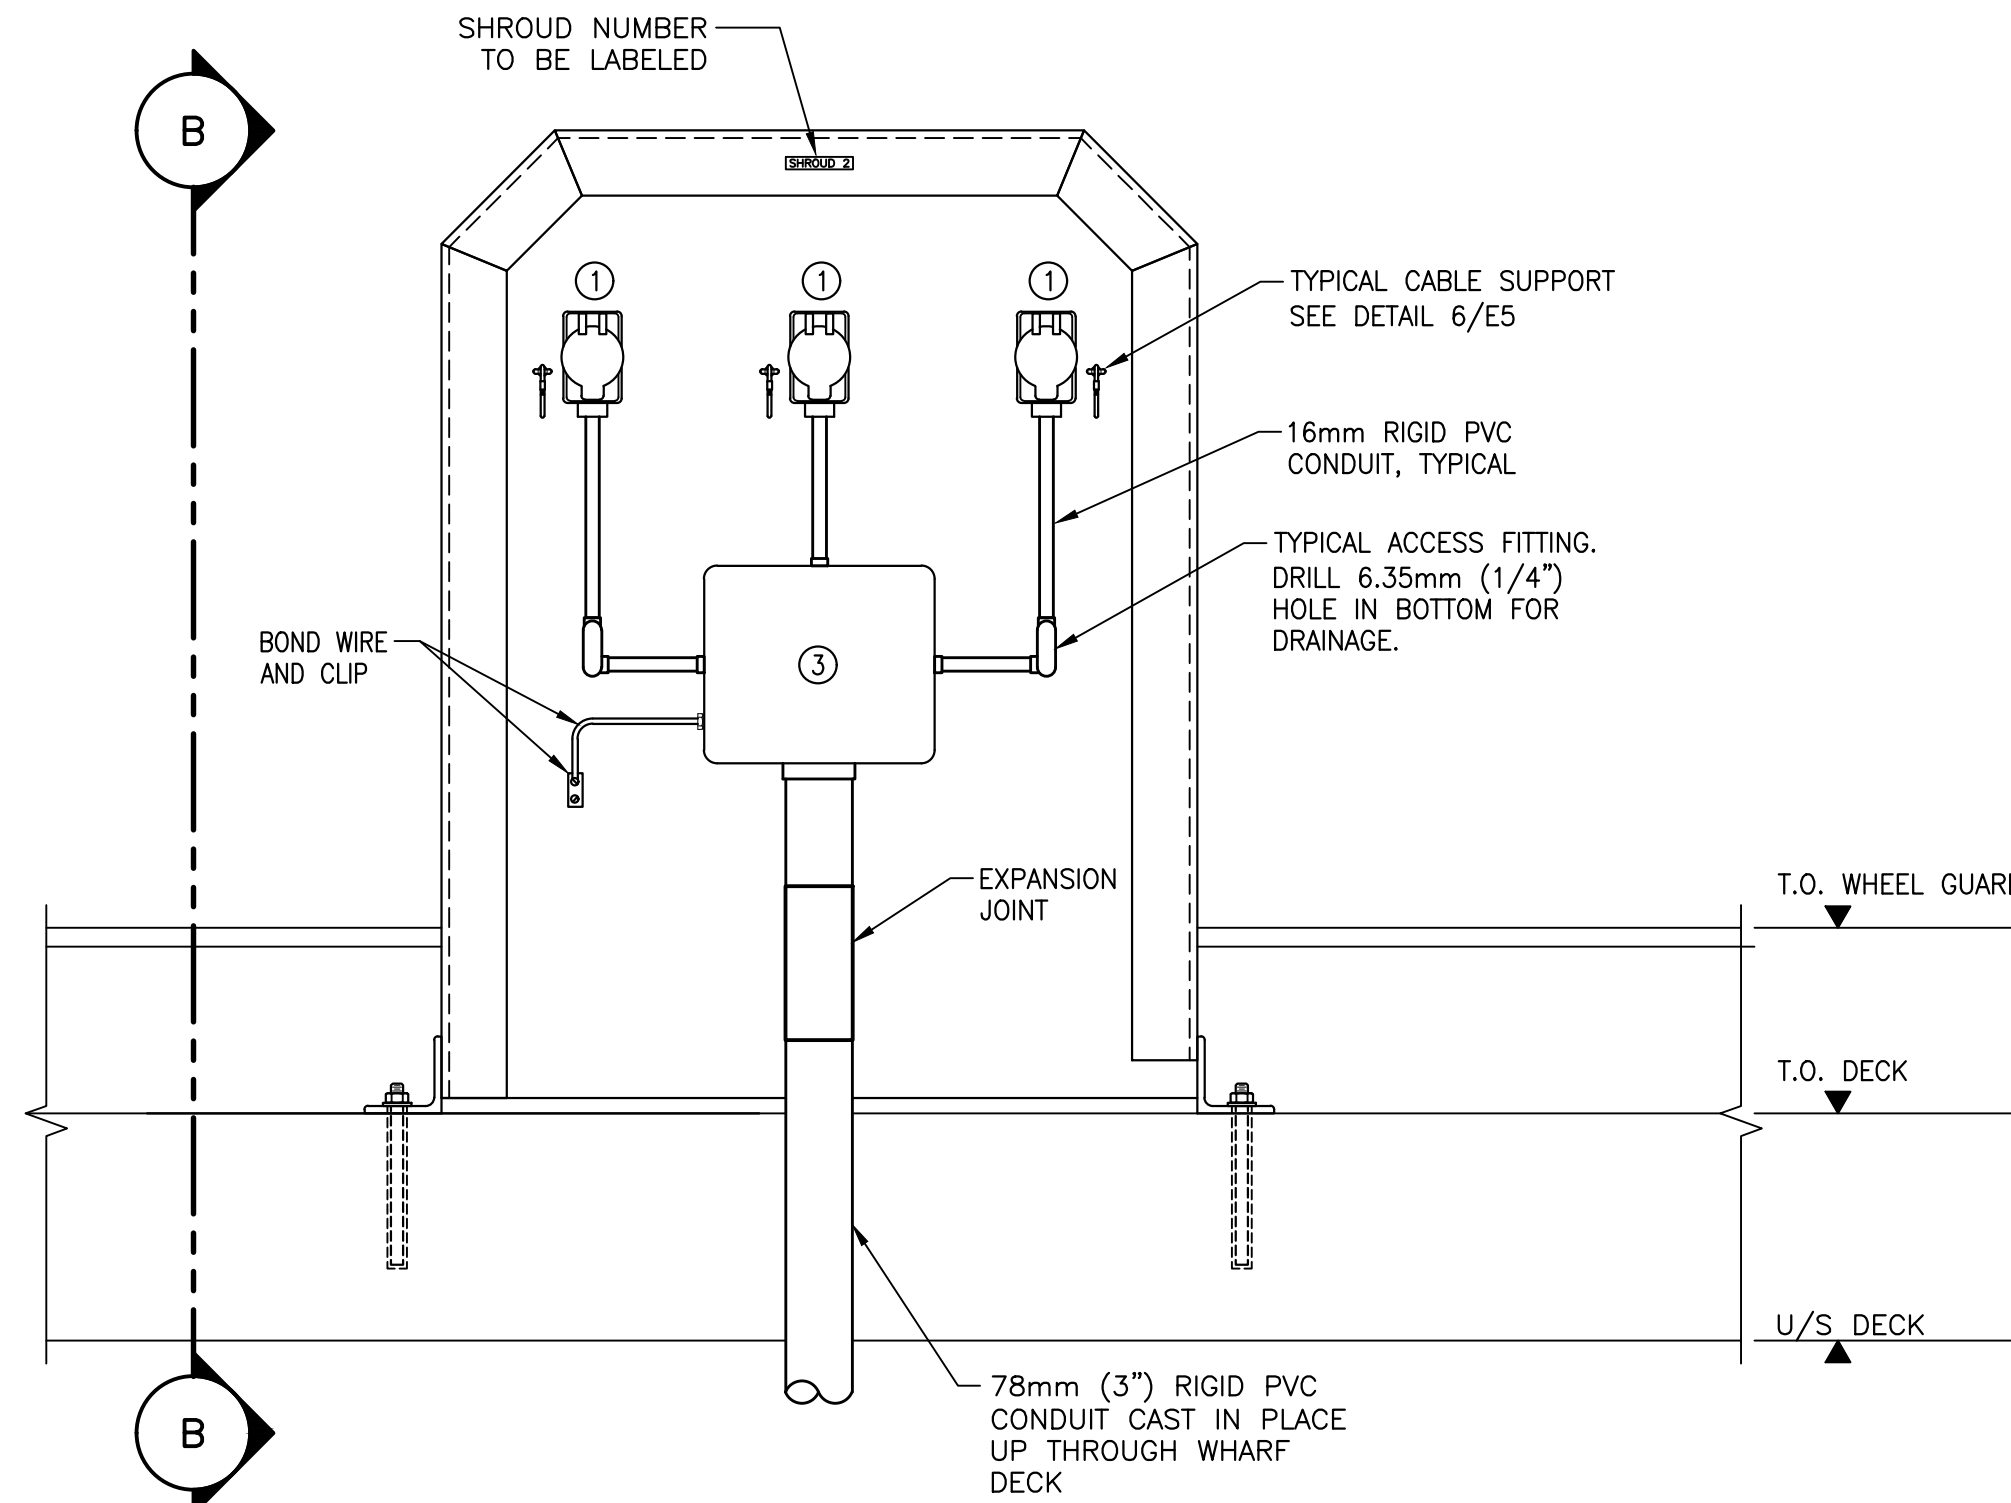

NOTE: ALSO TYPICAL FOR SHROUDS #3, #4 AND #5

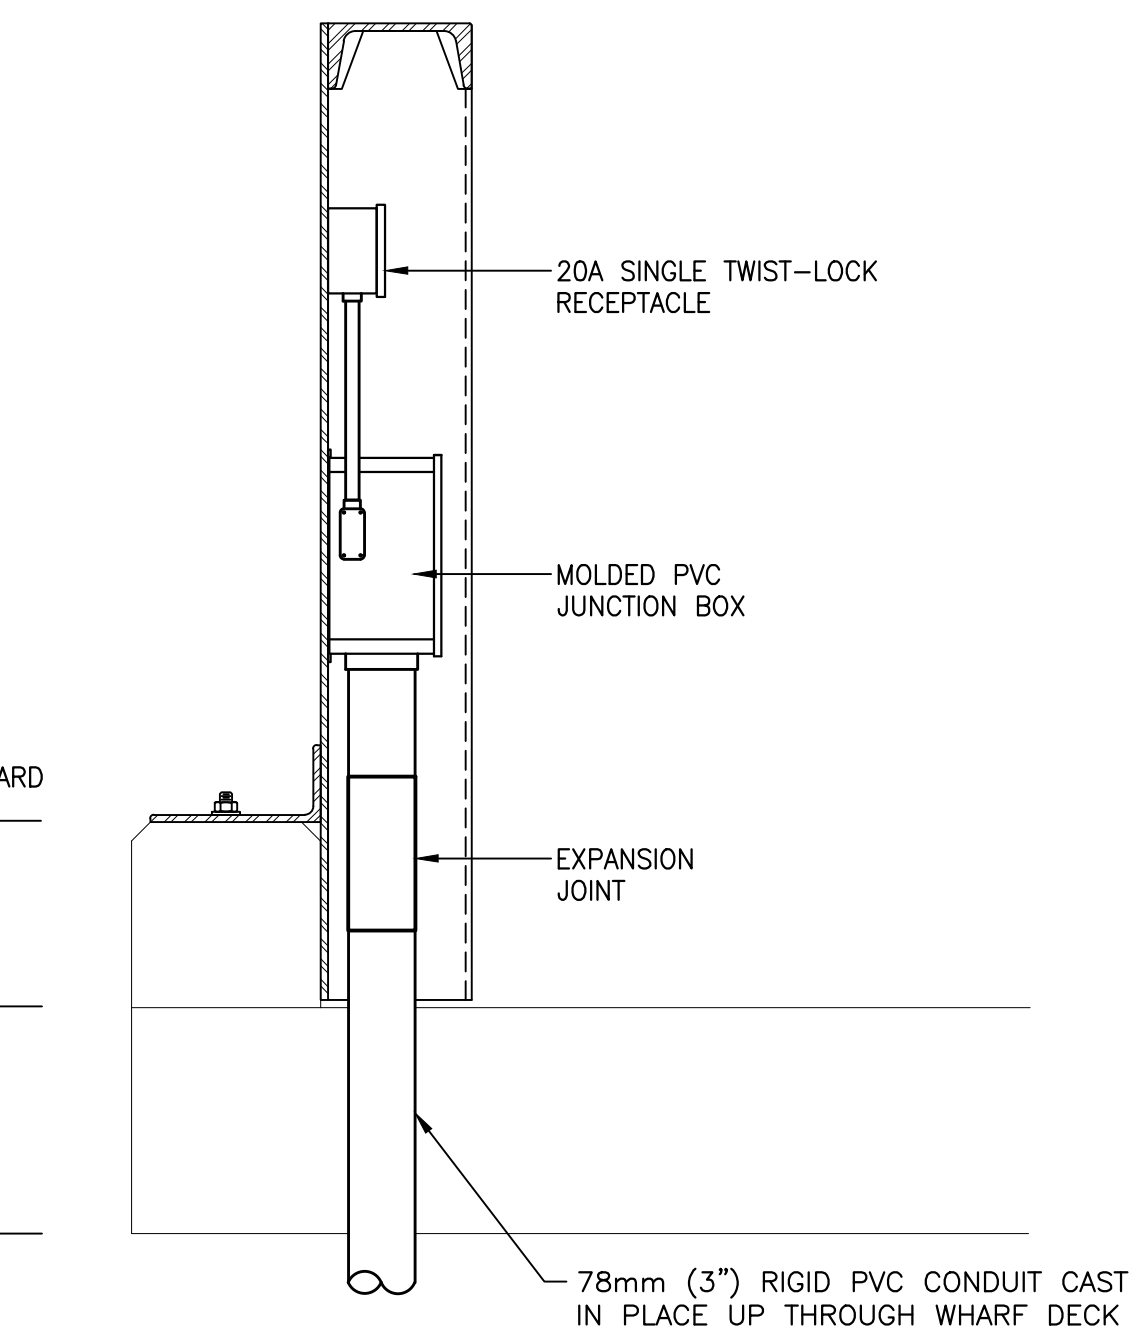

NOTE: ALL DIMENSIONS ARE IN MILLIMETERS.

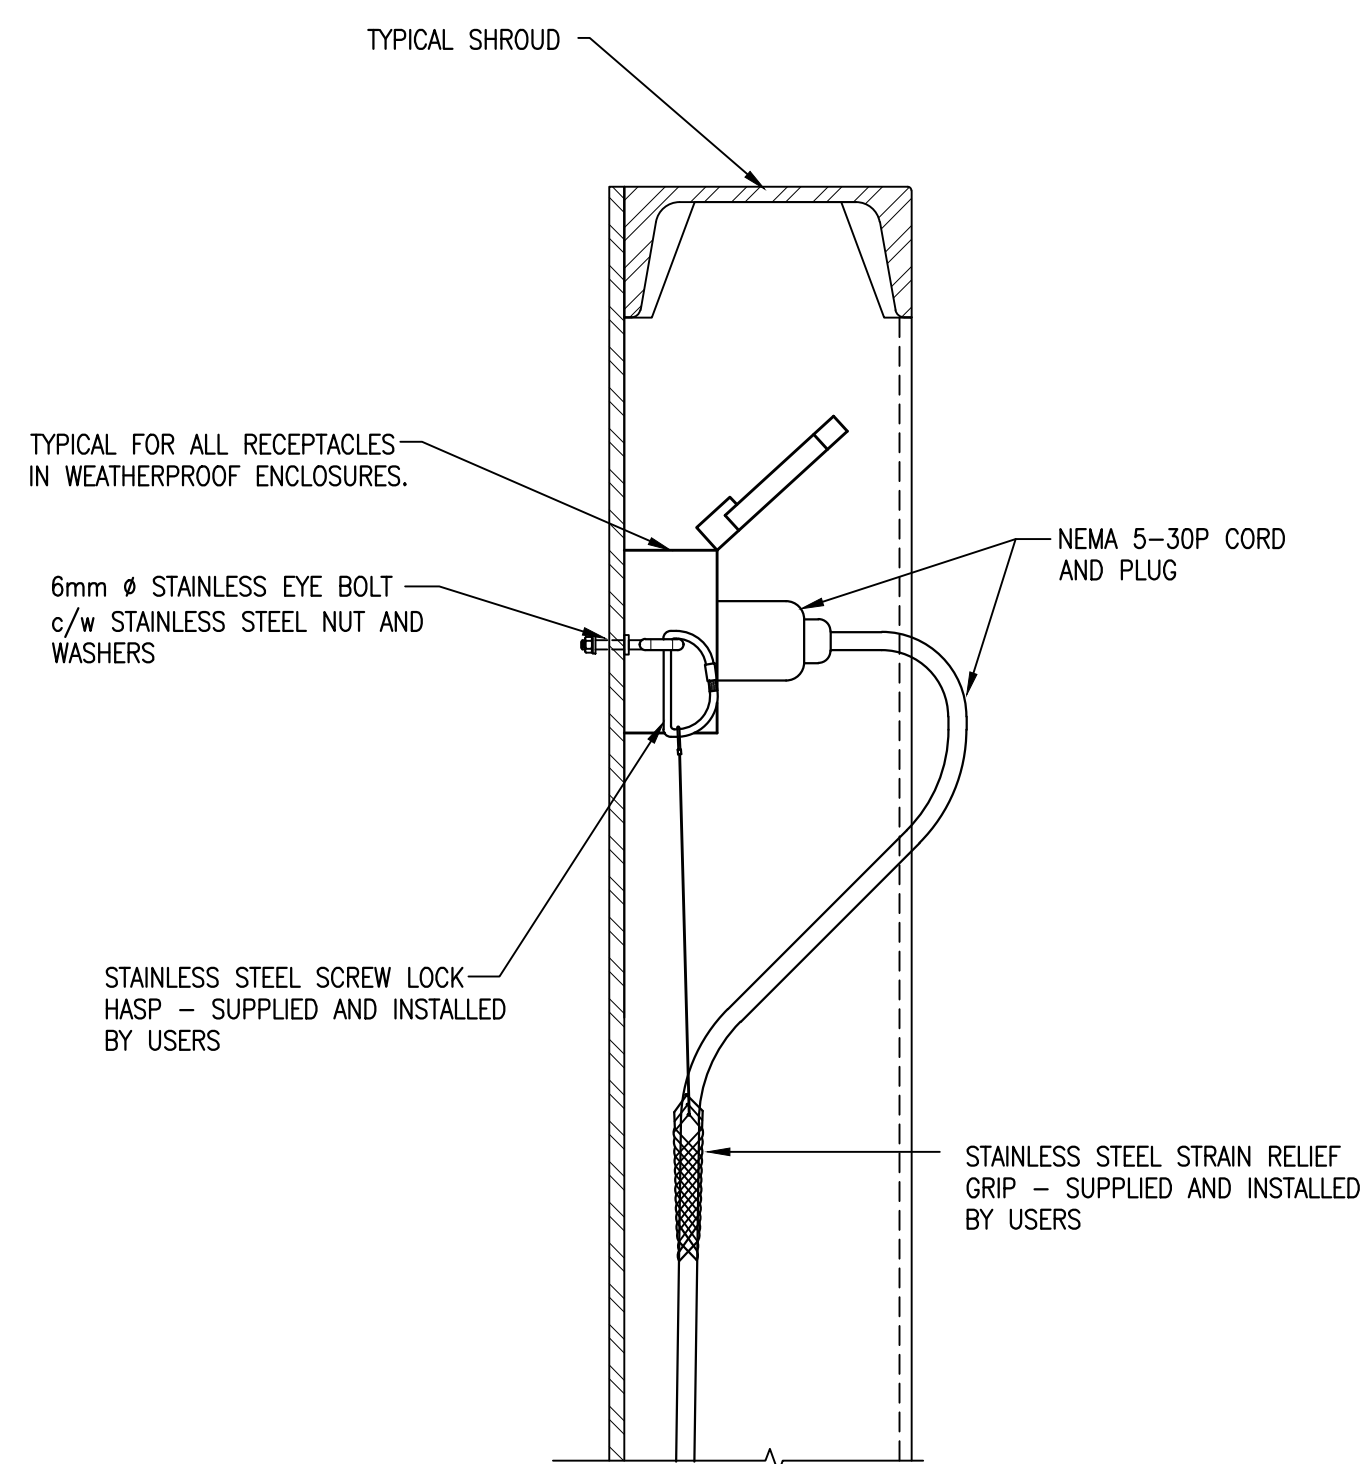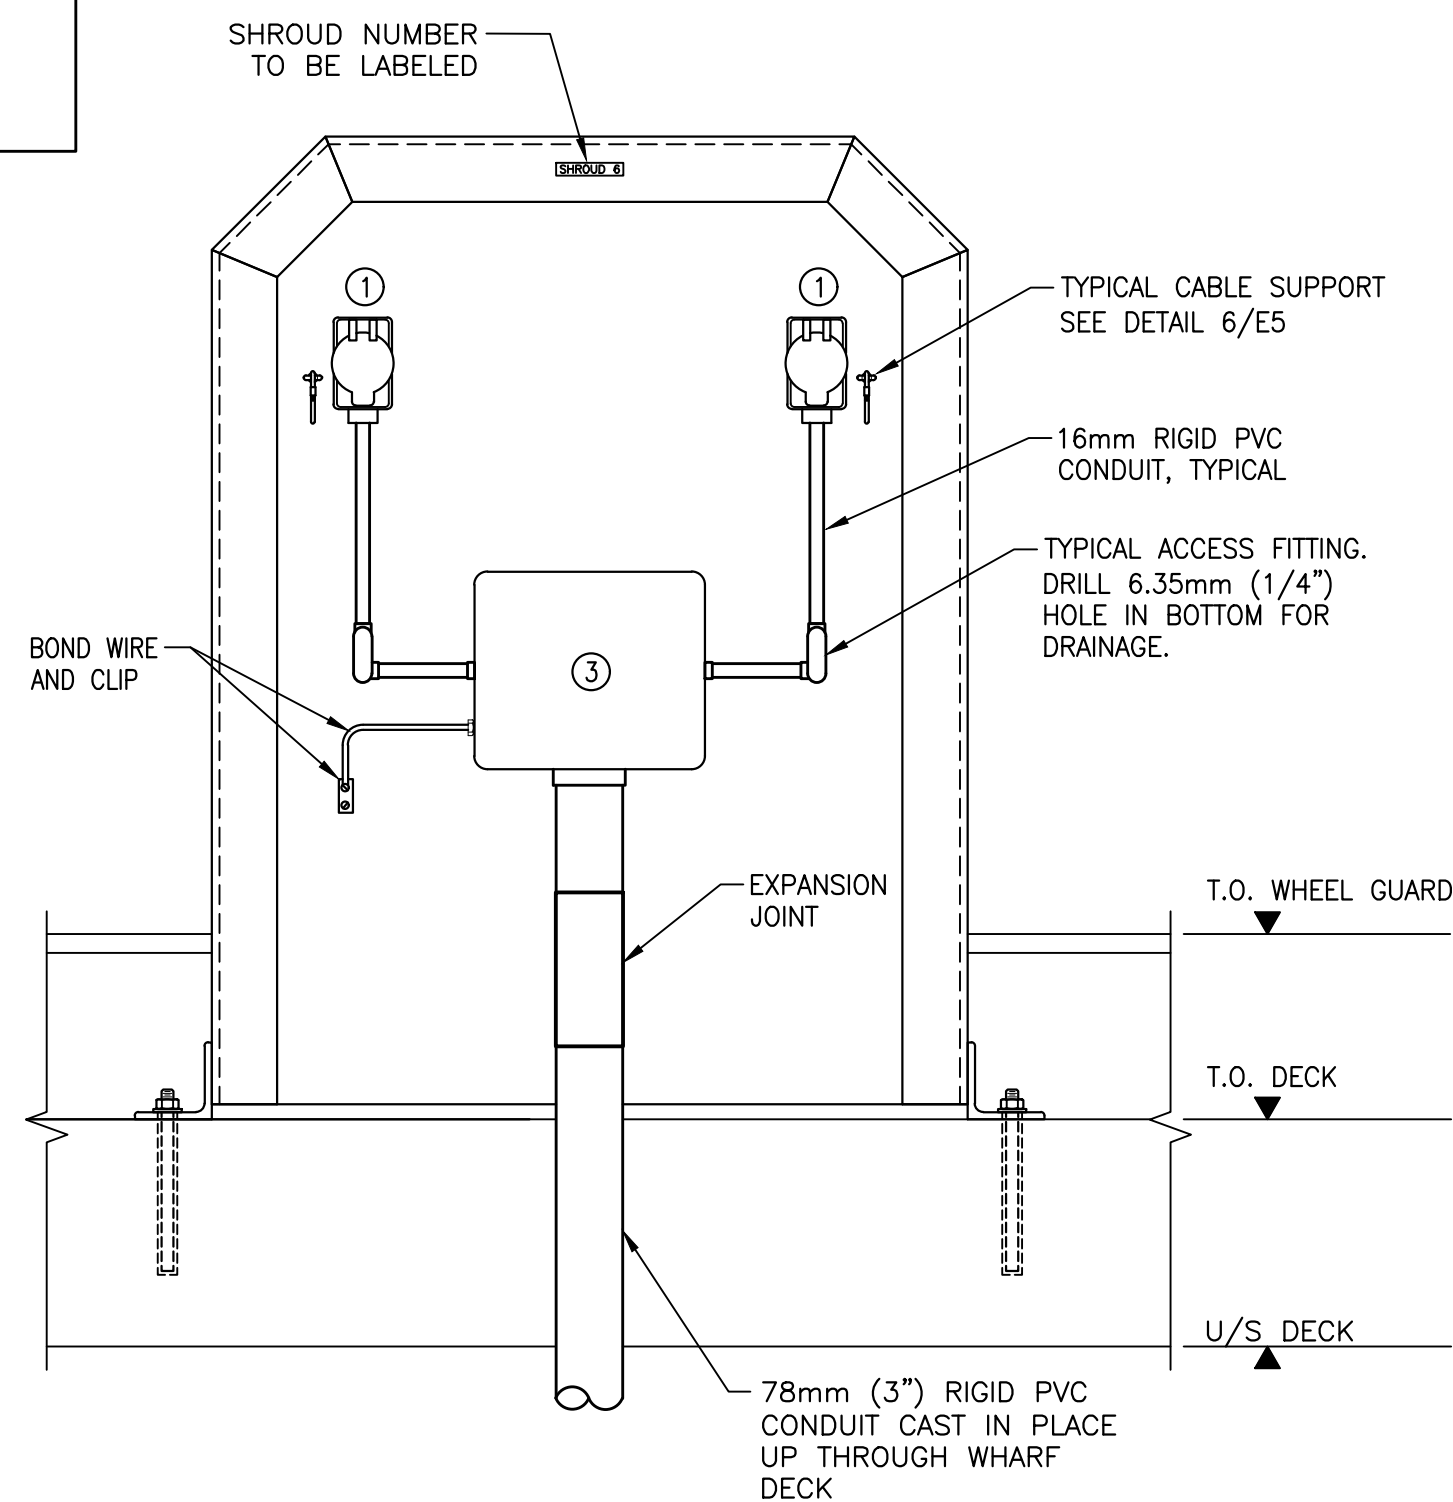

| | | |
|-----------|-------------------|------------|
| 0 | ISSUED FOR TENDER | SEPT. 2018 |
| revisions | | date |

project UPPER PORT LATOUR HARBOUR IMPROVEMENTS

project SHELBURNE COUNTY NOVA SCOTIA

drawing ELECTRICAL SHROUD DETAILS

desain

designed K. WOLFE conçu

date SEPTEMBER 2018

drawn K. WOLFE dessiné

date SEPTEMBER 2018

approved

date

Tender

IPWSC Project Manager Administrateur de projets TPSCC

project number R.097709.001

no. du projet

drawing no. E5

no. du dessin