

- DEMOLITION GENERAL NOTES:**
1. ALL DEVICES SHOWN ARE EXISTING TO REMAIN UNLESS OTHERWISE NOTED.
 2. NOT ALL EXISTING FIRE ALARM DEVICES ARE SHOWN. ONLY THOSE BEING IMPACTED BY RENOVATION ARE SHOWN.
 3. ALL DEVICES SHOWN TO BE REMOVED ARE TO BE REMOVED BACK TO SOURCE C/W CONDUIT, CABLING, FITTINGS, ETC. AS MUCH AS PRACTICAL.
 4. EXISTING GENERATOR NOT TO BE REMOVED UNTIL NEW GENERATOR C/W TRANSFER SWITCH, ASSOCIATED CONNECTIONS ARE COMPLETED TO MAKE A COMPLETE EMERGENCY DISTRIBUTION NETWORK. COORDINATE BUILDING SHUTDOWN WITH OWNER.

1200, 10909 Jasper Avenue NW
Edmonton, AB, Canada T5J 3L9
Tel.: +1 780-410-6740
Fax: +1 780-449-4050
wsp.com

CONSULTANT:

SEAL:

CLIENT:

CLIENT REF. # CLIENT_REFERENCE_#

PROJECT:

MIETTE HOT SPRINGS
GENERATOR UPGRADE

KEY PLAN:

DISCLAIMER: THIS DRAWING AND DESIGN IS COPYRIGHT PROTECTED WHICH SHALL NOT BE USED, REPRODUCED OR REVISED WITHOUT WRITTEN PERMISSION BY WSP CANADA INC. THE CONTRACTOR SHALL CHECK AND VERIFY ALL DIMENSIONS AND UTILITY LOCATIONS AND REPORT ALL ERRORS AND OMISSIONS PRIOR TO COMMENCING WORK. THIS DRAWING IS NOT TO BE SCALED.

ISSUED FOR - REVISION:

NO.	RE	DATE	DESCRIPTION
3		2018/12/17	ISSUED FOR ADDENDUM E001
2		2018/12/03	ISSUED FOR TENDER
1		2016/11/28	ISSUED FOR 99% REVIEW

PROJECT NO: 181-13597-15 DATE: 2018/12/17

ORIGINAL SCALE: 1:50

DESIGNED BY: MP

DRAWN BY: DT

CHECKED BY: MJ

DISCIPLINE: ELECTRICAL

TITLE: LOWER LEVEL ELECTRICAL DEMOLITION AND CONSTRUCTION PLANS


SHEET NUMBER: E101

SHEET # 2 OF 3

ISSUE: ISSUED FOR ADDENDUM E001

DATE OF: 2018/12/17

REV # 2

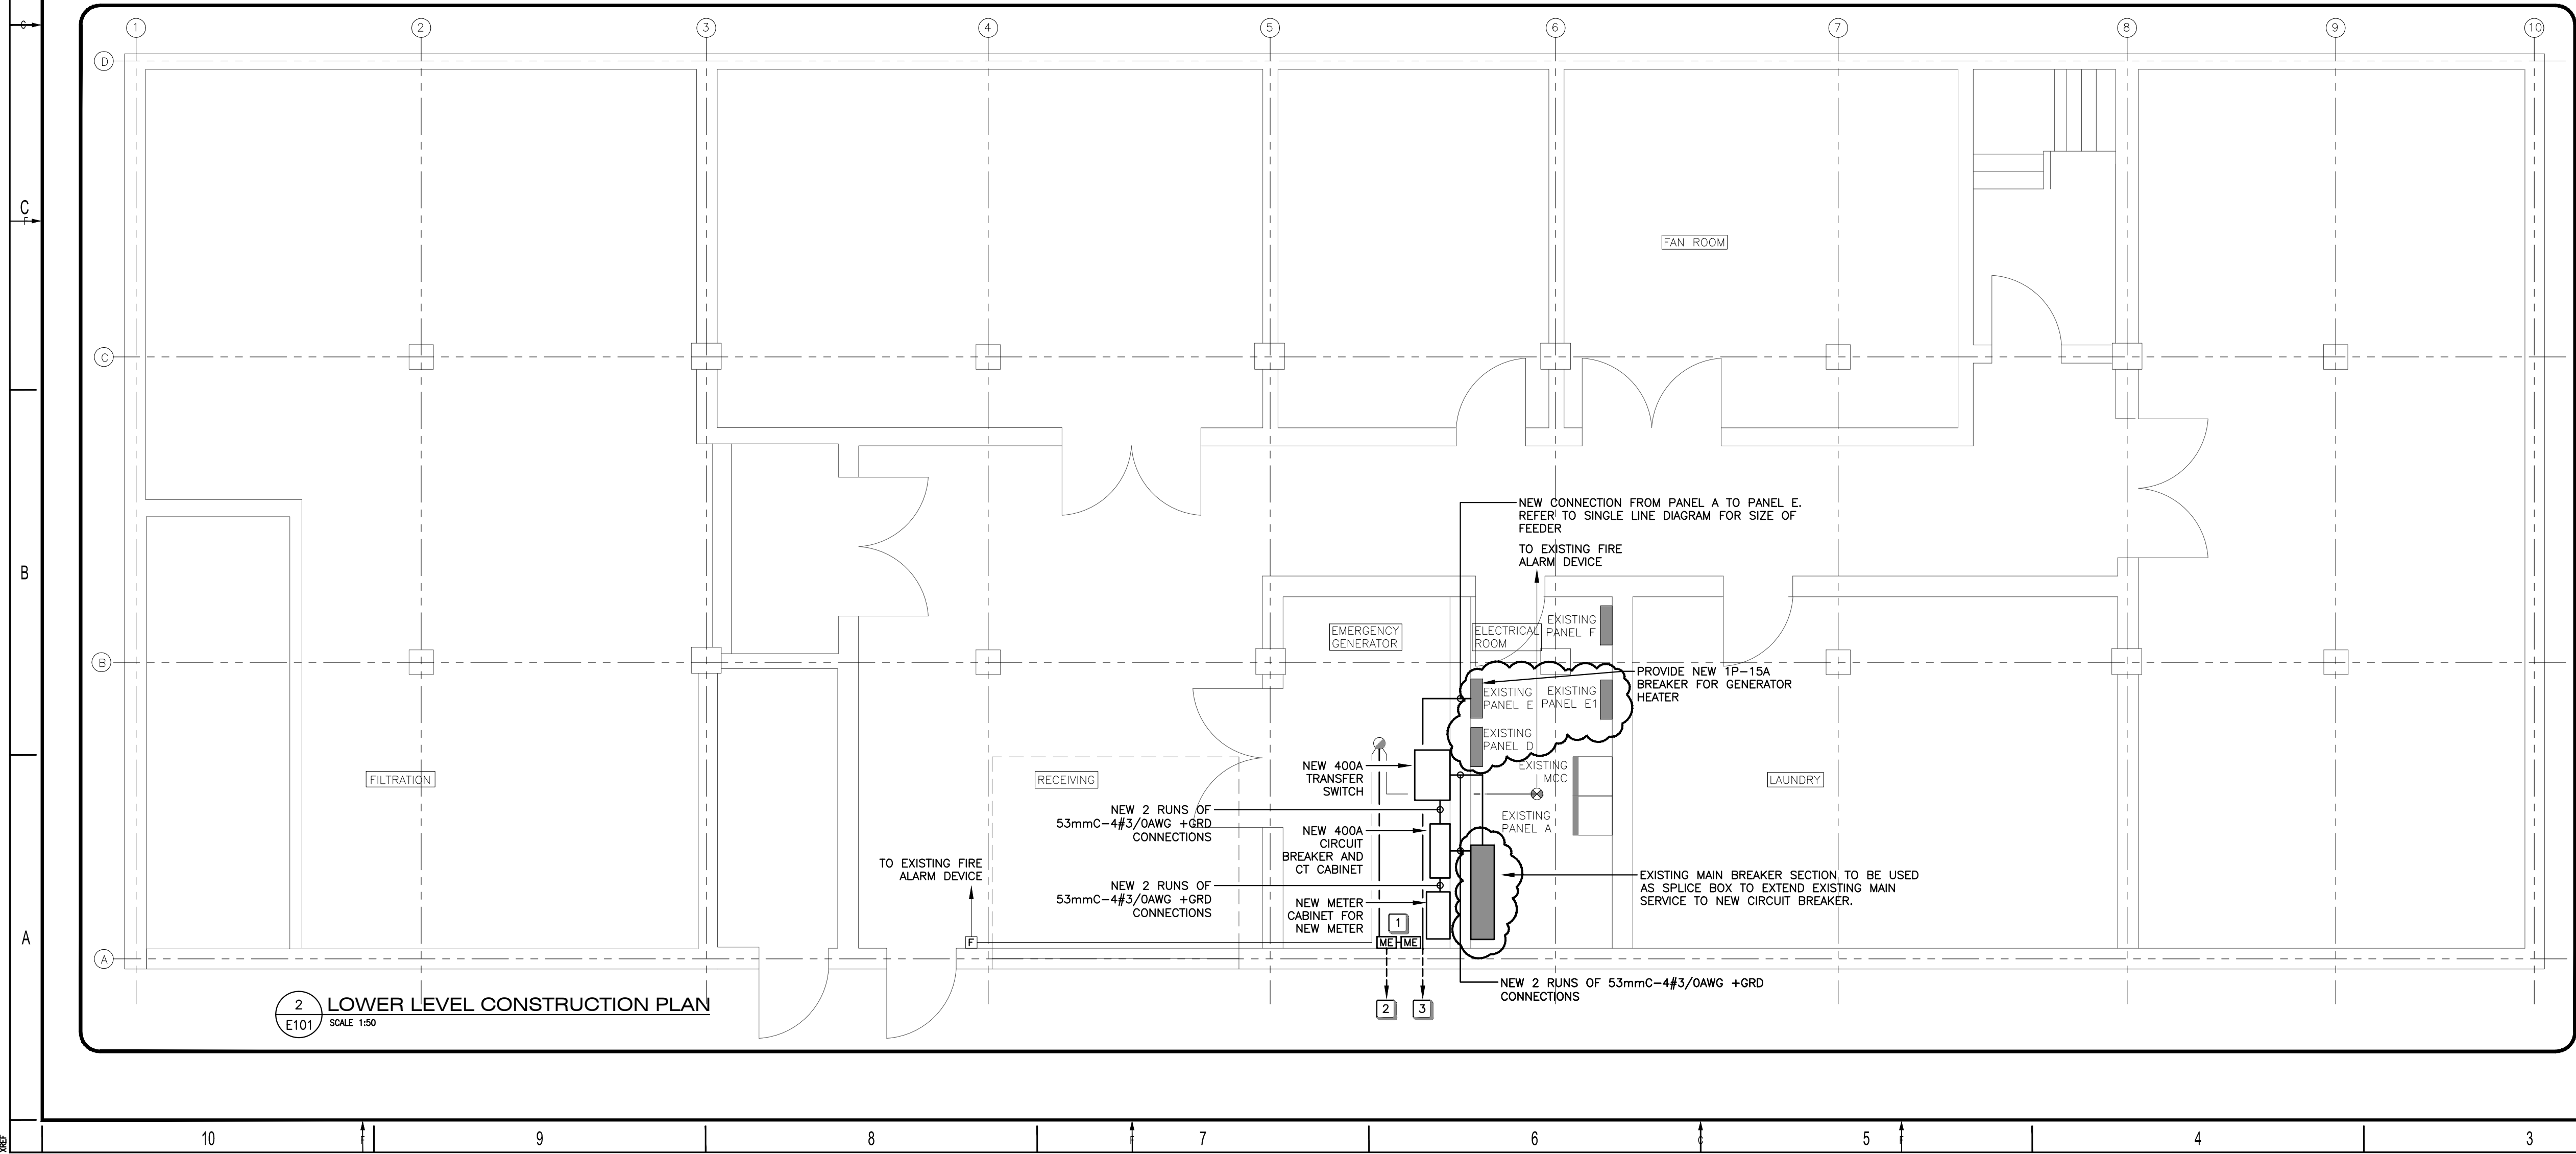

- CONSTRUCTION GENERAL NOTES:**
1. ALL DEVICES SHOWN ARE EXISTING TO REMAIN UNLESS OTHERWISE NOTED.
 2. CONFIRM ALL DEVICE QUANTITIES AND LOCATIONS ON SITE.
 3. PROVIDE NEW FIRE ALARM CONNECTIONS AS SHOWN. FIRE ALARM CABLING TO MATCH EXISTING. CONTRACTOR TO REVIEW EXISTING CABLING ON SITE.
- CONSTRUCTION KEYNOTES:**
1. PROVIDE 2 NEW MONITOR MODULES INSIDE BUILDING AND PROVIDE UNDERGROUND CONNECTIONS FOR GENERATOR TO MONITOR GENERATOR RUN/FAL. PROVIDE CONDUIT FROM EXISTING HEAT DETECTOR TO NEW MONITOR MODULES. MAINTAIN CLASS 'A' WIRING. UTILIZE EXISTING CONDUIT TO RUN FIRE CABLING FROM MONITOR MODULE TO EXISTING SMOKE DETECTOR.
 2. PENETRATE CONDUIT TO EXTERIOR OF BUILDING AND RUN UNDERGROUND CONDUITS/CABLING TO GENERATOR. REFER TO SITE PLAN FOR ADDITIONAL INFORMATION.
 3. PROVIDE POWER CONNECTION TO GENERATOR BLOCK HEATER. REFER TO SITE PLAN FOR CONDUIT/CABLE SIZING.