


GENERATOR CONNECTIONS





NOTES:

1. KATO ENGINEERING RECOMMENDS SHIELDED WIRING FOR MAXIMUM EMI SUPPRESSION. USE TWISTED PAIR, SHIELD GROUNDED TO CHASSIS AT BOTH ENDS, ON ALL SHIELDED WIRING.
2. ALL RTD WIRE #22 AWG. MINIMUM
3. ALL WIRING RATED 600V. MINIMUM UNLESS OTHERWISE STATED.

ENCLOSURES WITH THIS LINETYPE, ARE INDIVIDUAL LEAD JUNCTION BOXES, UNLESS OTHERWISE NOTED.

MOTOR CONNECTIONS

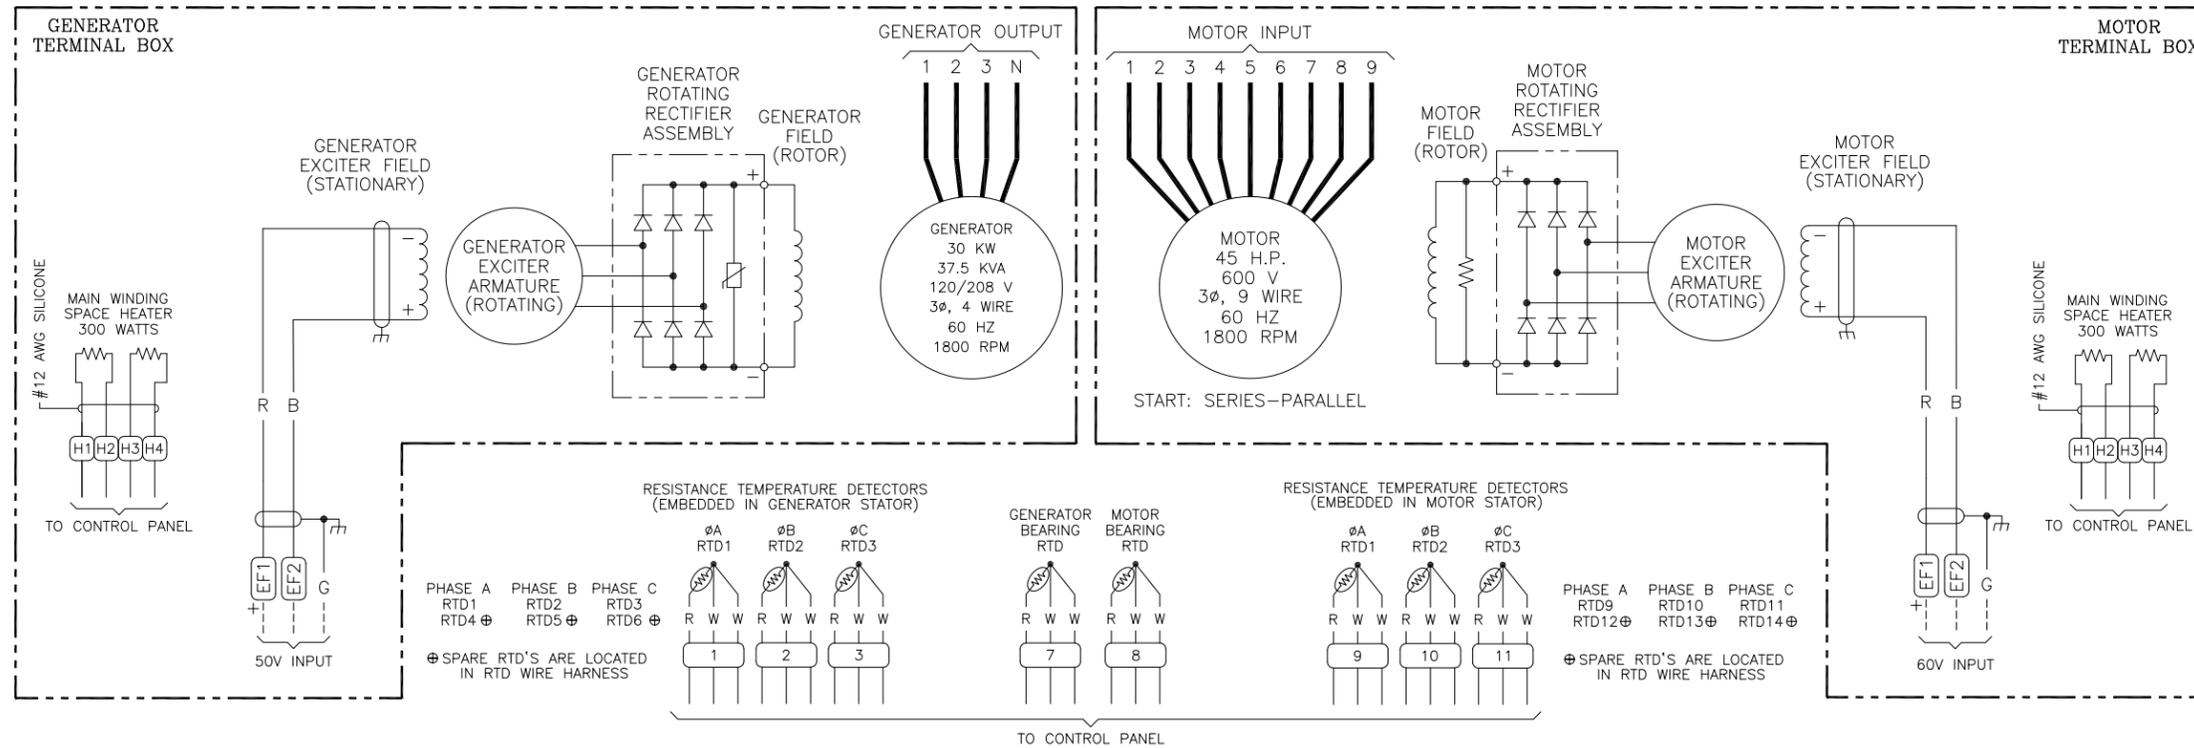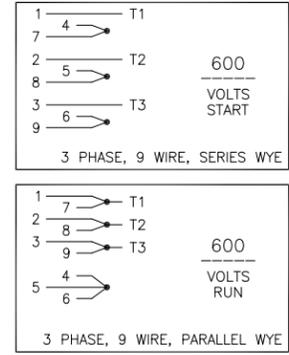

THE INFORMATION HEREON IS THE PROPERTY OF KATO ENGINEERING. WITHOUT WRITTEN PERMISSION, ANY COPYING, TRANSMITTAL TO OTHERS, AND ANY USE EXCEPT THAT FOR WHICH IT IS LOANED IS PROHIBITED.			REV A
NEE	DLB	8-27-18	47796
MAT'L NONE			2075 Howard Drive West North Mankato, MN 56003
TITLE MOTOR GENERATOR CONNECTION DRAWING			DRAWING NUMBER SH 1 OF 1
888-00477-96			

Kato Engineering