



LOCATIONS OF WORKS

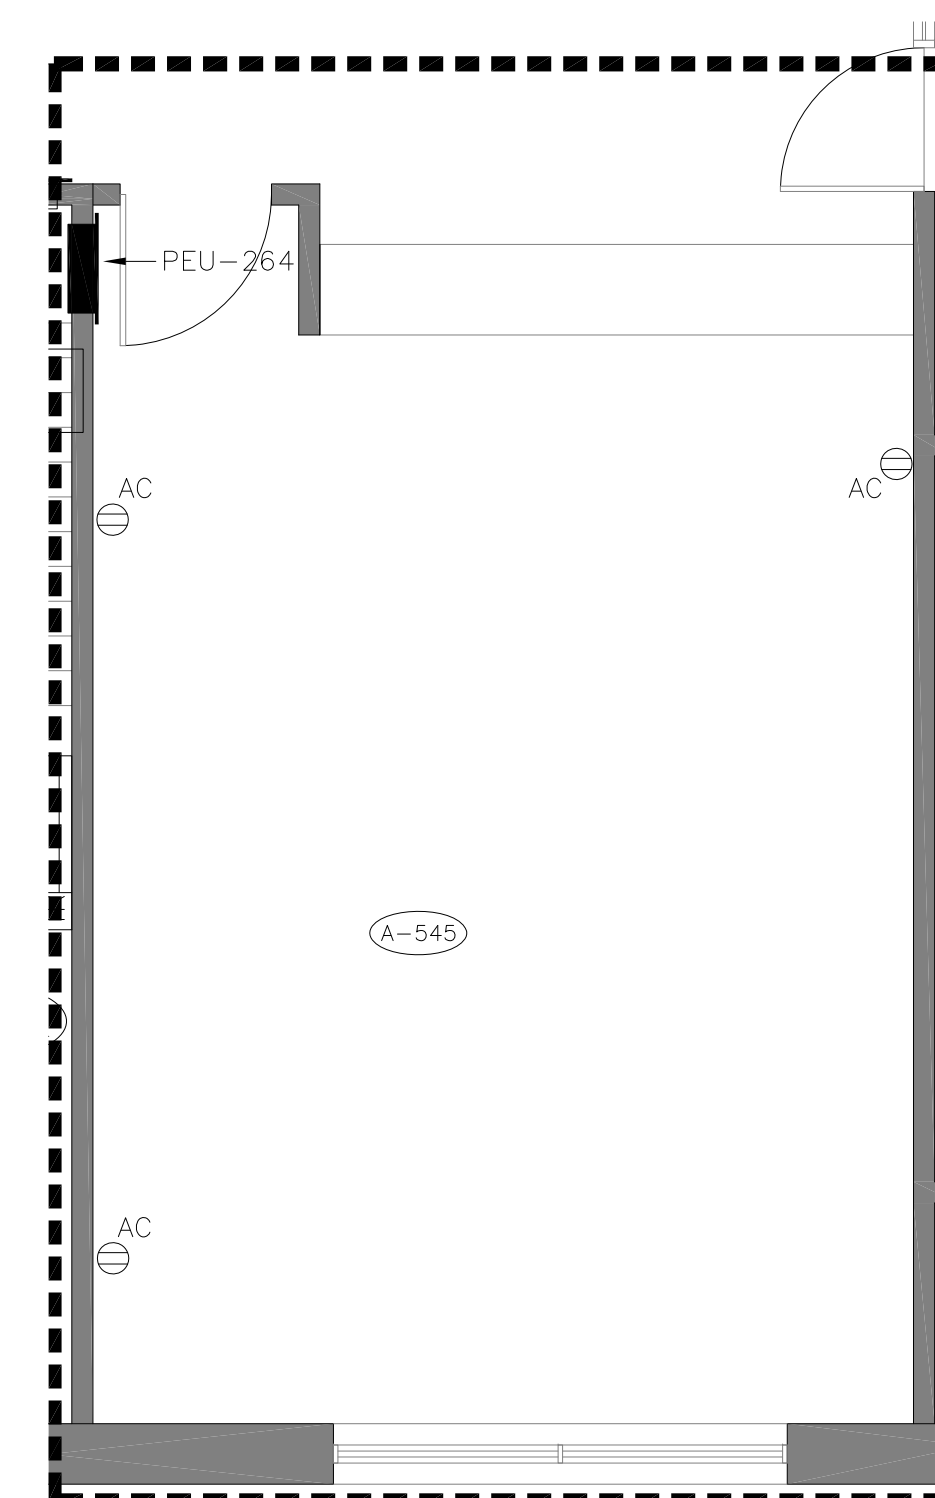


1. REPLACE 2x20A BREAKER BY TWO 1x15A BREAKERS.
2. ROLL UP THE TELECOMMUNICATION CABLE IN THE CEILING SPACE, FOR FUTURE USE BY CLIENT.
3. ENSURE CONTINUITY OF CIRCUITS DURING RENOVATIONS.
4. UNINSTALL ALL OF THE ELECTRICAL ELEMENT (EXCEPT THOSE WITH AC INDICATION). THE CIRCUITS FOR THE UNINSTALLED ITEMS WILL GENERALLY BE REUSED FOR NEW INSTALLATIONS. ENSURE CONTINUITY OF THESE CIRCUITS.
5. ALL ELECTRICAL DEVICES TO BE RELOCATED MUST BE REPLACED WITH NEW DEVICES, OF COMMERCIAL GRADE LIKE THE EXISTING.

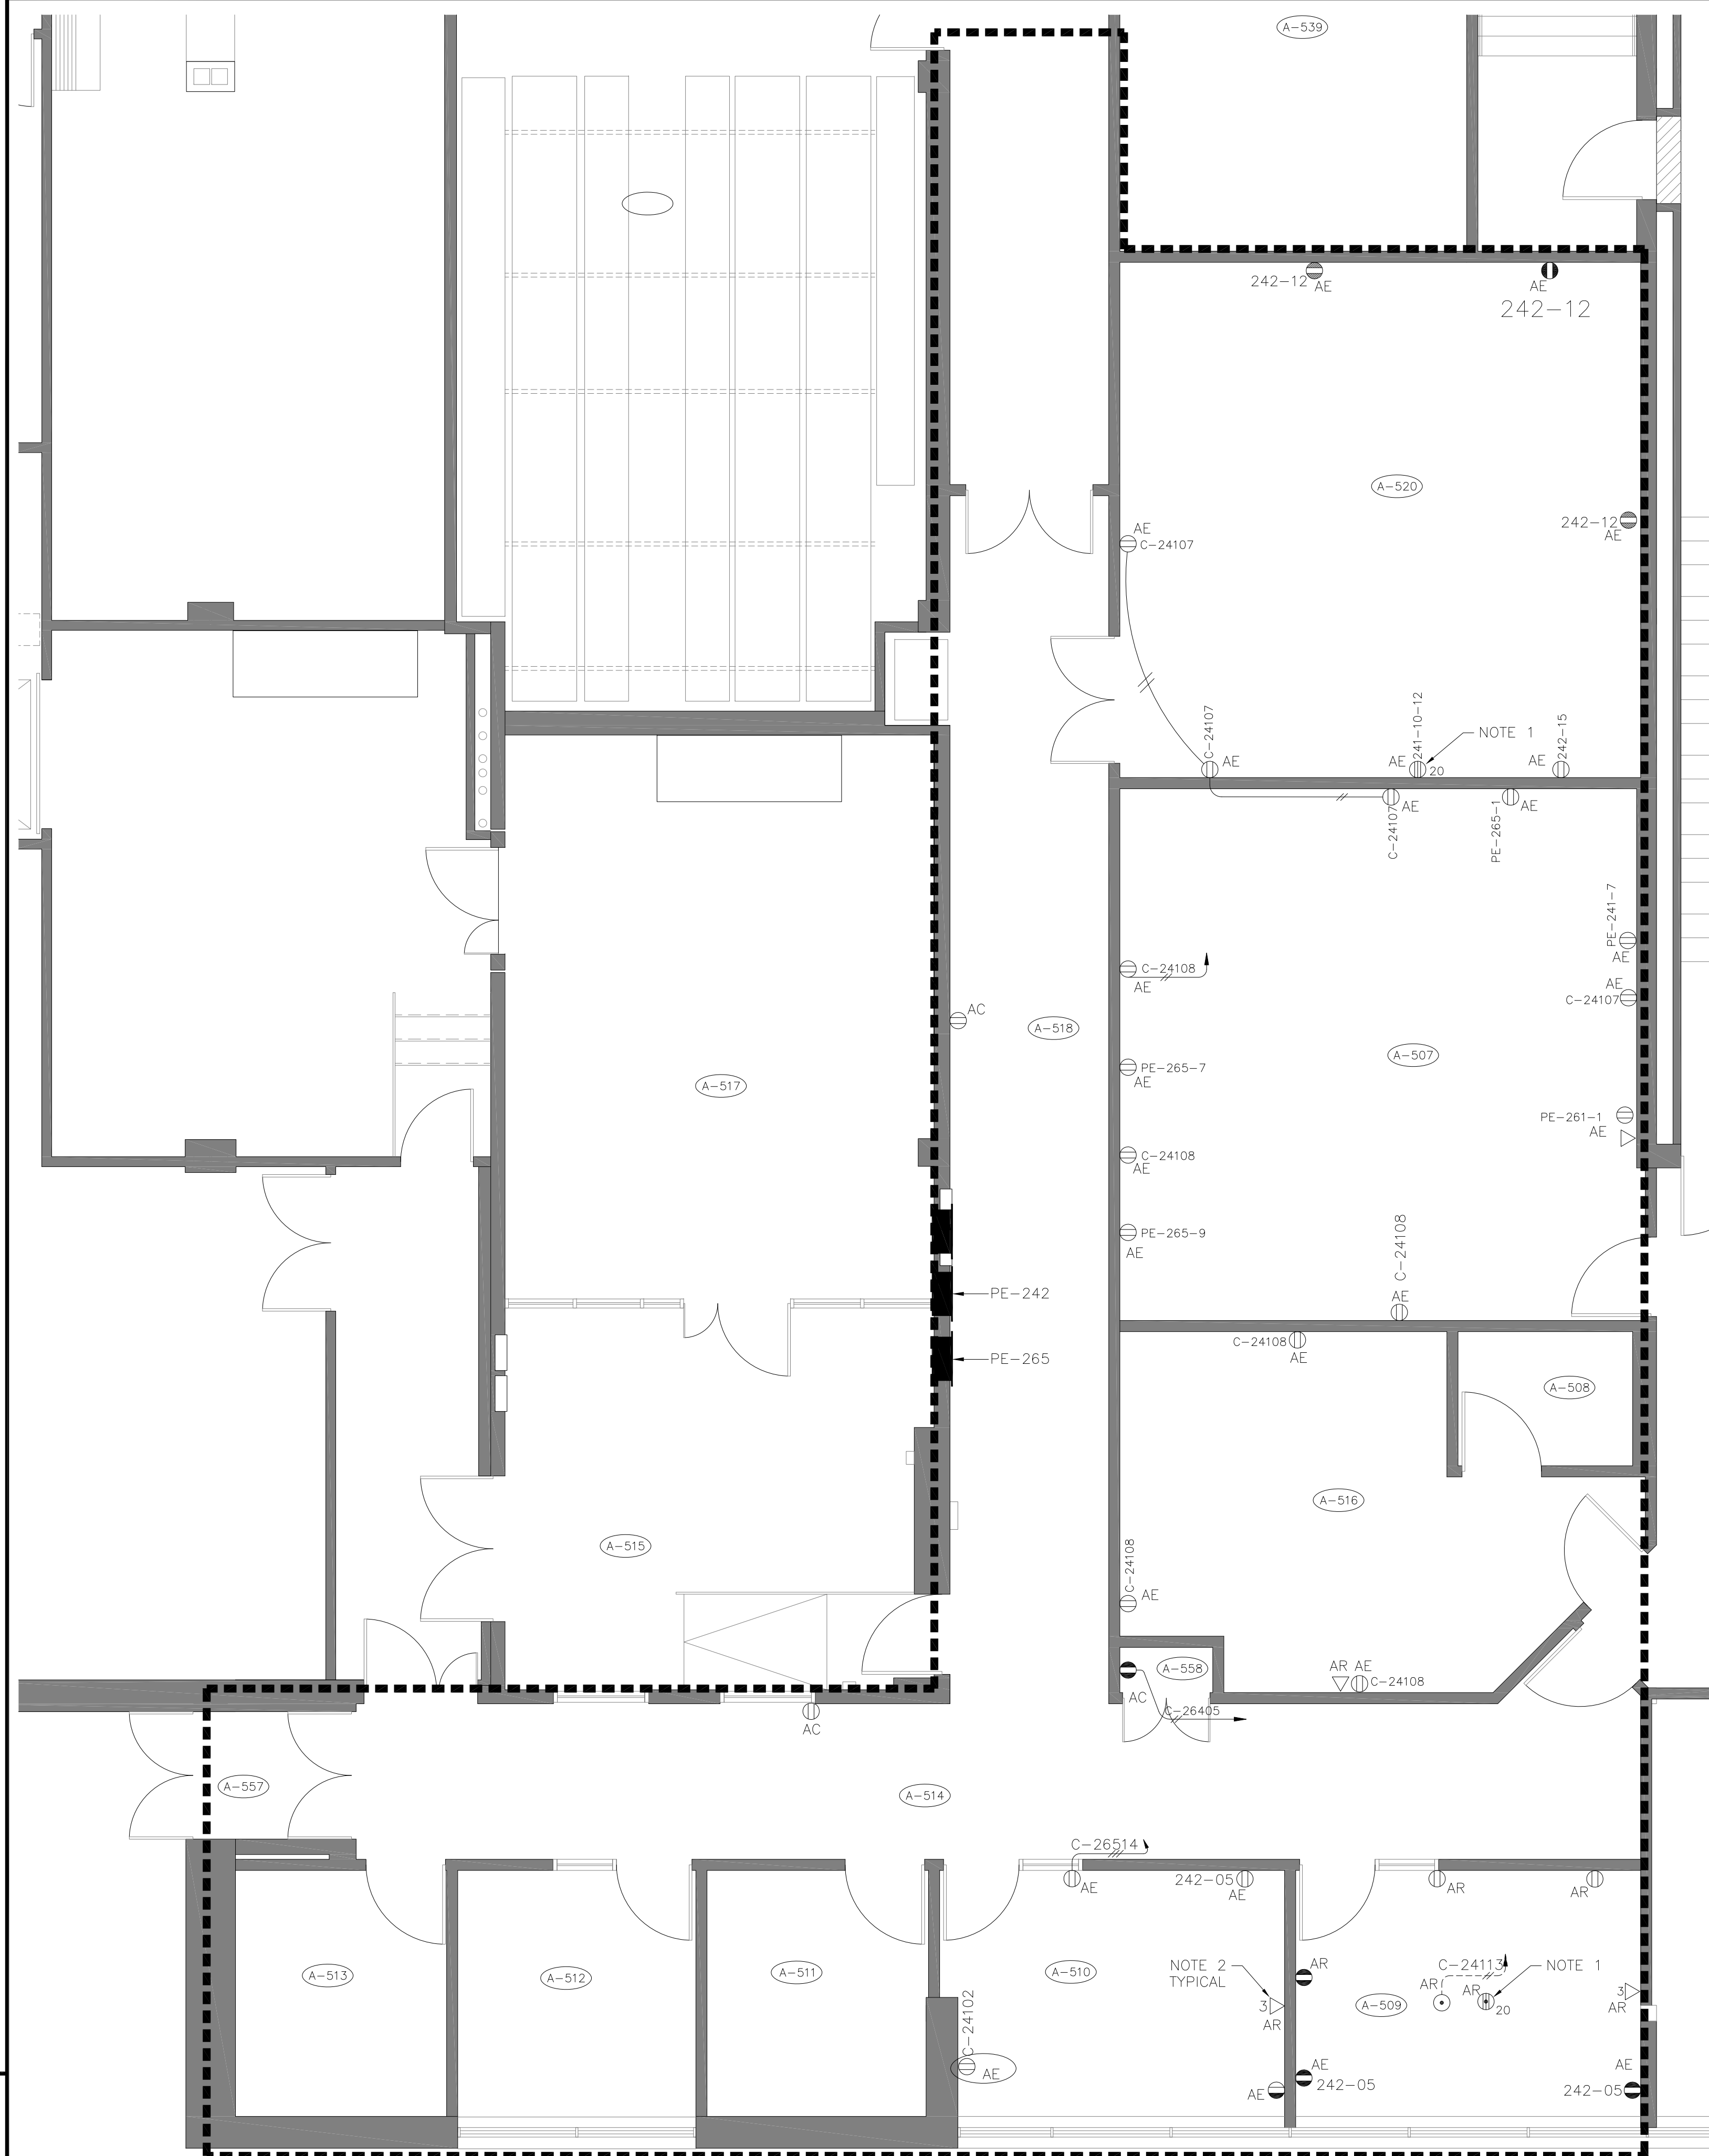

LEVEL 5 - ZONE D  
PLAN VIEW  
SCALE 1:50



LEVEL 5 – ZONE C  
PLAN VIEW  
SCALE 1:50

	FOR TENDER	JMP	2019-01-18
Révision	Description	Par/By	Date
<div style="display: flex; justify-content: space-between; align-items: flex-start;"> <div style="width: 30%;"> <p>A: Numéro du détail Detail no.</p> <p>B: Feuille sur laquelle le détail est référé Location drawing no.</p> <p>C: Feuille sur laquelle le détail est dessiné Drawing no.</p> </div> <div style="width: 30%; text-align: center;">  </div> <div style="width: 30%; text-align: center;">  </div> </div>			
Toute modification doit être rapportée à: All modification must be reported to:			
Biens Immobiliers, Environnement, Sécurité et Santé 104, Dalousie, Québec, Qc G1K 7Y7			
Dossier: File:			
<h1>MONT-JOLI</h1> <h2>MAURICE-LAMONTAGNE BUILDING</h2> <h2>RENOVATION GIST/SPC</h2>			
Dessin: Drawing:			
<h3>OUTLETS AND SERVICES</h3> <h3>DISMANTLING</h3> <h3>LEVEL 5, BUILDING A</h3>			
Conçu par: Designed by:			
P-L Jean		JMP	2018-03-12
Dessiné par: Drawn by:			
J-M Potvin		JMP	2018-03-12
Vérifié par: Verified by:			
F. Jean		JMP	2018-05-08
Approuvé par: Approved by:			
P-L Jean		JMP	2018-05-08
No. dossier: File no.:		<b>F3766-170169</b>	Echelle: Scale: Indicated
No. dessin: Drawing no.:		No. feuille: Sheet no.:	
		E08 OF 19	