
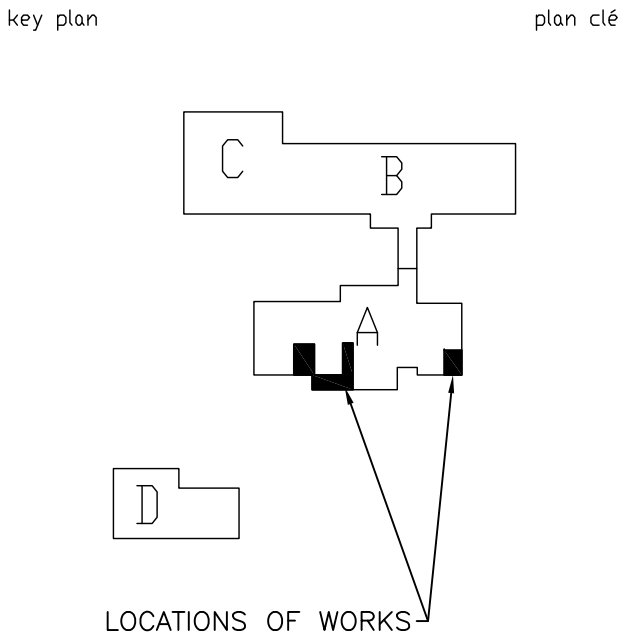


NOTES

1. INCLUDE THE VERIFICATION OF THE FIRE ALARM SYSTEM AFTER COMPLETING WORK, AS WELL AS APPLICABLE CERTIFICATION ULC S-524 AND ULC-S537. THIS APPLIES TO THE WHOLE PROJECT.
2. THE FIRE ALARM SYSTEM MUST REMAIN OPERATIONAL DURING ALL OF THE WORK. ANY REQUIRED INTERRUPTION OF SERVICES MUST BE DONE BY THE GENERAL CONTRACTOR, AND MUST BE COORDINATED WITH THE CLIENT'S PROPERTY MANAGER.

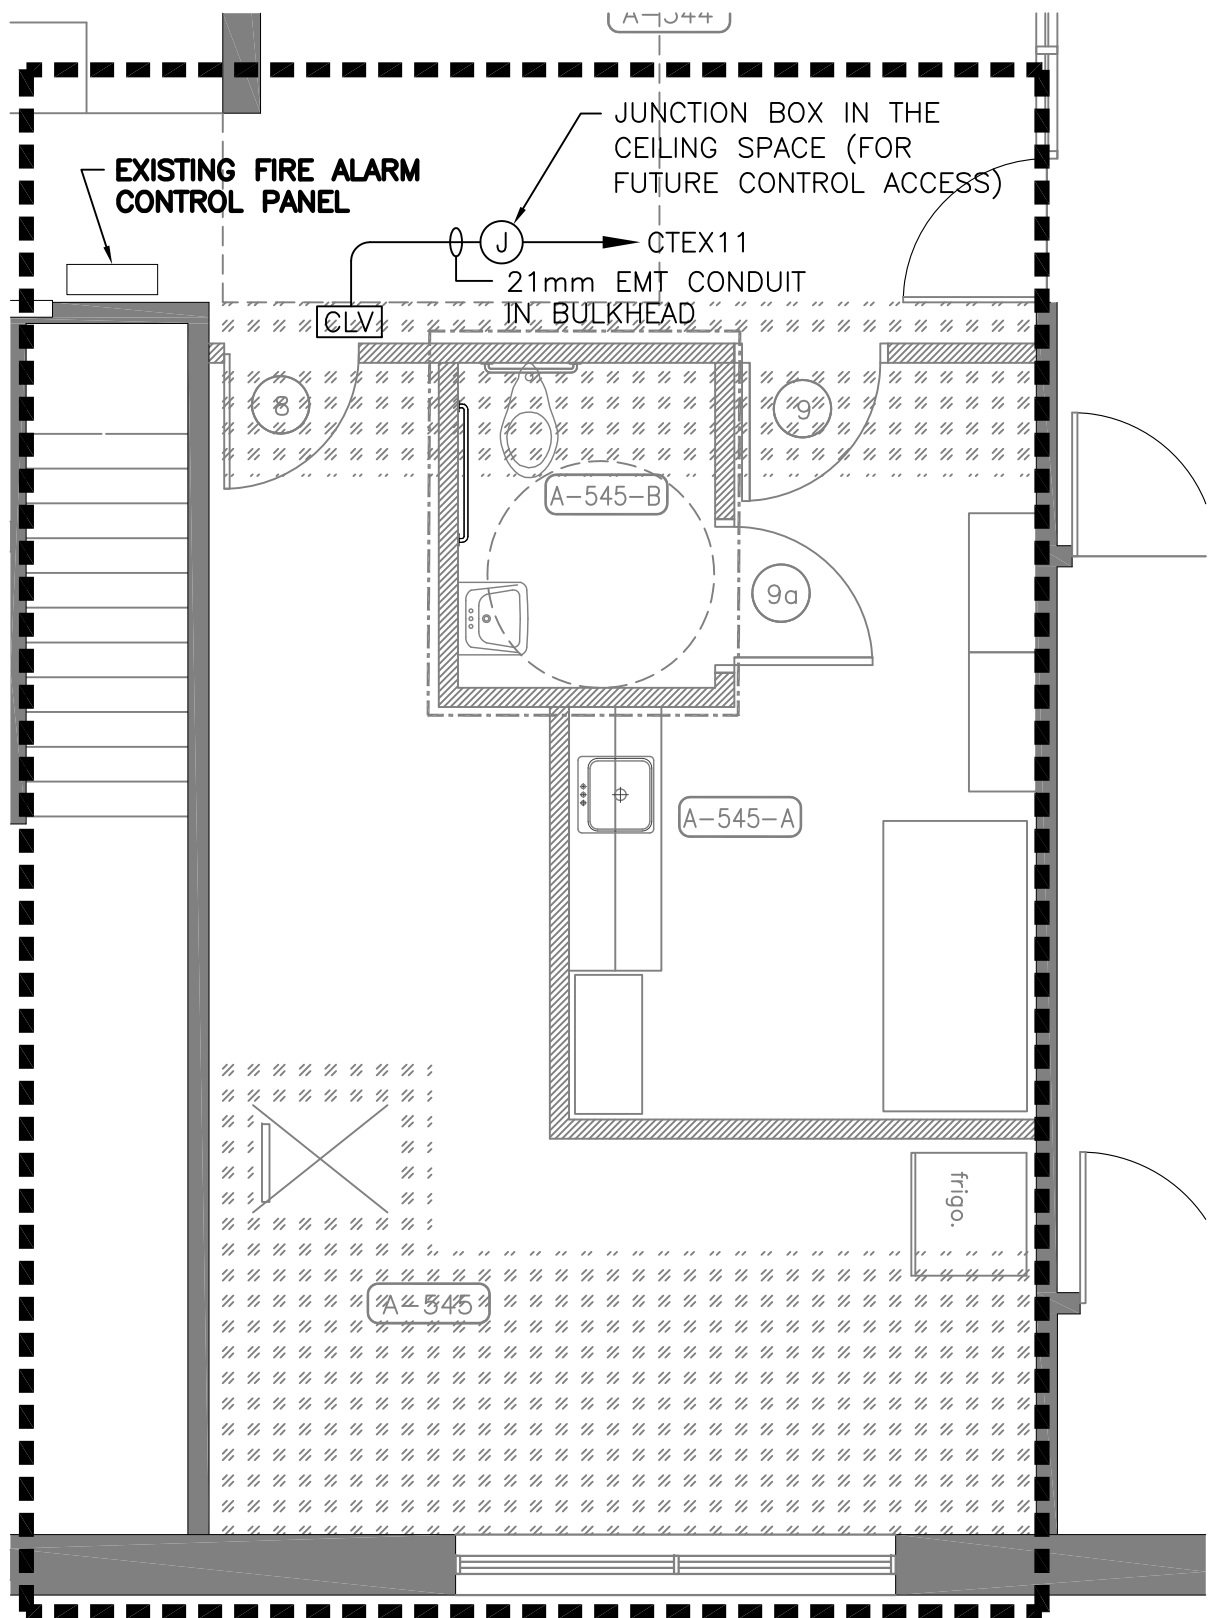

FOR TENDER	JMP	2019-03-11
Révision	Description	Par/By Date
A	A: Numéro du détail Detail no.	A
B	B: Feuille sur laquelle le détail est référencé Location drawing no.	B/C
C	C: Feuille sur laquelle le détail est dessiné Drawing no.	
Toute modification doit être rapportée à: All modification must be reported to:		
Biens Immobiliers, Environnement, Sécurité et Santé 104, Dalhousie, Québec, Qc G1K 7Y7		
Dossier: File:		
MONT-JOLI MAURICE-LAMONTAGNE BUILDING RENOVATION GIST/SPC		
Dessiné: Drawing:		
CONNECTION OF MECHANICS AND SPECIAL SYSTEMS RENOVATION OF LEVEL 5, BUILDING A		
Conçu par: Designed by:	P-L Jean	Date 2018-03-12
Dessiné par: Drawn by:	J-M Potvin	Date 2018-03-12
Vérifié par: Verified by:	F. Jean	Date 2018-05-08
Approuvé par: Approved by:	P-L Jean	Date 2018-05-08
No. dossier: File no.:	F3766-170169	Échelle: Scale: Indicated
No. dessin: Drawing no.:		No. feuille: Sheet no.:
		E13 OF 19