




TYPICAL DETAIL – INSTALLATION OF A HEAT-PUMP (REPLACEMENT)
ÉCH : N/A

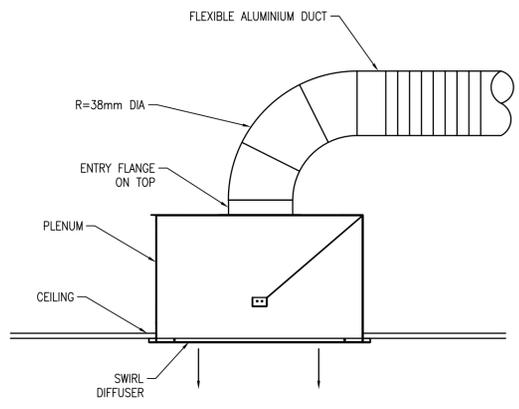

TYPICAL DETAIL – INSTALLATION OF DIFFUSER
ÉCH : N/A

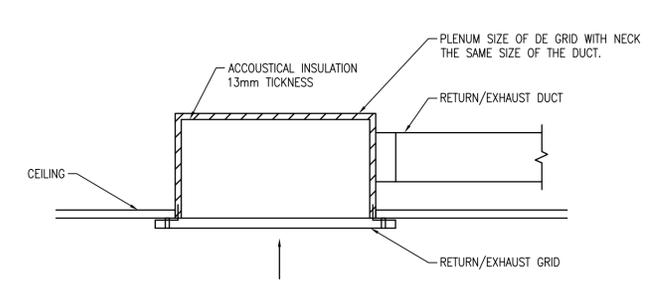

TYPICAL DETAIL – INSTALLATION OF RETURN/EXHAUST GRID
ÉCH : N/A

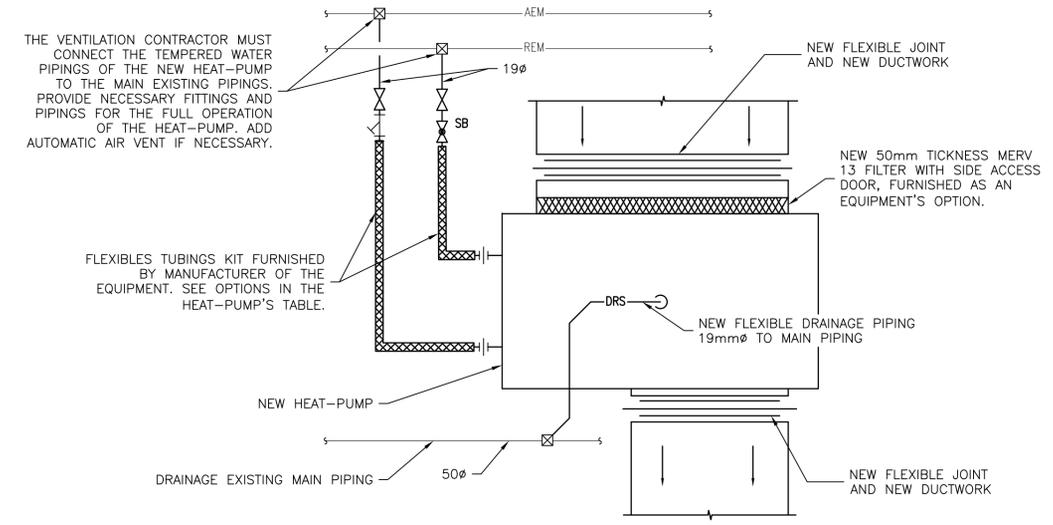


TYPICAL DETAIL – INSTALLATION OF A HEAT-PUMP (T-A6-XX)
ÉCH : N/A

NEW HEAT-PUMPS TABLE

ROOM NUMBERS	IDENTIFICATION ON PLANS	COOLING CAPACITY		HEATING CAPACITY	WATER CIRCUIT		FANS		ELECTRICAL DATA				EER EFFICIENCY	PERFORMANCE COEFFICIENT	OPTIONS	
		ENTERING AIR TEMPERATURE: 19.5°C D.B. / 26.7°C W.B.	WATTS	WATTS	TEMP. D'ENTRÉE D'EAU: 29.5°C TEMP. SORTIE D'EAU: 35°C	FLOW (l/s)	PRESSURE DROP (kPa)	FLOW (l/s)	S.P. (Pa)	VOLTAGE	INPUT POWER (TOTAL)	FANS				COMPRESSOR
			TOTAL	SENSIBLE	TOTAL					WATTS	WATTS	A.E.M.	E.E.R.	C.O.P		
A-507	T-A5-09		6900	4345	10580	0.31	22.2	394	74	208-1-60	1190	90	1110	14.5	5.43	1, 2
A-513	T-A5-06		2800	2107	3600	0.15	14	125	74	208-1-60	700	62.6	720	14.2	5.73	1, 2
A-566	T-A5-02		3500	3297	6400	0.27	22.4	235	74	208-1-60	1190	87.2	1110	14.5	5.43	1, 2
A-566	T-A5-03		6700	5170	9600	0.28	14.8	390	74	208-1-60	1960	236.3	1850	14.6	5.39	1, 2
A-602	T-A6-19		8750	7045	10200	0.28	12.6	425	74	208-1-60	2100	281	2220	15.6	5.99	1, 2
A-602	T-A6-20		8750	7045	10200	0.28	12.6	425	74	208-1-60	2100	281	2220	15.6	5.99	1, 2
A-602	T-A6-XX		1800	1365	2000	0.54	12	120	74	208-1-60	700	58	696	15	4.9	1, 2

- OPTIONS:
- 1- STAINLESS STEEL FLEXIBLES TUBINGS KIT WC/W BALANCING VALVE AND SHUTING VALVE. SELECTED AND SOLD BY THE HEAT-PUMP'S MANUFACTURER.
 - 2- 50mm THICKNESS MERV 13 FILTER WITH SIDE ACCESS DOOR OPTION.

FOR QUOTATION
 THESE DOCUMENTS MUST NOT BE USED
 FOR CONSTRUCTION (OR FABRICATION).

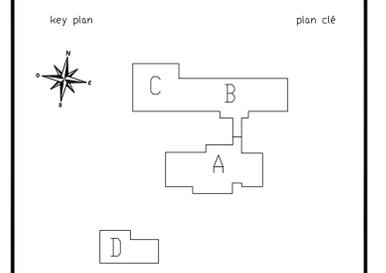

FOR QUOTATION	JD	2019-01-18
Révision	Description	Par/By Date
A	A: Numéro du détail Détail no.	A
C	B: Feuille sur laquelle le détail est référé Location drawing no.	B C
	C: Feuille sur laquelle le détail est dessiné Drawing no.	
Toute modification doit être rapportée à: All modification must be reported to:		
Biens Immobiliers, Environnement, Sécurité et Santé 104, Dalousie, Québec, Qc G1K 7Y7		
Dossier: Fic:		
MONT-JOLI MAURICE-LAMONTAGNE BUILDING RENOVATION GIST/SPC		
Dessiné par: Date		
MECHANICAL VENTILATION TYPICAL DETAILS AND HEAT-PUMP'S TABLE		
Conçu par: Date		
Conçu par: Jessy Devin Date: 2018-05-08		
Dessiné par: Date		
Dessiné par: Jessy Devin Date: 2018-05-08		
Vérifié par: Date		
Vérifié par: Guy Villeneuve, ing. Date: 2018-05-08		
Approuvé par: Date		
Approuvé par: Guy Villeneuve, ing. Date: 2018-05-08		
No. dossier: Fic. no.	F3677-170169	Echelle: Scale
No. dossier: Drawing no.		Indicated
		No. feuille: Sheet no.
		M18 OF 24