


LEVEL 5 - ZONE C
PLAN VIEW
 SCALE: 1:50

DISMANTLING SPECIFIC NOTES:


- 1- EXISTING HEAT PUMP LOCATED ABOVE THE CEILING SPACE TO KEEP. SUPPLY AND RETURN AIR DUCT TO BE DISMANTLED SE ON PLANS.
- 2- HEAT PUMP TO BE DISMANTLED. DISMANTLE PLUMBING ACCESSORIES, TWO FLEXIBLE HOSES TO THE ISOLATION VALVES AND DRAINAGE TO THE MAIN PIPE. DISMANTLE THE DUCTS AS SHOWN ON PLANS. DISMANTLING OF CONTROLS AND ELECTRICAL WIRES MUST BE DONE BY EACH SPECIALIZED CONTRACTORS. THE VENTILATION CONTRACTOR MUST COORDINATE WITH OTHER SPECIALIZED CONTRACTORS BEFORE DISMANTLING THE HEAT-PUMP.
- 3- FRESH AIR SPIRAL DUCT AND FRESH AIR FAN TO KEEP.
- 4- HEAT-PUMP'S CONTROLLER TO BE DISMANTLED BY THE CONTROLS CONTRACTOR, TO BE COORDINATED BEFORE DISMANTLING THE HEAT-PUMP.
- 5- WALL GRID TO DISMANTLE.
- 6- ROOF GRID TO BE DISMANTLED, DUCT TO BE SEALED.
- 9- HEAT-PUMP'S CONTROLLER TO BE RELOCATED BY THE CONTROLS CONTRACTOR, TO BE COORDINATED BEFORE DISMANTLING THE HEAT-PUMP.

IMPORTANT NOTES:

- EVERY DISMANTLED EQUIPMENTS MUST BE RETURN TO THE OWNER. THE CONTRACTOR MUST CLEAN THE DISMANTLED EQUIPMENTS AND PLACE THEM WHERE INDICATED BY THE OWNER.
- THE VENTILATION CONTRACTOR MUST PERFORM FLOW READINGS OF EXISTING VENTILATION UNITS BEFORE DISMANTLING. THE CONTRACTOR MUST PROVIDE, TO THE ENGINEER, A REPORT WITH THE ACTUAL FLOW READINGS.
- THE WORKS MUST BE DONE BY PHASES, THE VENTILATION CONTRACTOR MUST REFER TO THE ARCHITECT'S PHASES PLAN TO KNOW THEIR SCOPE OF WORKS. THE VENTILATION CONTRACTOR IS RESPONSIBLE FOR COMPLIANCE WITH ALL WORKS ACCORDING TO THE PLANS AND SPECIFICATIONS.
- ALL FRESH AIR DUCTS THAT SUPPLY THE HEAT PUMPS MUST BE SEALED DURING WORKS.
- ALL EQUIPMENT AND DUCTWORKS TO BE KEPT LOCATED IN THE WORK AREA MUST BE PROTECTED DURING WORKS.

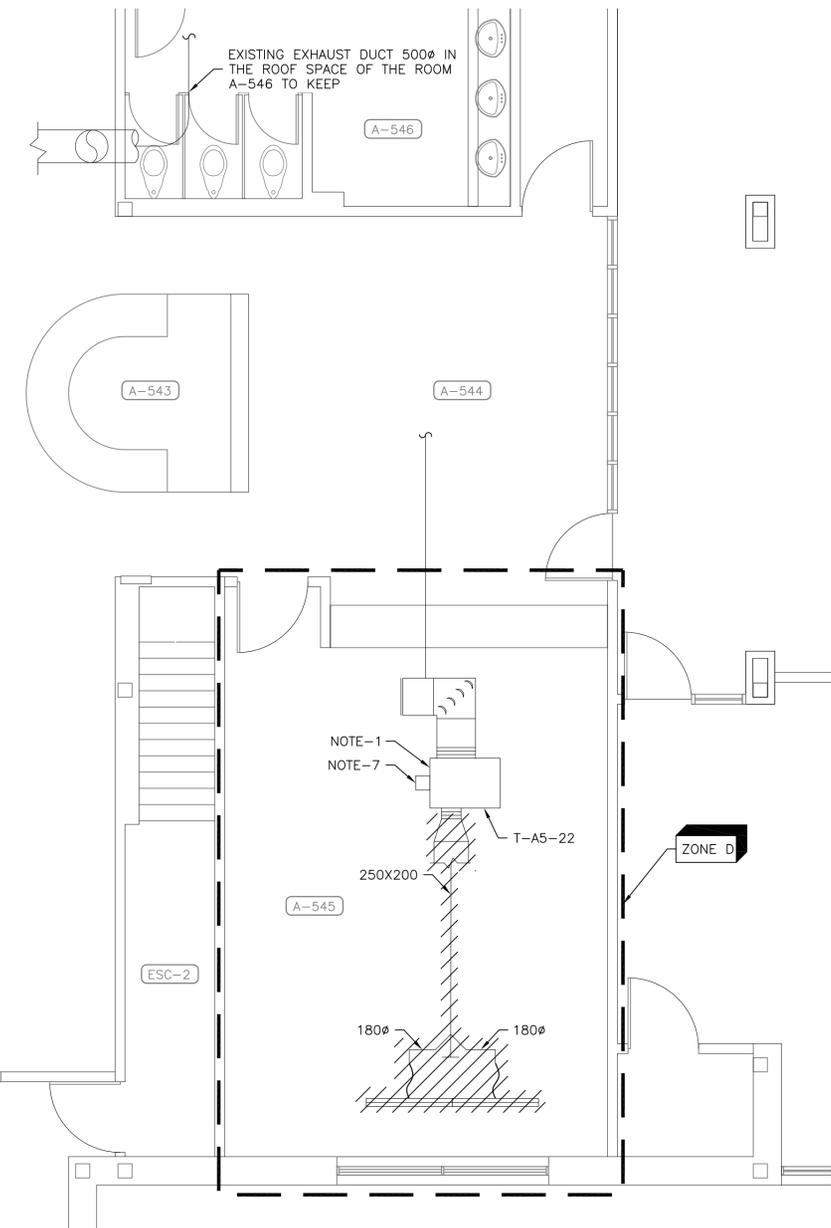

LEVEL 5 - ZONE D
PLAN VIEW
 SCALE: 1:50

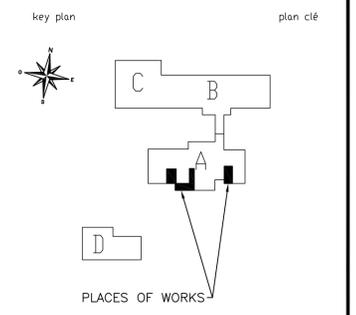

Revisión	Description	Par/By	Date
01	FOR QUOTATION R-01	JD	2019-03-08
02	FOR QUOTATION	JD	2019-01-18

A: Numéro du détail Detail no.	A
B: Feuille sur laquelle le détail est référencé Location drawing no.	B/C
C: Feuille sur laquelle le détail est dessiné Drawing no.	C

Toute modification doit être rapportée à:
All modification must be reported to:

Blens Immobiliers, Environnement, Sécurité et Santé
 104, Dalhousie, Québec, Qc G1K 7Y7

Dossier:
 File:

MONT-JOLI
MAURICE-LAMONTAGNE BUILDING
RENOVATION GIST/SPC

Dessin:
 Drawing:

MECHANICAL
LEVEL 5 - ZONES C AND D
VENTILATION
DISMANTLING

Conçu par: Designed by:	Jessy Devin	Date 2018-05-08
Dessiné par: Drawn by:	Jessy Devin	Date 2018-05-08
Vérifié par: Verified by:	Guy Villeneuve, ing.	Date 2018-05-08
Approuvé par: Approved by:	Guy Villeneuve, ing.	Date 2018-05-08

No. dossier: File no.:	F3677-170169	Échelle: Scale:	Indicated
No. dessin: Drawing no.:		No. feuille: Sheet no.:	M05 OF 24

FOR QUOTATION
 THESE DOCUMENTS MUST NOT BE USED
 FOR CONSTRUCTION (OR FABRICATION).