
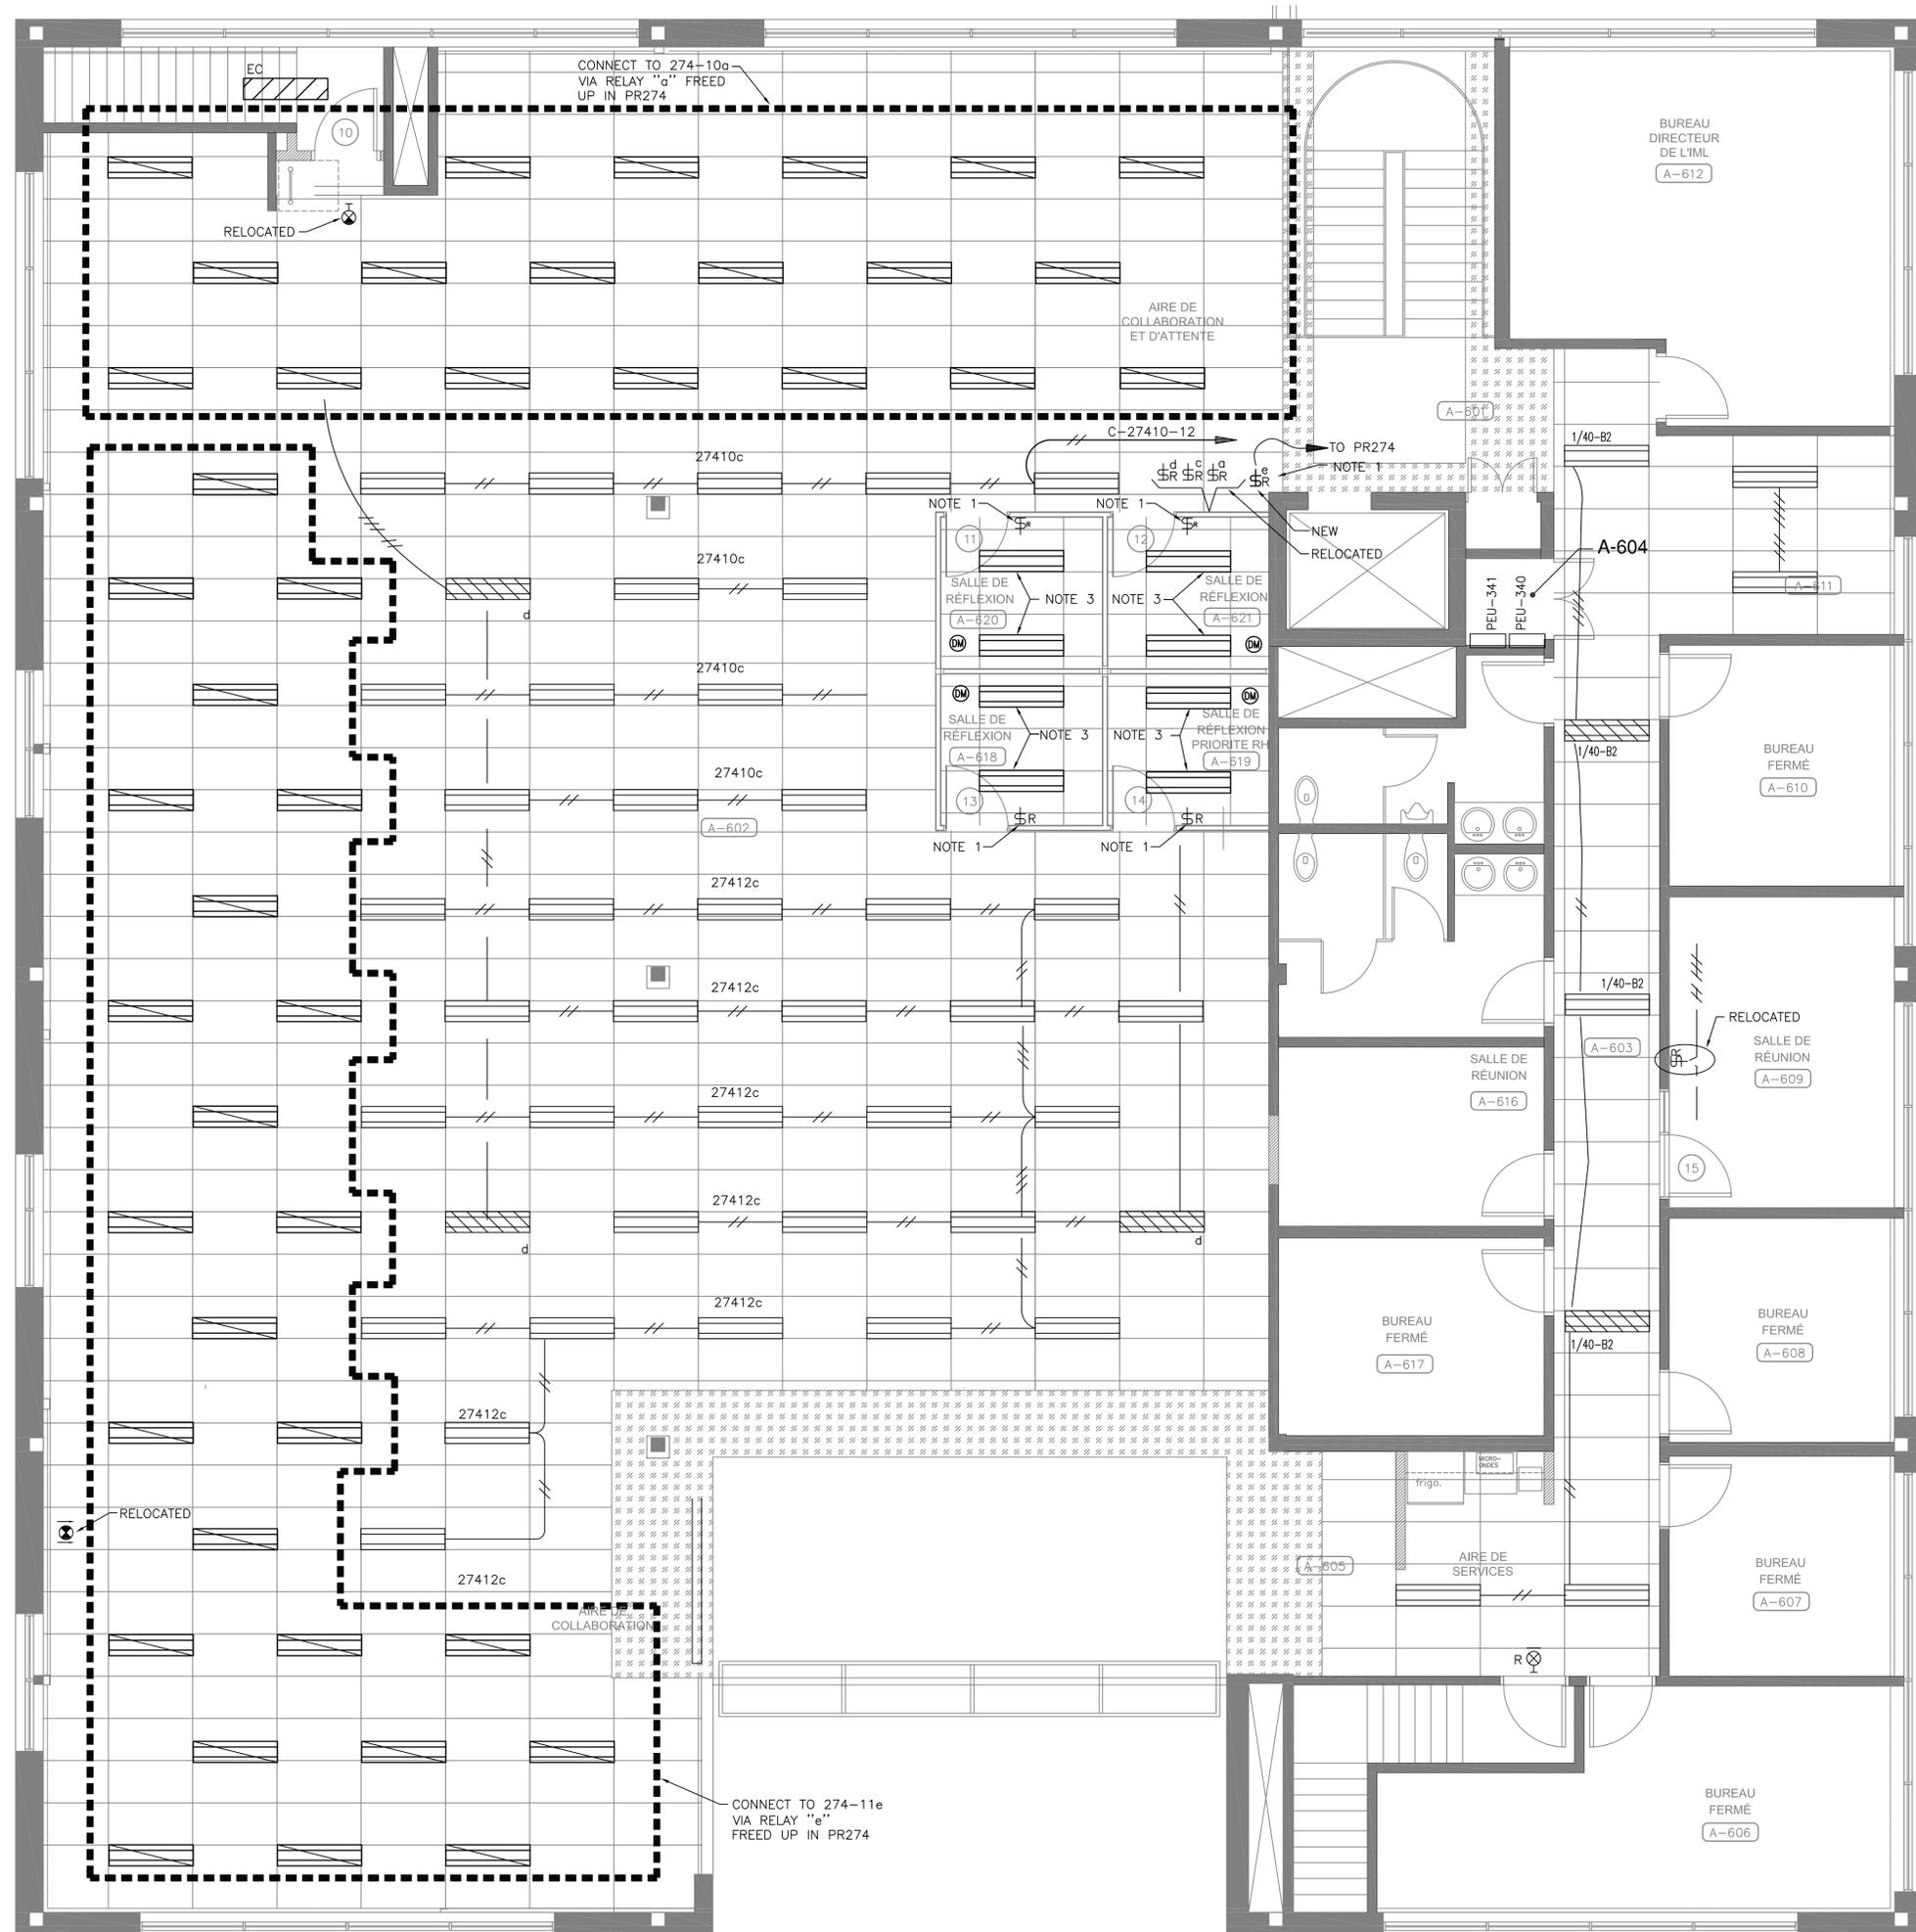


**NOTES**

1. NEW LIGHT SWITCH TOWARDS EXISTING RELAY FREED BY DEMOLITION.
2. FOR EVERY REINSTALLED LIGHT FIXTURE, MAKE SURE TO OBSERVE SEISMIC INSTALLATION GUIDELINES. PROVIDE A SEISMIC INSTALLATION REPORT, SEALED BY AN ACCREDITED ENGINEER.
3. PROVIDE AND INSTALL 2-LAMP T8 FLUORESCENT LIGHT FIXTURE 32W, 347V, WITH ELECTRONIC BALLAST THD>10%.
4. PLAN FOR THE REPLACEMENT OF ALL FLUORESCENT LAMPS F32-T8 4000K FOR ALL EXISTING RELOCATED OR KEPT LIGHT FIXTURES (2 LAMPS PER LIGHT FIXTURE), AS AN OPTIONAL EXTRA COST IN PROPOSAL.

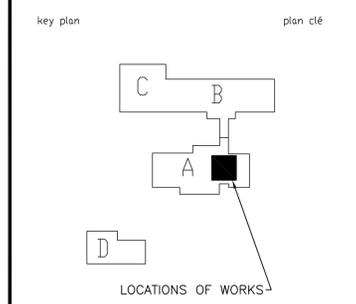

**LEVEL 6  
 PLAN VIEW**  
 SCALE 1:50

FOR TENDER	DG	2019-04-25
FOR TENDER	JMP	2019-01-18

Révision	Description	Par/By	Date
A	Numéro du détail		
B	Feuille sur laquelle le détail est référencé		
C	Feuille sur laquelle le détail est dessiné		

Toute modification doit être rapportée à:  
 All modification must be reported to:

**Biens Immobiliers, Environnement, Sécurité et Santé**  
 104, Dalhousie, Québec, Qc G1K 7Y7

Dossier: **MONT-JOLI**  
 MAURICE-LAMONTAGNE BUILDING  
 RENOVATION GIST/SPC

Dessin: **LIGHTING**  
 RENOVATION OF  
 LEVEL 6, BUILDING A

Conçu par / Designed by:	P-L Jean	Date	2018-03-12
Dessiné par / Drawn by:	J-M Potvin	Date	2018-03-12
Vérifié par / Verified by:	F. Jean	Date	2018-05-08
Approuvé par / Approved by:	P-L Jean	Date	2018-05-08

No. dossier / File no.:	F3766-170169	Echelle / Scale:	Indicated
No. dessin / Drawing no.:		No. feuille / Sheet no.:	E15 OF 19