

GENERAL NOTES:

1. PROVIDE SOUND MASKING THROUGHOUT AREA OF WORK. REFER TO SPECIFICATIONS. INDICATE LOCATIONS ON AS-BUILT DRAWINGS. CONFIRM ACTUAL POWER REQUIREMENTS WITH SOUNDMASKING VENDOR. PROVIDE CIRCUITS TO SUIT IN LOCAL ELECTRICAL PANEL WHICH SERVES THE AREA.

DRAWING NOTES:

- ① INSTALL DEVICE WITHIN MILLWORK.
- ② CONNECT EXHAUST FAN TO LOCAL CO2 SENSOR. COORDINATE WITH MECHANICAL CONTRACTOR.

REVISE DRAWING NOTES

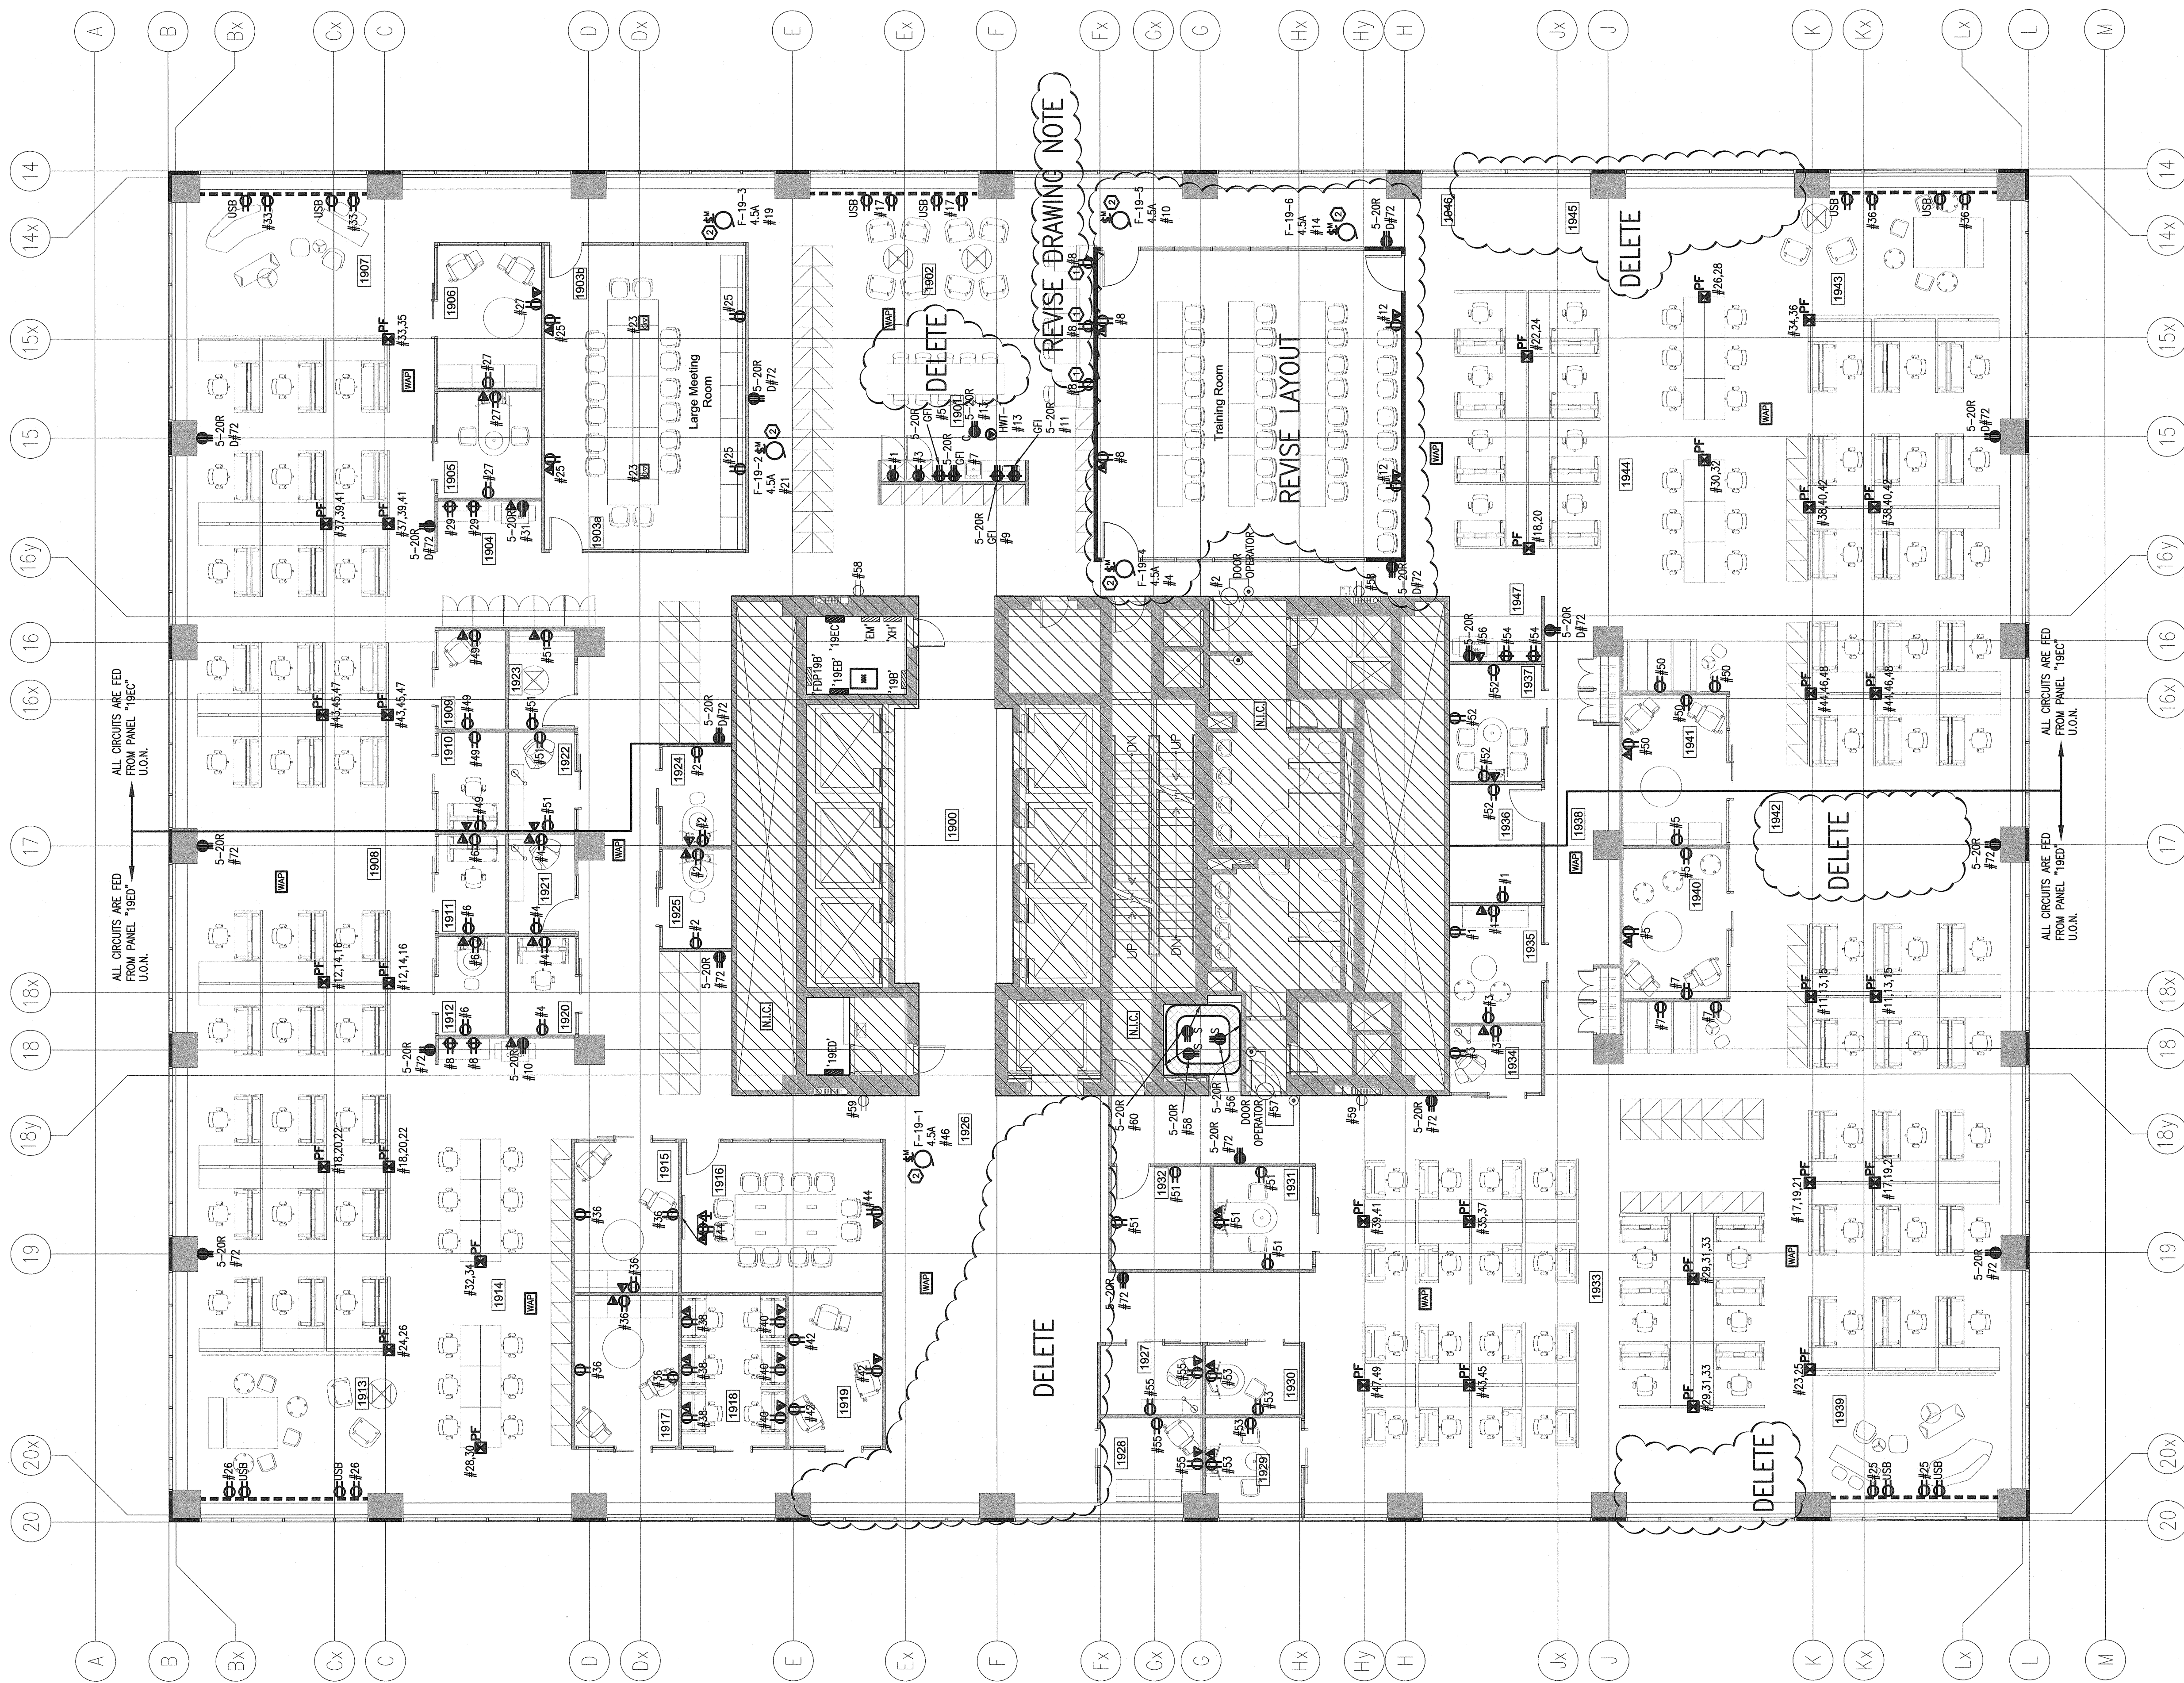
[illegible][illegible]

Contractor to verify all dimensions & conditions on site and immediately notify the engineer of all discrepancies.

	G4	Issued for Addendum E001	2017-06-01
	O3	Issued for Tender	2017-07-15
	O2	Issued for 98% Client Review	2018-03-08
	O1	Issued for 66% Client Review	2018-02-16

Generic Swing Space at LEL West Tower

**ELECTRICAL:
DOOR - POWER AND
SYSTEMS**

[illegible]

1 19TH FLOOR – POWER AND SYSTEMS
E-5 1:100