



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS À:

Bid Receiving Public Works and Government
Services Canada/Réception des soumissions Travaux
publics et Services gouvernementaux Canada
800 Burrard Street, Room 219
800, rue Burrard, pièce 219
Vancouver
British Columbia
V6Z 0B9
Bid Fax: (604) 775-9381

**SOLICITATION AMENDMENT
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise
indicated, all other terms and conditions of the Solicitation
remain the same.

Ce document est par la présente révisé; sauf indication contraire,
les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works and Government Services Canada - Pacific
Region
800 Burrard Street, Room 219
800, rue Burrard, pièce 219
Vancouver
British C
V6Z 0B9

Title - Sujet CCG Modular Building Construction	
Solicitation No. - N° de l'invitation F1700-195552/A	Amendment No. - N° modif. 005
Client Reference No. - N° de référence du client F1700-195552	Date 2019-08-21
GETS Reference No. - N° de référence de SEAG PW-\$PWY-031-8623	
File No. - N° de dossier PWY-9-42034 (031)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2019-08-23	
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Leung, Janie	Buyer Id - Id de l'acheteur pwy031
Telephone No. - N° de téléphone (778) 919-3273 ()	FAX No. - N° de FAX (604) 775-6633
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction: DFO - Hartley Bay, BC	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Solicitation No. - N° de l'invitation
F1700-195552A

Amd. No. - N° de la modif.
005

Buyer ID - Id de l'acheteur
XXXXX

Client Ref. No. - N° de réf. du client
XXXXX

File No. - N° du dossier
XXXXXXXXXXXXX

CCC No./N° CCC - FMS No./N° VME
XXXXXXXXXXXXX

Amendment 005

This amendment issued to publish Addendum #4

Addendum #4 dated 2019-08-20 attached.

All other terms and conditions remain unchanged.

*The following changes in the Tender Documents are effective IMMEDIATELY.
This addendum will form part of the Contract Documents*

Amend/revise the Standard Contract Documents as follows:

Contractor Questions

Question: I cannot locate the value of the float for insurance during transit.

Response: The value of the float for insurance purposes is \$1,000,000.00.

Question: Can you please confirm when the concrete float will be available for pickup?

Response: The float will be available for pickup on October 31, 2019.

Question: My electrical sub has noted that the electrical drawings indicate that there is work to be done in Hartley Bay. It is our understanding that the concrete float and SAR station are to be delivered to Steveston and that there is no work taking place in Hartley Bay itself. Please clarify.

Response: No work is to take place in Hartley Bay.

Electrical hookup to shore shown and any shore work as shown on E1.01 are not part of contract. Power and communications service from shore to termination point in building not part of this contract.

However, temporary power and communications hookup for the purpose of testing and commissioning is to be provided as per Spec section 01 11 55.

ELECTRICAL

Refer to Electrical Drawings:

1. Drawing E1.00, E1.01.

See items noted as Not in Contract (NIC)

End of Addendum



3	16/07/27	APPROVED E-1
2	19/04/29	ISSUED FOR PERMITS REVIEW
1	19/03/18	ISSUED FOR 50% OPERATIVE BUILDING
REV	DATE	DESCRIPTION
1		ISSUED FOR 50% OPERATIVE BUILDING

**FISHERIES AND OCEANS,
REAL PROPERTY
SAFETY AND SECURITY**
VANCOUVER, BC
200-401 BURRARD ST.

Project name/Title de projet
HARTLEY BAY, B.C.
HARTLEY BAY
SAR STATION

REVISION	DATE	DESCRIPTION


Project No./No. de projet: 2017566
Sheet/Feuille: E1.01
REV 4 OF 4

LUMINAIRE SCHEDULE:


- TYPE A - RECESSED CEILING DOWN LIGHT FIXTURES AND RECESSED DOWNLIGHT FIXTURES WITH 2" AND 4" HOLES.
- TYPE B - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 4" HOLES.
- TYPE C - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 2" HOLES.
- TYPE D - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 4" HOLES.
- TYPE E - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 2" HOLES.
- TYPE F - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 4" HOLES.
- TYPE G - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 2" HOLES.
- TYPE H - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 4" HOLES.
- TYPE I - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 2" HOLES.
- TYPE J - SURFACE MOUNTED DOWNLIGHT FIXTURES WITH 4" HOLES.

ROOF FLOOR FINISH	10
ROOF FLOOR SLAB	10
ROOF FLOOR CONCRETE	10
ROOF FLOOR MECHANICAL	10
ROOF FLOOR ELECTRICAL	10
ROOF FLOOR PLUMBING	10
ROOF FLOOR FINISH	10
ROOF FLOOR CONCRETE	10
ROOF FLOOR MECHANICAL	10
ROOF FLOOR ELECTRICAL	10
ROOF FLOOR PLUMBING	10
ROOF FLOOR FINISH	10
ROOF FLOOR CONCRETE	10
ROOF FLOOR MECHANICAL	10
ROOF FLOOR ELECTRICAL	10
ROOF FLOOR PLUMBING	10


- SECURITY ZONES:**
- SECURITY 1 -
 - SECURITY 2 -
 - SECURITY 3 -
 - SECURITY 4 -

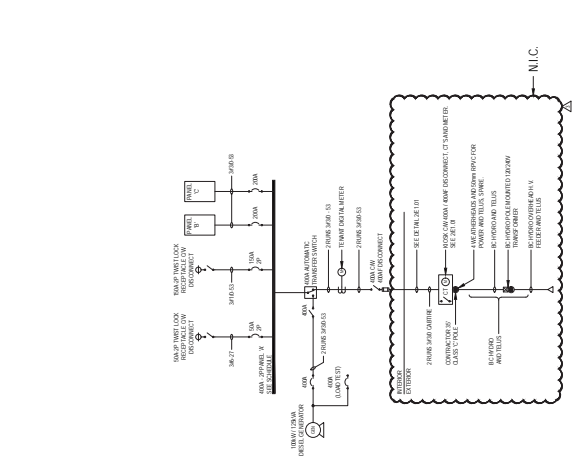


1 SINGLE LINE DIAGRAM
400A-120/240V 1PH 3W SERVICE
NOT TO SCALE
E1.01

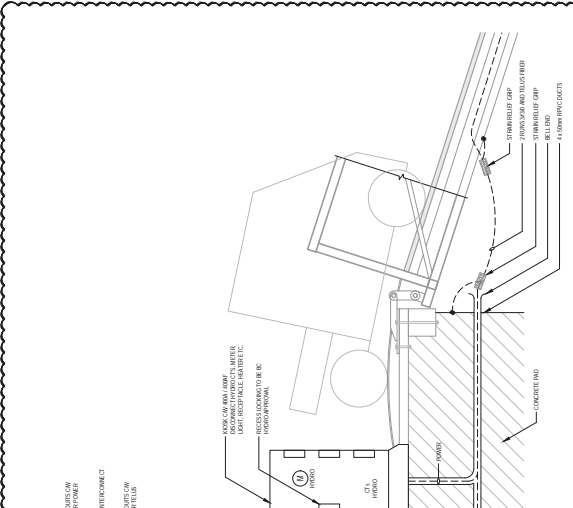


2 RAMP AT GRADE
E1.02

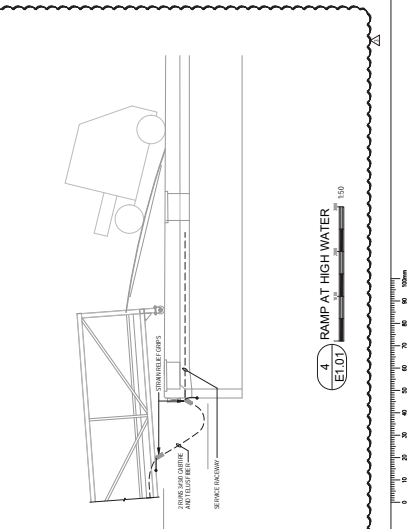

3 RAMP AT HIGH WATER
E1.03

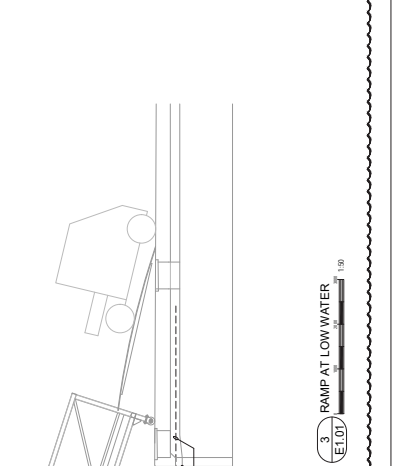

4 RAMP AT LOW WATER
E1.04

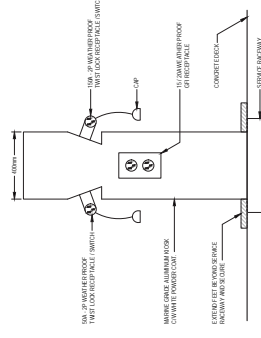

5 RECEPTACLE NOOK
E1.05

