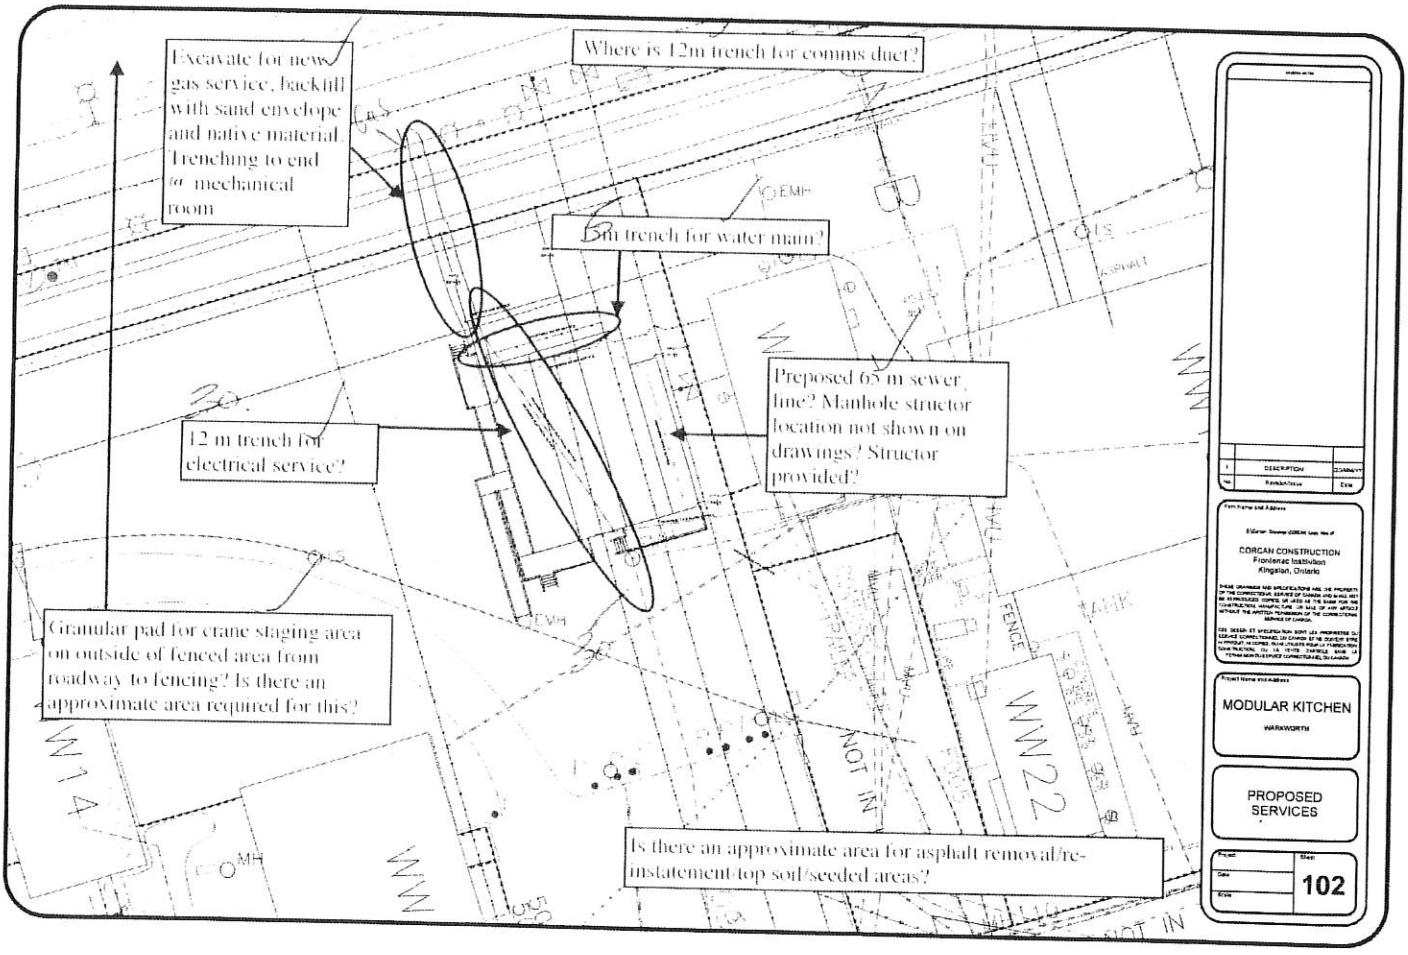
Excavate for new gas service, backfill with sand envelope and native material Trenching to end @ mechanical room
Where is 12m trench for comms duct?
8m trench for water main?
Preposed 65 m sewer line? Manhole structor location not shown on drawings? Structor provided?
12 m trench for electrical service?
Granular pad for crane staging area on outside of fenced area from roadway to feneing? Is there an approximate area required for this?
Is there an approximate area for asphalt removal/re-instatement/top soil/seeded areas?
CORGAN CONSTRUCTION
Frontenac Institution
Kingston, Ontario
MODULAR KITCHEN
WARKWORTH
PROPOSED SERVICES
102