


# GENERAL NOTES

1. ALL EXISTING LIGHTING, SWITCHES, RECEPTACLES, THERMOSTATS, CONTACTORS, DISCONNECTS, MAIN SWITCHGEAR, DISTRIBUTION PANEL BOARDS, LIGHTING PANEL BOARDS, DRY TYPE DISTRIBUTION TRANSFORMERS, RELAYS, ALL FIRE ALARM SYSTEM COMPONENTS INCLUDING MAIN FIRE ALARM PANEL, EXIT SIGNS, EMERGENCY LIGHTING AND THEIR BATTERY UNITS AS WELL AS ABANDONED CONDUIT AND WIRING TO BE REMOVED FROM SITE, AND REPLACED WITH NEW UNLESS INDICATED OTHERWISE.
2. ALL EXISTING DISCONNECTS, MOTOR STARTERS AND SPEED CONTROLLERS FOR EXISTING MECHANICAL EQUIPMENT TO BE REMOVED AND REPLACED WITH NEW.
3. THESE DRAWINGS REASONABLY REPRESENT EXISTING CONDITIONS. ACTUAL CONDITIONS MAY DEVIATE FROM THAT SHOWN/IDENTIFIED ON THE DRAWINGS. THE CONTRACTOR SHALL VERIFY ACTUAL CONDITIONS, CHECK ALL DIMENSIONS, AND VERIFY MATERIALS REQUIRED TO COMPLETE THIS WORK. CONTRACTOR SHALL INFORM THE ENGINEER/PROJECT MANAGER OF ANY DISCREPANCIES PRIOR TO COMMENCING WORK.
4. REMOVE FROM SITE DEMOLISHED MATERIALS, DEBRIS, AND RUBBISH. DISPOSE DEMOLISHED MATERIALS AS PER THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
5. THE CONTRACTOR IS RESPONSIBLE FOR TEMPORARY REMOVAL/RELOCATION OF ELECTRICAL SYSTEMS WHICH INTERFERE WITH COMPLETING THE REPAIR WORK INDICATED ON THE DRAWINGS. ELECTRICAL SYSTEMS TO BE REINSTATED ONCE REPAIR WORK IS COMPLETE. ALL WORK MUST BE COMPLETED IN ACCORDANCE WITH ALL APPLICABLE BUILDING CODES INCLUDING THE NATIONAL FIRE CODE (CSA CAN 5537) AND THE CSA C92. ALL WORK MUST BE COMPLETED BY LICENSED TRADES PEOPLE.
6. COMPLETE ALL WORK IN ACCORDANCE WITH THE NATIONAL BUILDING CODE OF CANADA (LATEST EDITION) AND THE CANADIAN ELECTRICAL CODE (LATEST EDITION).
7. THIS DEMOLITION PLAN IS MEANT TO BE A CONVENIENCE TO THE CONTRACTOR. CONTRACTOR IS RESPONSIBLE FOR ALL DEMOLITION AND REINSTATEMENT NECESSARY FOR THE INSTALLATION OF THE NEW WORK WHETHER SHOWN HERE OR NOT.

# GENERAL NOTES

8. ALL BUILDING ELECTRICAL AND COMMUNICATION SYSTEMS IS TO REMAIN OPERATIONAL DURING DEMOLITION AND CONSTRUCTION.
9. ALL ITEMS TO BE COORDINATED WITH ARCHITECTURAL, STRUCTURAL, MECHANICAL, AND CIVIL DRAWINGS AND SPECIFICATIONS BY CONTRACTOR.
10. EXECUTE WORK BY METHODS TO AVOID DAMAGE TO OTHER EXISTING COMPONENTS AND FINISHES WHERE POSSIBLE.
11. ALL EXISTING ABANDONED CONDUIT AND WIRING TO BE REMOVED FROM SITE.
12. ALL EXISTING MECHANICAL EQUIPMENT TO REMAIN. DISCONNECT SUCH EQUIPMENT FROM EXISTING BRANCH CIRCUIT BREAKER PANEL BOARD, RECONNECT TO NEW BRANCH CIRCUIT BREAKER IN NEW PANEL BOARD. BREAKER SIZE TO MATCH PREVIOUS BREAKER RATING.
13. THE ELECTRICAL CONTRACTOR SHALL OBTAIN ALL PERMITS AND INSPECTIONS REQUIRED BY LAW, ORDINANCES, RULES AND REGULATIONS OF PUBLIC AUTHORITIES HAVING JURISDICTION, AND SHALL OBTAIN CERTIFICATES ON SUCH INSPECTIONS AND SUBMIT SAME AND PAY ALL CHARGES IN CONNECTION THEREWITH.
14. THE ELECTRICAL CONTRACTOR IS TO COORDINATE WITH MECHANICAL AND ARCHITECTURAL DRAWINGS TO ASCERTAIN WHAT EXISTING EQUIPMENT AND DEVICES ARE TO BE TEMPORARILY REMOVED TO ACCOMMODATE THE REMOVAL OF EXISTING SEWING AND ROOF COVERING. INCLUDE IN TENDER THE COST FOR DISCONNECTING ELECTRICAL POWER FROM SUCH EQUIPMENT AND DEVICES AND THE FUTURE RECONNECTION ONCE ARCHITECTURAL AND MECHANICAL WORK IS COMPLETED.
15. REROUTE EXISTING WIRE AND CONDUIT TO NEW LOCATION OF DEVICES DUE TO DOOR RELOCATION.
16. ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL ALL WIRING, CONDUIT AND ASSOCIATED EQUIPMENT FOR THE CONTROL OF ALL MECHANICAL HYDRONIC HEATING FIXTURES. COORDINATE EXACT LOCATIONS AND REQUIREMENTS WITH MECHANICAL CONTRACTOR.

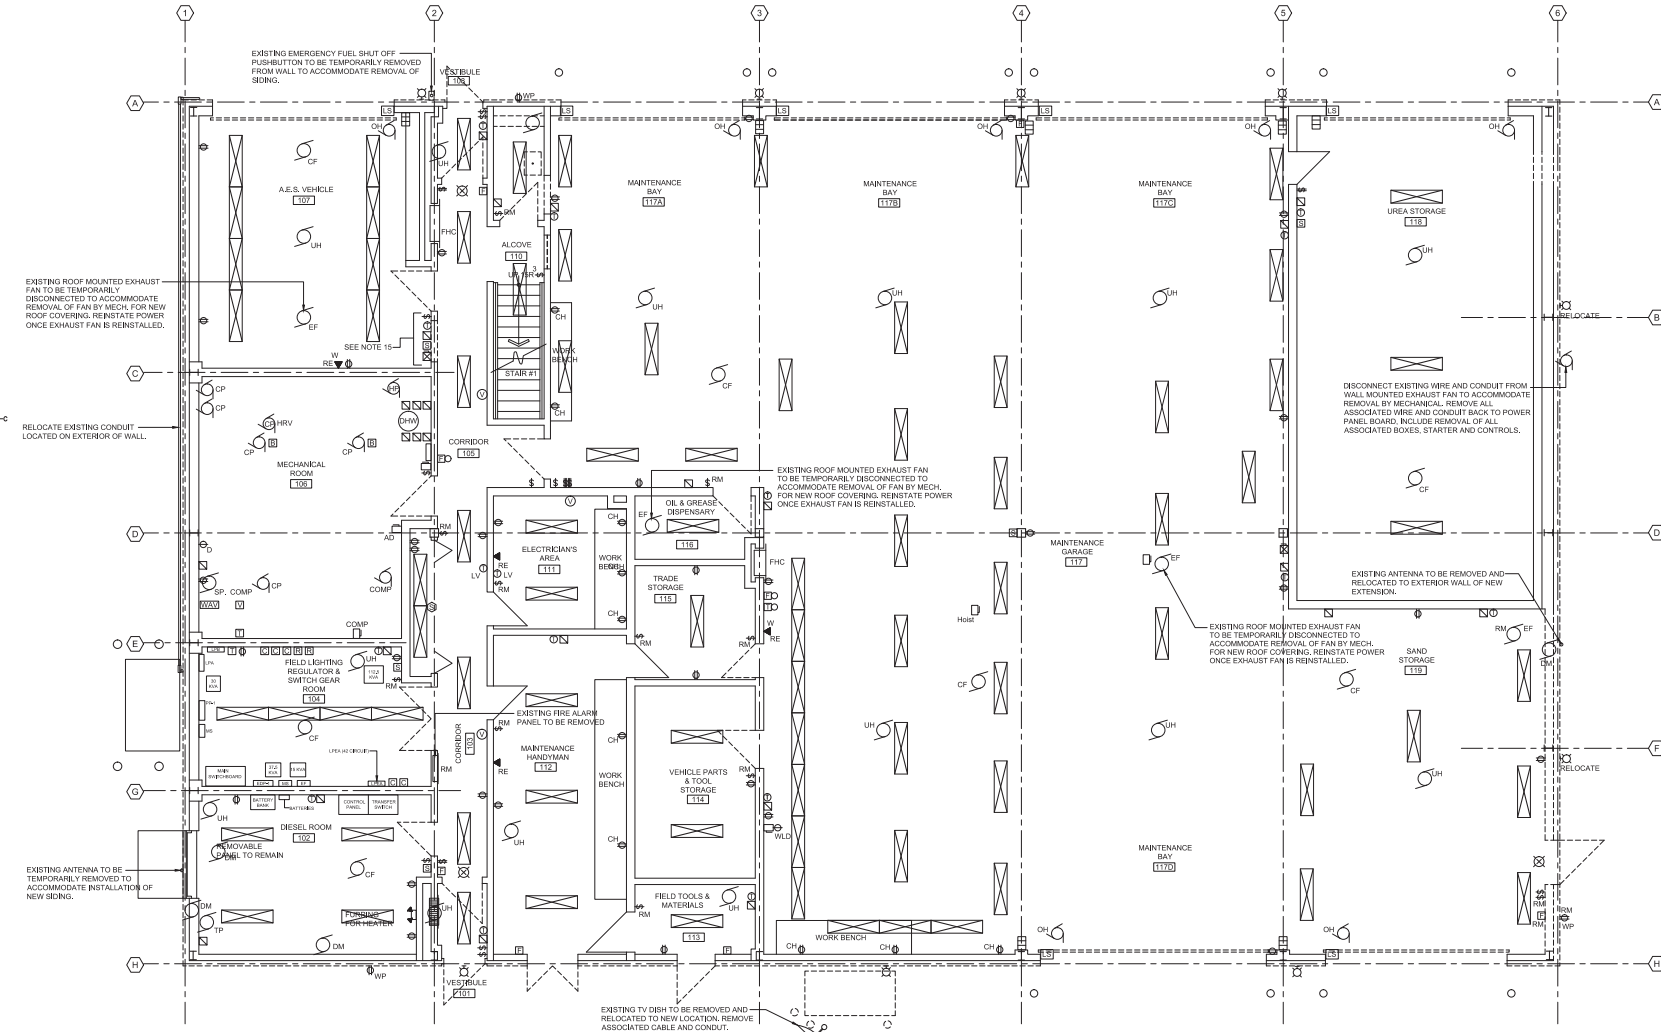

LEVEL ONE EXISTING/DEMOLITION FLOOR PLAN

SCALE: 1:50

1

E2



CO3	ISSUED FOR TENDER	06/30/2019
CO2	RE-ISSUED FOR TENDER	02/14/2019
CO1	ISSUED FOR TENDER	09/28/2018

revisions project

**MAINTENANCE GARAGE REHABILITATION ST. ANTHONY AIRPORT**

drawing

**EXISTING/DEMOLITION ELECTRICAL FLOOR PLAN LEVEL 1**

designed	G.N.S.	comp
date	2017.07.17	
drawn	G.N.S.	des
date	2017.07.17	
approved	K.S.	app
date	2017.07.17	
tender		sc
PROJEC Project Manager	Administrateur de projets TPSC	
project number	no. du projet	
	<b>R.077269.001</b>	
drawing no.	no. du dessin	
	<b>E2</b>	