


LEGEND			
DOWNLIGHT		EMERGENCY DOWNLIGHT	
READING LIGHT (INTERNALLY SWITCHED)		DESK LIGHT (INTERNALLY SWITCHED)	
LIGHTSWITCH (ON/OFF)		LIGHTSWITCH WITH DIMMER	
DUPLEX RECEPTACLE		GFCI RECEPTACLE (DUPLEX)	
DUPLEX RECEPTACLE WITH USB		NETWORK RECEPTACLE	
TELEPHONE RECEPTACLE		JUNCTION BOX	
TV COAX OUTLET			

NOTES:

- DIMMER SWITCH AT DOOR OF EACH STATEROOM IS CONNECTED TO OVERHEAD LIGHTS
- DIMMER SWITCH IN BATHROOM CONNECTED TO OVERHEAD LIGHTS
- READING LIGHT ON SEPARATE CIRCUIT (INTEGRAL SWITCH ON FIXTURE)
- DESK LIGHT ON SEPARATE CIRCUIT (INTEGRAL SWITCH ON FIXTURE)
- GFCI OUTLET AT VANITIES
- RECEPTACLES ARE DUPLEX WITH USB CHARGING PORTS IN CABINS AT DESKS AND BERTHS
- RECEPTACLES ARE PLAIN DUPLEX AT TV'S APPLIANCES AND GENERAL UTILITY OUTLETS
- FINAL LIGHTING LAYOUT AND CEILING PANEL ARRANGEMENT BY BUILDER
- REFER TO 1146-4-400-01 ONE LINES FOR AC WIRING DETAILS
- REFER TO 1146-4-406-02 NETWORKING FOR NETWORK WIRING DETAILS
- REFER TO 1146-4-408-01 PBX AND PA FOR COMMUNICATIONS WIRING DETAILS
- EMERGENCY LIGHTS WIRED TO EXISTING EMERGENCY LIGHTING SYSTEM
- OUTLET WIRING NOT SHOWN FOR CLARITY. INSTALLER TO FOLLOW PROPER INSTALLATION PROCEDURES AND WIRE ACCORDINGLY.

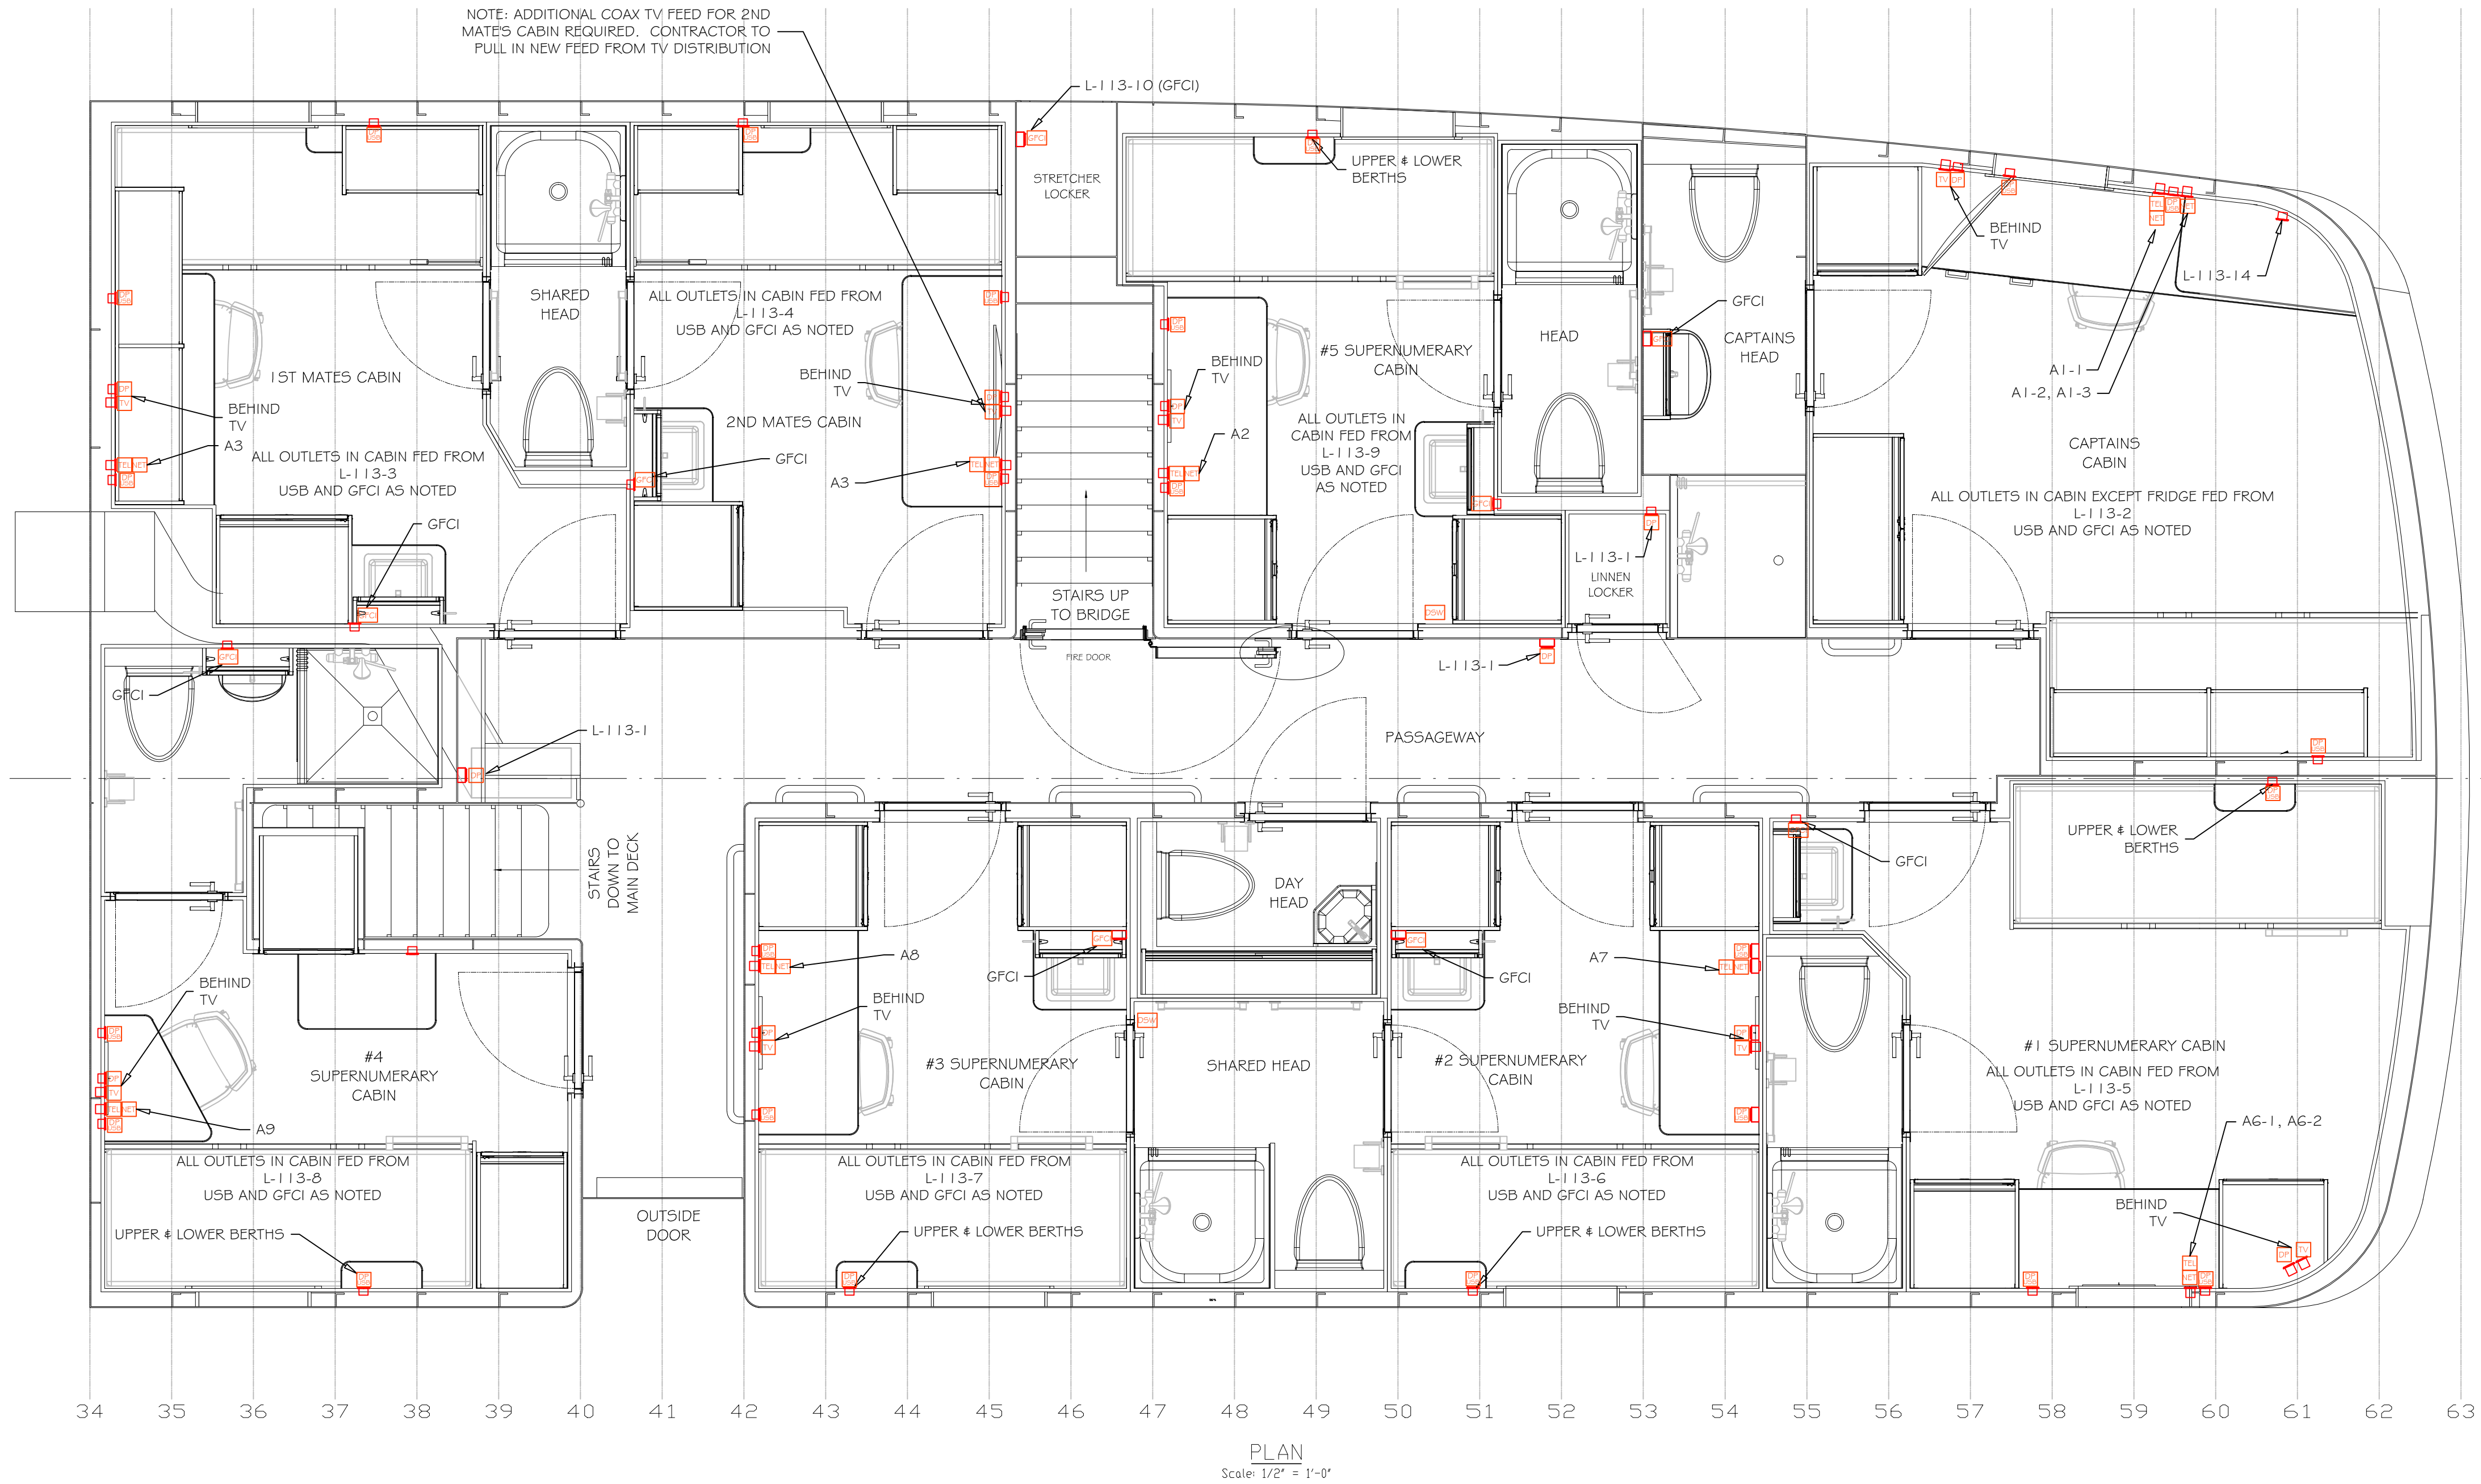

PLAN  
Scale: 1/2" = 1'-0"

OUTLETS

ISSUED : APR 24, 2018	DRAWING BY : MD	SCALE : 1" = 1'	CHECKED BY : MD
REVISION DATE			
REVISION			

CCG VECTOR  
FOC'SLE DECK

SHEET# 1/2	1146-4-407-01 FOC'SLE DECK OUTLETS, SWITCHES AND LIGHTS	REV -
------------	--	-------



LEGEND			
DOWNLIGHT		EMERGENCY DOWNLIGHT	
READING LIGHT (EXTERNALLY SWITCHED)		DESK LIGHT (EXTERNALLY SWITCHED)	
LIGHTSWITCH (ON/OFF)		LIGHTSWITCH WITH DIMMER	
DUPLEX RECEPTACLE		GFCI RECEPTACLE (DUPLEX)	
DUPLEX RECEPTACLE WITH USB		NETWORK RECEPTACLE	
TELEPHONE RECEPTACLE		JUNCTION BOX	
TV COAX OUTLET			

- NOTES:
1. DIMMER SWITCH AT DOOR OF EACH STATEROOM IS CONNECTED TO OVERHEAD LIGHTS
  2. DIMMER SWITCH IN BATHROOM CONNECTED TO OVERHEAD LIGHTS
  3. READING LIGHT ON SEPARATE CIRCUIT (INTEGRAL SWITCH ON FIXTURE)
  4. DESK LIGHT ON SEPARATE CIRCUIT (INTEGRAL SWITCH ON FIXTURE)
  5. GFCI OUTLET AT VANITIES
  6. FINAL LIGHTING LAYOUT AND CEILING PANEL ARRANGEMENT BY BUILDER IN CONJUNCTION WITH REFLECTED CEILING PLANS
  9. REFER TO 1146-4-400-01 ONE LINES FOR AC WIRING DETAILS
  10. EMERGENCY LIGHTS WIRED TO EXISTING EMERGENCY LIGHTING SYSTEM
  11. WIRING PATHS SHOWN ARE FOR REFERENCE ONLY. ACTUAL WIRING TO BE DETERMINED ON-SITE BASED UPON EQUIPMENT AND CONNECTORS USED



SWITCHES AND LIGHTING

ISSUED : APR 25, 2018	DRAWING BY : MD	SCALE : 1/4" = 1'	CHECKED BY : MD
REVISION DATE			
REVISION			

CCG VECTOR  
FOC'SLE DECK

SHEET# 2/2	1146-4-405-01 FOC'SLE DECK OUTLETS, SWITCHING AND LIGHTS	REV -
APPROVED BY		