

PP-11944
10/29/2019

NORR

2300, 411 1st Street SE,
Calgary, Alberta, Canada T2G 4Y5
norr.com

NORR ARCHITECTS ENGINEERS PLANNERS
A Partnership of Limited Companies

Victor Smith, Architect, AAA, B.Arch, M.A.S.C.
Bruce McKenzie, Architect, AAA, B.Arch, M.A.S.C.
A. Shih Siddiqui, Architect, AAA, B.Arch, M.A.S.C.
Ariyan Torkella, P.Eng., A.P.E.G.A.
Chris Pat, P.Eng., A.P.E.G.A.

Revision	Description	Date
4	ISSUED FOR CONSTRUCTION	2019/10/29
3	ISSUED FOR 90% REVIEW	2019/08/29
2	ISSUED FOR 60% REVIEW	2019/05/09
1	ISSUED FOR 30% REVIEW	2019/03/14

Client: PSPC

10025 JASPER AVE
EDMONTON, ALBERTA, T5J 1S6
PH. 780-919-9445

Project Title: JASPER STAFF HOUSING CONSTRUCTION

5 PLEX
902 PATRICIA STREET
JASPER, AB, T0E 1E0

Designed by: H. HUANG / Conçu par

Drawn by: D. GREGOIRE / Dessiné par


Approved by: T. HIRES / Approuvé par

PWSC Project Manager / Administrateur de Projets TPSCC
ROB HAFER

Drawing Title: SECOND FLOOR HEATING PLAN / Titre du dessin

SECOND FLOOR HEATING PLAN

Project no./No. du projet	Drawing no./No. du dessin	Revision no.
R.100429.001	M4.2 OF	4

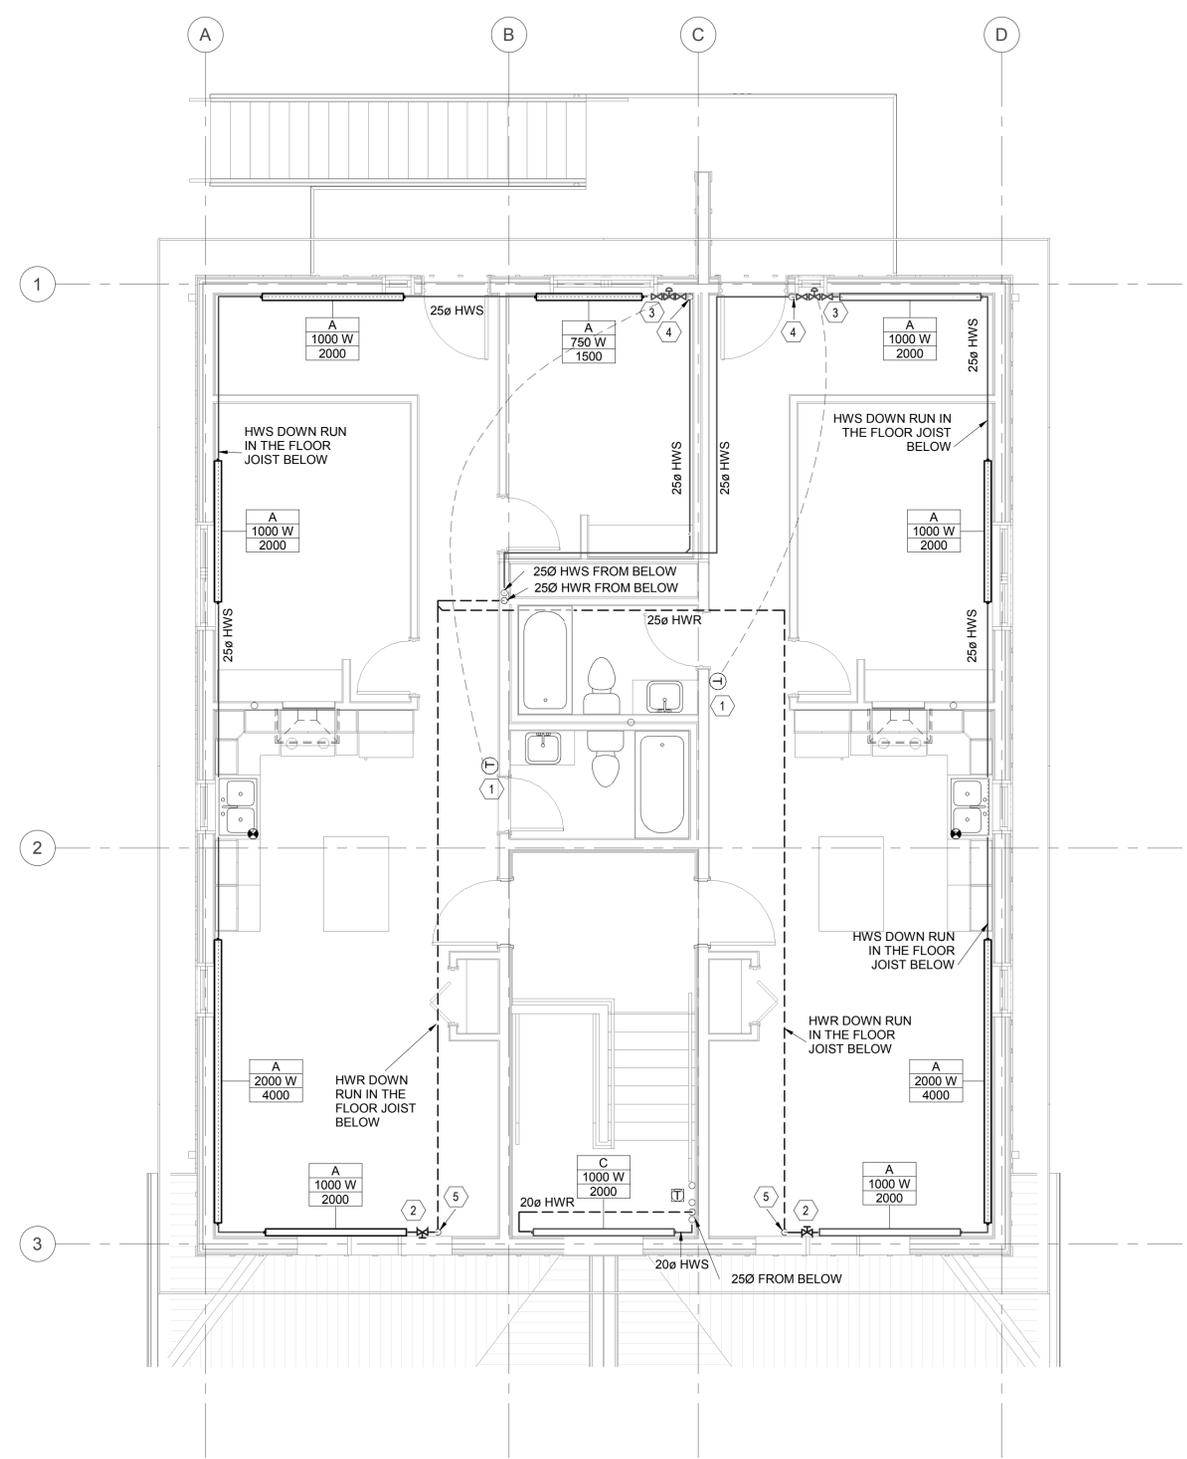

1 SECOND LEVEL HEATING PLAN
M4.2 SCALE: 1:50

GENERAL NOTES:

- A. ALL HWS AND HWR SHALL BE 20Ø OR OTHERWISE NOTED.
- B. PROVIDE RADIATION CABINET FOR HEATING PIPING AS INDICATED.
- C. AIR TRAP TO BE PROVIDED AS REQUIRED.
- D. CONTRACTOR TO COORDINATE WITH JOIST MANUFACTURER REGARDING THE LOCATION OF PIPE PENETRATION THROUGH THE JOIST PRIOR TO CONSTRUCTION.

KEYNOTES:

- 1. MOUNT THERMOSTAT @ 1500 MM A.F.F. TYP. PROVIDE LOCKABLE COVER FOR THERMOSTATS IN PUBLIC AREA.
- 2. CIRCUIT BALANCING VALVE AT 0.20L/S TO BE INSTALLED INSIDE THE BASEBOARD CABINET.
- 3. CONTRAL VALVE AND ISOLATION VALVE TO BE INSTALLED INSIDE THE BASEBOARD CABINET.
- 4. HWS UP FROM JOIST TO BASEBOARD CABINET.
- 5. HWR DOWN RUN IN THE FLOOR JOIST BELOW.

