



# TENDER

NOT FOR CONSTRUCTION


- NOTE:**
- CONDENSATE VENT TO BE FIELD ROUTED OUTSIDE TO AN APPROPRIATE LOCATION.
  - PIPING INSULATION IS NOT SHOWN FOR CLARITY. PIPING TO BE INSULATED AS PER SPECIFICATION.
  - ALL 20mm NIPPLES TO BE 100mm MINIMUM LENGTH.
  - ALL 65mm NIPPLES TO BE 150mm MINIMUM LENGTH.

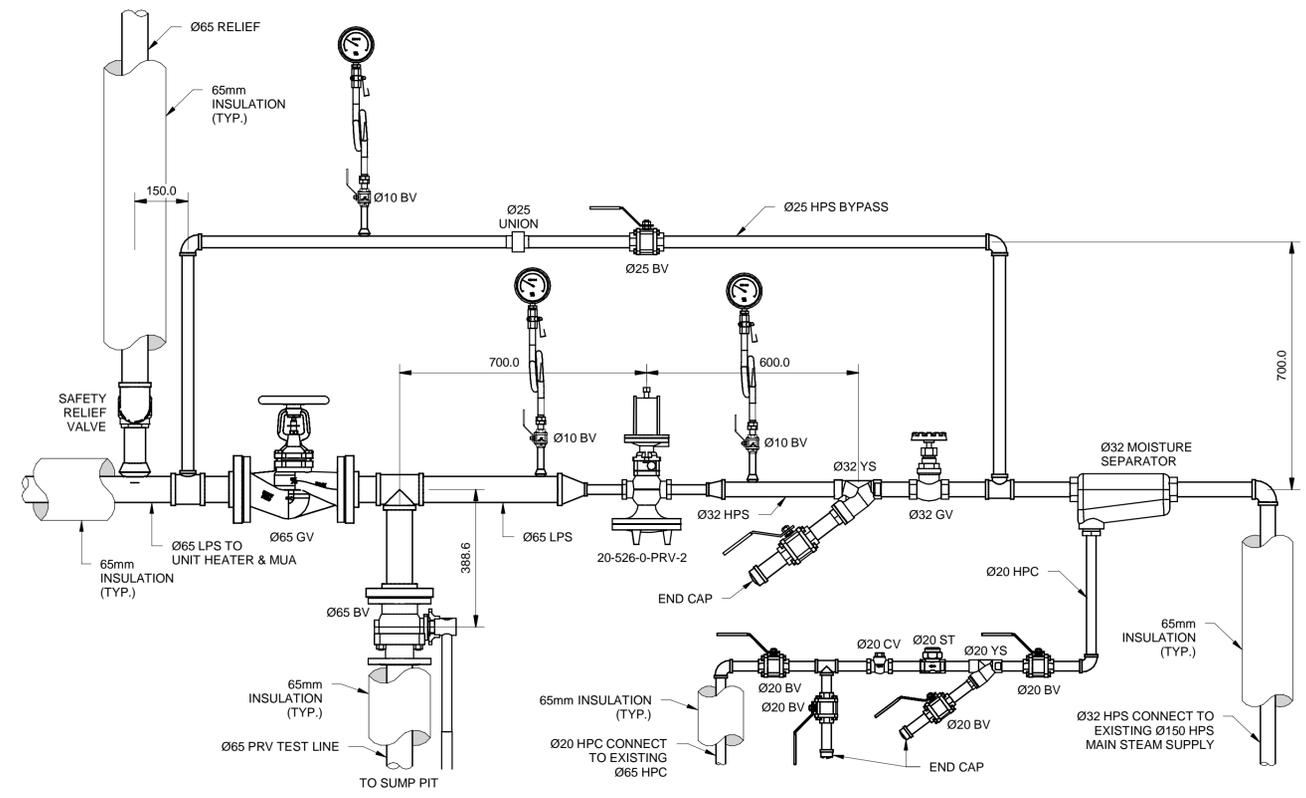


**1 TBU43+000 - STEAM REDUCING STATION**  
M1.11 Scale: 1 : 10

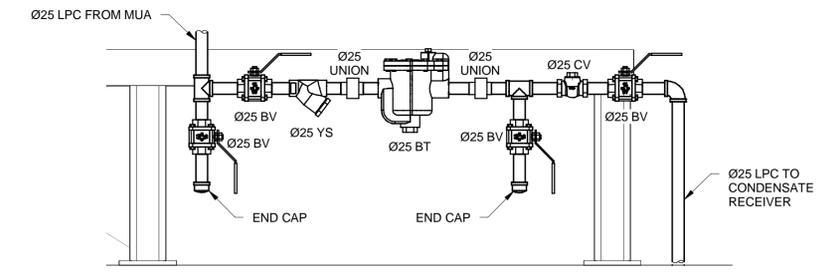

**2 TBU43+000 - MUA CONDENSATE STATION**  
M1.11 Scale: 1 : 10

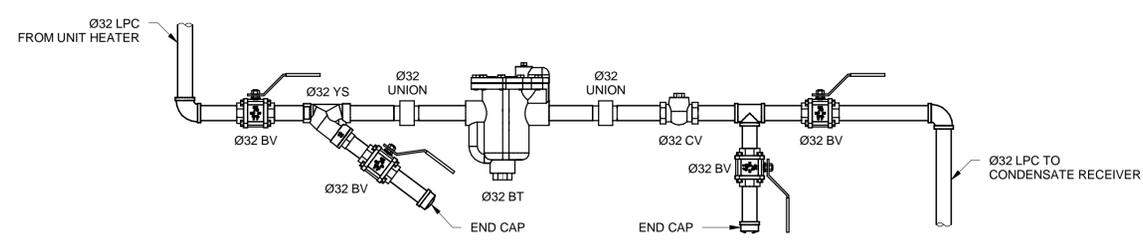


**3 TBU43+000 - UH CONDENSATE STATION**  
M1.11 Scale: 1 : 10

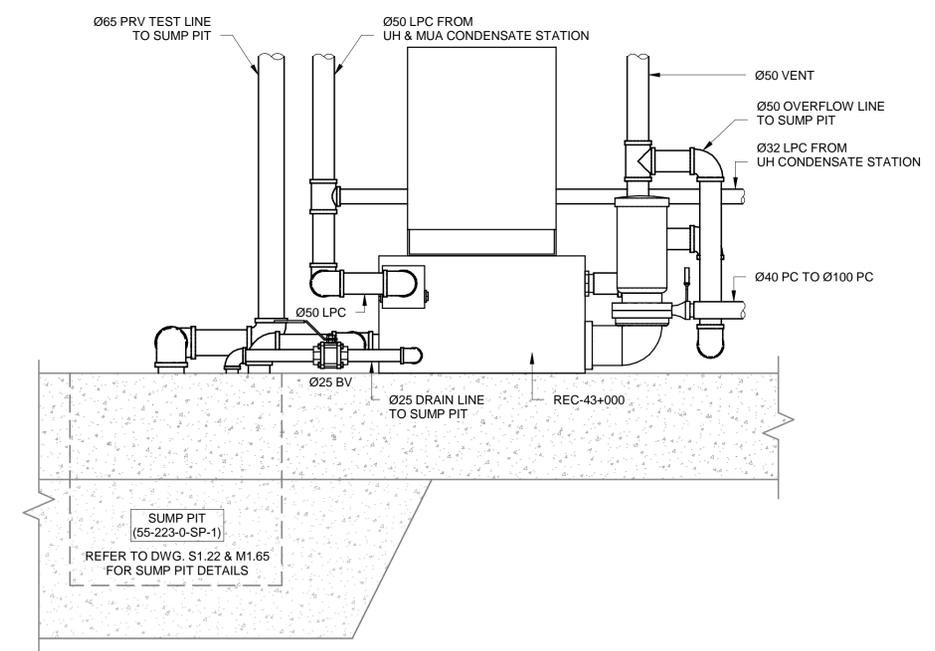

**4 TBU43+000 - CONDENSATE PUMP**  
M1.11 Scale: 1 : 10

PROFESSIONAL ENGINEER  
J.O. KELLS  
MEMBER 21246  
19 09 30  
YR. MN. DAY  
SASKATCHEWAN

ASSOCIATION OF PROFESSIONAL ENGINEERS & GEOSCIENTISTS OF SASKATCHEWAN  
**CERTIFICATE OF AUTHORIZATION**  
AECOM Canada Ltd.  
NUMBER C1667  
PERMISSION TO CONSULT HELD BY:  
DISCIPLINE: MECH SASK. REG. NO. SIGNATURE: M. Diego 2/24/6

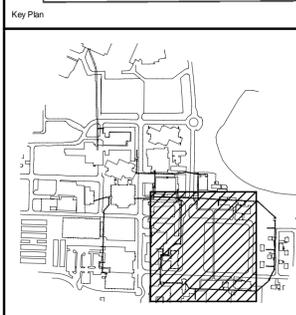

Revision	Description	Date
E	Issued For Tender	19/09/30
D	Issued For 99% Review	19/06/21
C	Issued For 85% Review	19/03/15
B	Issued For 50% Review	18/11/13
A	Not Issued	-

Public Works and Government Services Canada

Project Title  
**Tunnel Revitalization**

Designed by  
J. Kells  
Drawn by  
M. Diego  
Approved by  
B. Wolfater  
PWGSC Project Manager  
J. Dayman  
Drawing Title

Package 1 - TBU43 - Above Ground Mechanical  
Supply, Exhaust Air and Exit - Details

Project no.	Drawing no.	Revision no.
1004259	M1.13	E