



———— 16mm CONDUIT UNLESS SPECIFIED OTHERWISE.

—— ——— CONDUIT SIZED TO FIT CABLES UNLESS SPECIFIED OTHERWISE (MINIMUM 21mm)

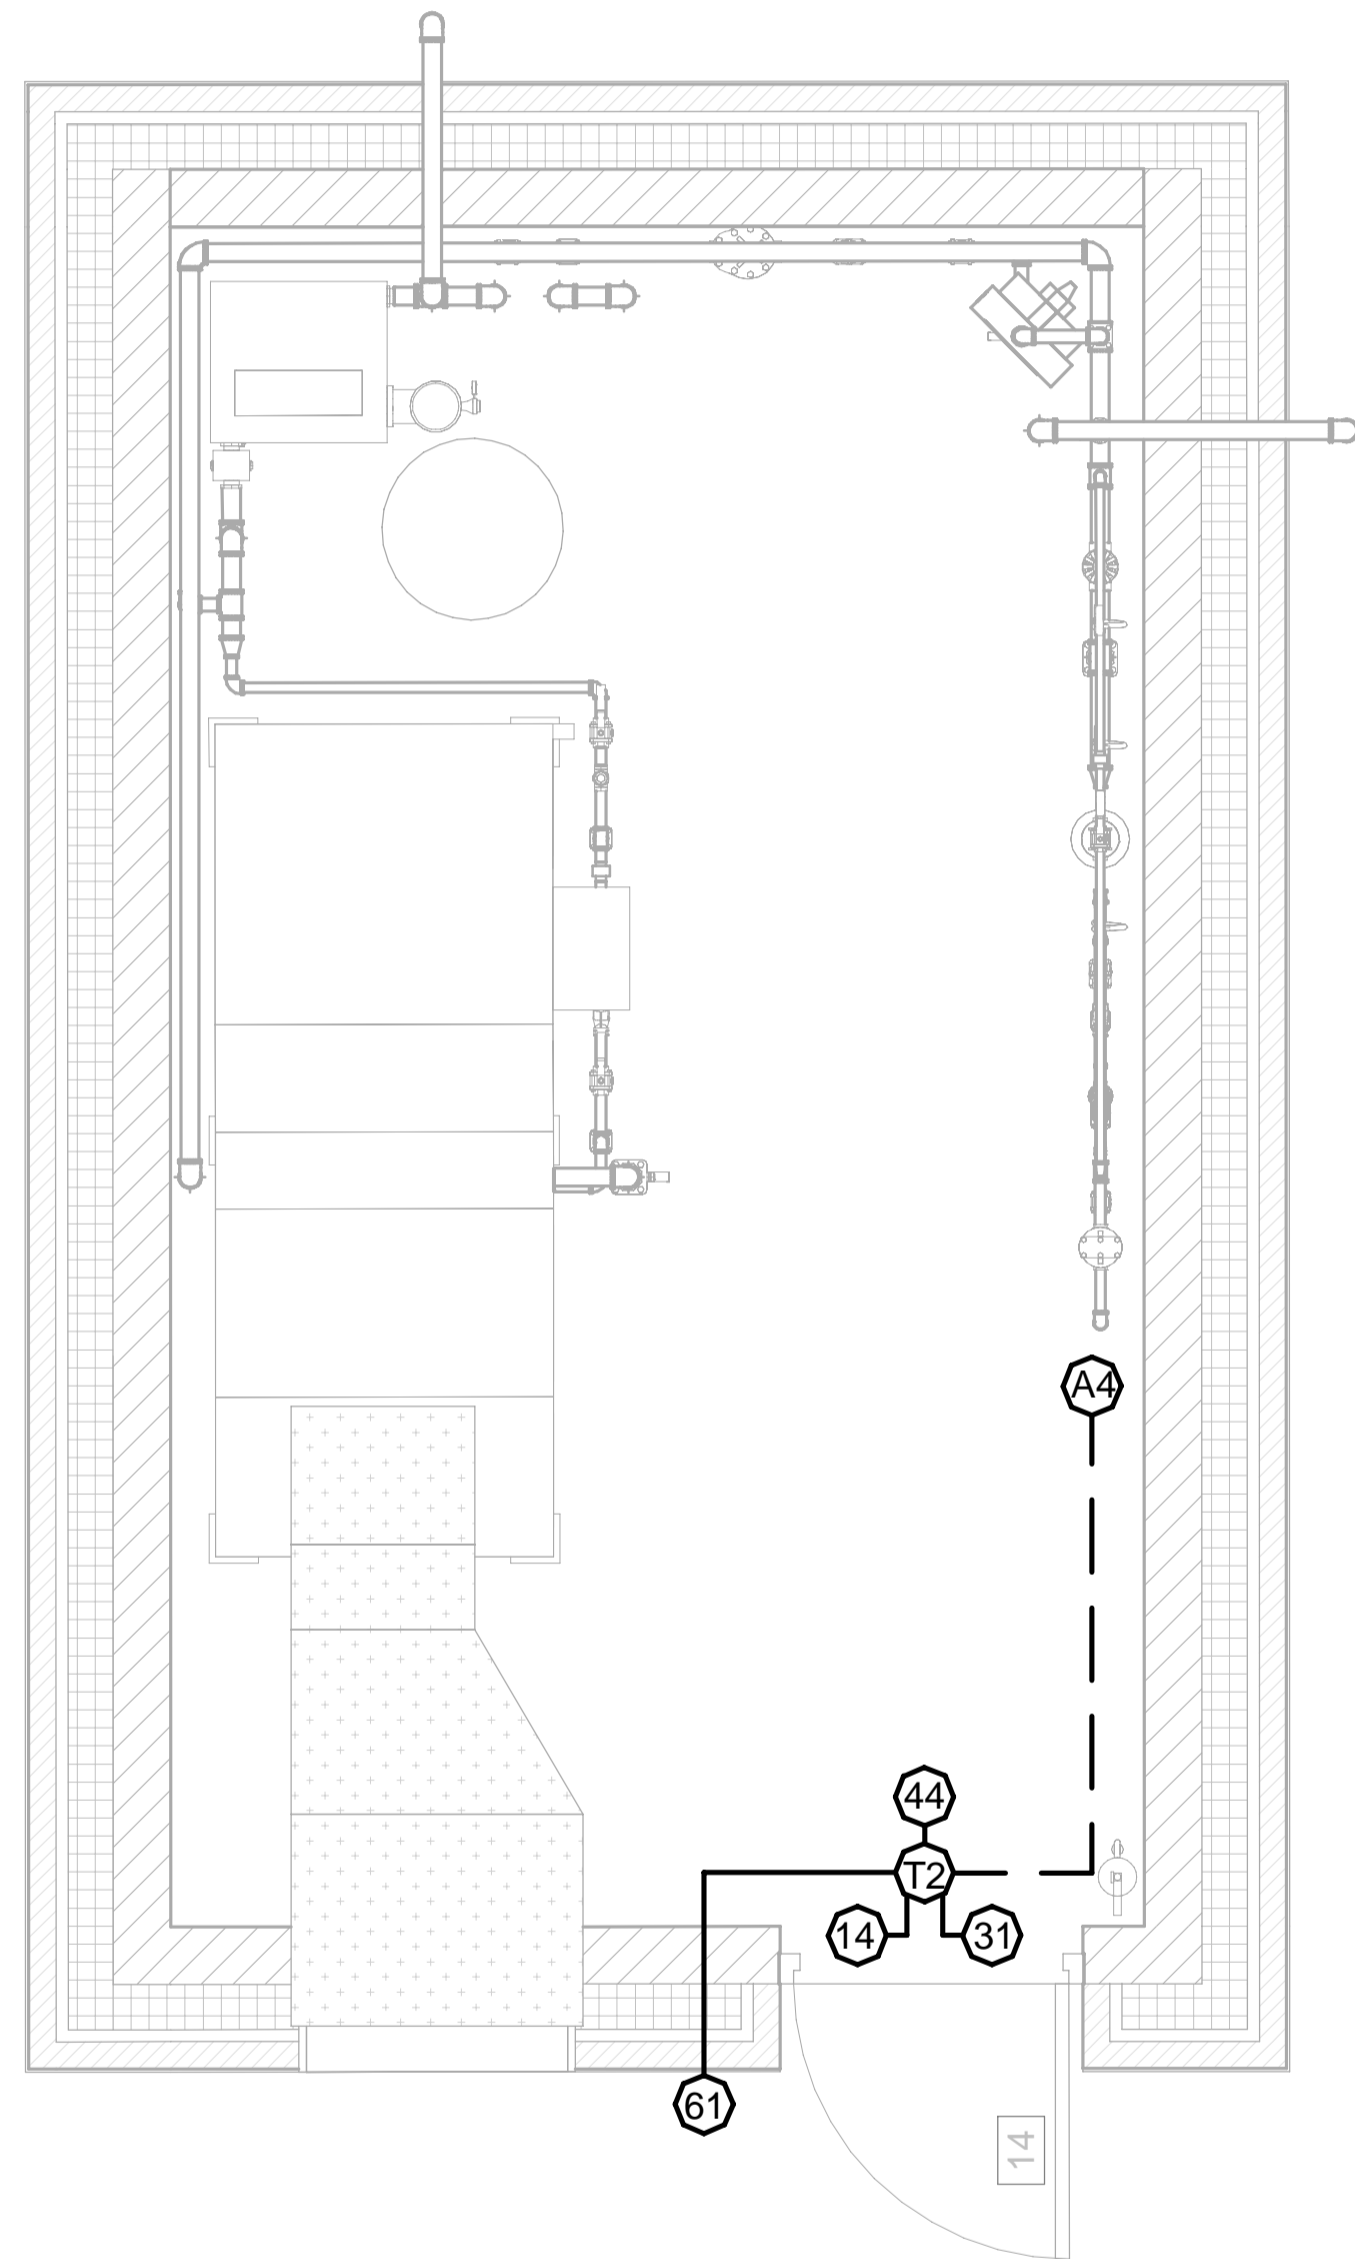


Scale: 1 : 25

1. ALL NUMBERS IN OCTAGONS REFER TO EQUIPMENT LISTED IN SPECIFICATION SECTION 28 13 01 PTSS CONDUIT AND CABLING.
2. REFER TO DRAWINGS E1.38 AND E1.39 FOR DOOR ELEVATION DETAILS.

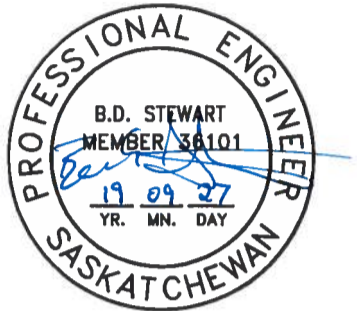

ASSOCIATION OF PROFESSIONAL ENGINEERS
& GEOSCIENTISTS OF SASKATCHEWAN
CERTIFICATE OF AUTHORIZATION
AECOM Canada Ltd.
NUMBER C1667
PERMISSION TO CONSULT HELD BY:
DISCIPLINE SASK. REG. No. SIGNATURE
ELECTRICAL 36101 Ean [Signature]

Key Plan

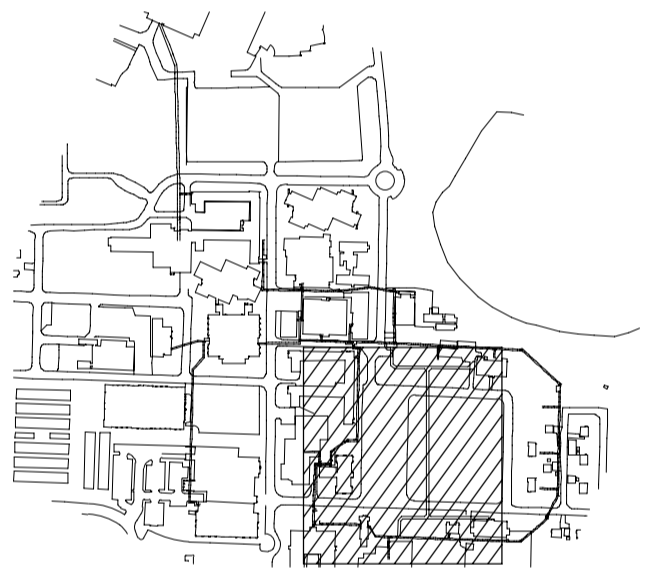

E	Issued For Tender	19/09/30
D	Issued For 99% Review	19/06/21
C	Not Issued	-
B	Not Issued	-
A	Not Issued	-
Revision	Description	Date

Client

**Public Works and
Government Services Canada**

Project Title

Tunnel Revitalization

Designed by

B. Stewart

Drawn by

T. Shrufi

Approved by _____

B. Wolfater

PWGSC Project Ma

J. Dayman

Package 1 - NTBU43 - Building
Electrical - New TBU43+520 Building
Security System Plans

Project. no.	Drawing no.	Revision no.
1004259	E1.31	E

