

NOTES:

- DISCONNECT AND REMOVE FEEDER CABLE FOR TUNNEL LUMINAIRES AND RECEPTACLE BACK TO SOURCE AND DISCARD. RUN NEW FEEDER CABLE TO EACH LUMINAIRE IN SCHEDULE 40 RPVC CONDUIT FROM NEW UPS SUB-PANEL, PNL-TBU43+000-UPS, LOCATED IN NTB43 BUILDING.
- UNLESS OTHERWISE SPECIFIED, ALL OCCUPANCY SENSORS ON THIS DRAWING ARE EXISTING IN PLACE.




TENDER
NOT FOR CONSTRUCTION



ASSOCIATION OF PROFESSIONAL ENGINEERS & GEOSCIENTISTS OF SASKATCHEWAN
CERTIFICATE OF AUTHORIZATION
AECOM Canada Ltd.
NUMBER C1667
PERMISSION TO CONSULT HELD BY:
DISCIPLINE: ELECTRICAL SIGN. REG. No. 36101 SIGNATURE: [Signature]

Key Plan

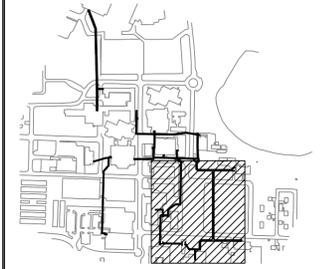

Revision	Description	Date
E	Issued For Tender	19/09/30
D	Issued For 99% Review	19/06/21
C	Issued For 85% Review	19/03/15
B	Issued For 50% Review	18/11/13
A	Issued For Record	18/09/07


Client
Public Works and Government Services Canada

Project title
Tunnel Revitalization

Designed by
B. Stewart
Drawn by
T. Shrufi
Approved by
B. Wolfater
PWSSC Project Manager
J. Dayman
Drawing title


Package 1 - TBU43 - Tunnel
Electrical
Lighting & Emergency Lighting Plans

Project no.	Drawing no.	Revision no.
1004259	E1.10	E

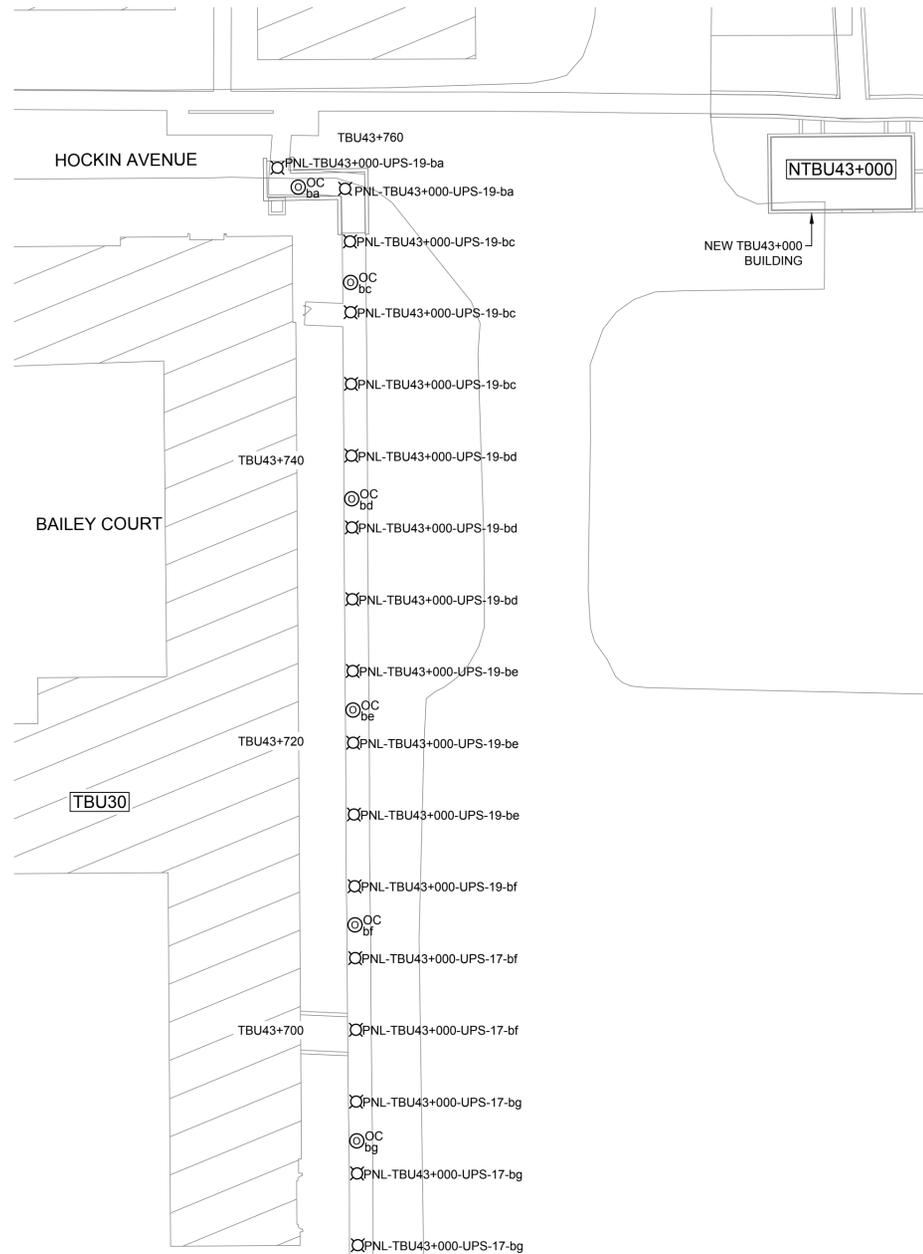

1 | TBU43+760 TO +700 LIGHTING PLAN

1:250

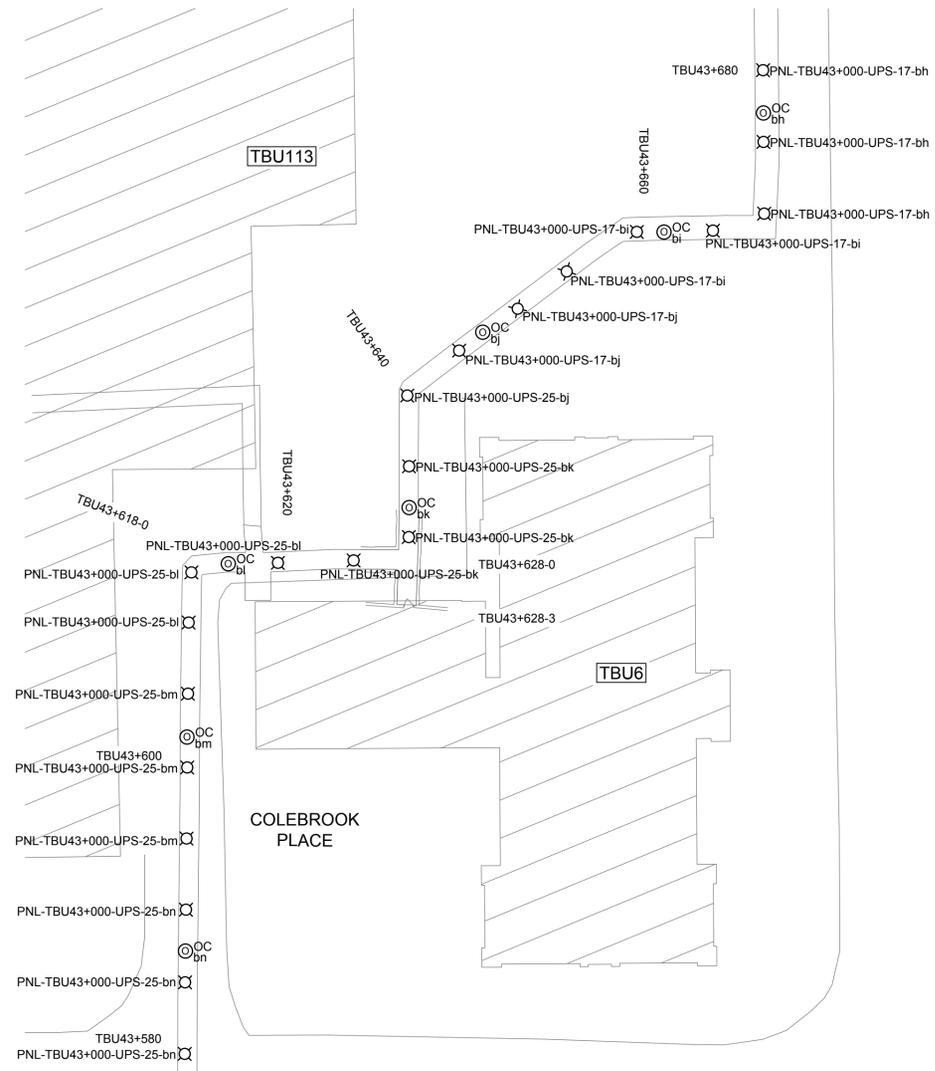

2 | TBU43+680 TO +580 LIGHTING PLAN

1:250

