

METRIC
WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

0	ISSUED FOR TENDER	2020/06/07
Revision/ Révision	Description/Description	Date/Date

Client/client

**PARKS CANADA AGENCY
CHURCHILL RAIL STATION
NATIONAL PARK**

Project title/Titre du projet

**CHURCHILL VRC
WATERMAIN REPLACEMENT
MANTAYO SEEPÉE MESKANOW**

Approved by/Approuvé par

-

Designed by/Concept par

JR

Drawn by/Dessiné par

RC

PWGSC Project Manager/Administrateur de Projets TPSCG

-

PWGSC, Architectural and Engineering Resources Manager/
Ressources Architectural et de Directeur d'ingénierie, TPSCG

Client/client

-


Drawing title/Titre du dessin

**ELECTRICAL
HEAT TRACE
PLAN**

Project No./No. du
projet
60632286


Sheet/ Feuille
E-01
OF

Revision no./
La Révision
no.
0

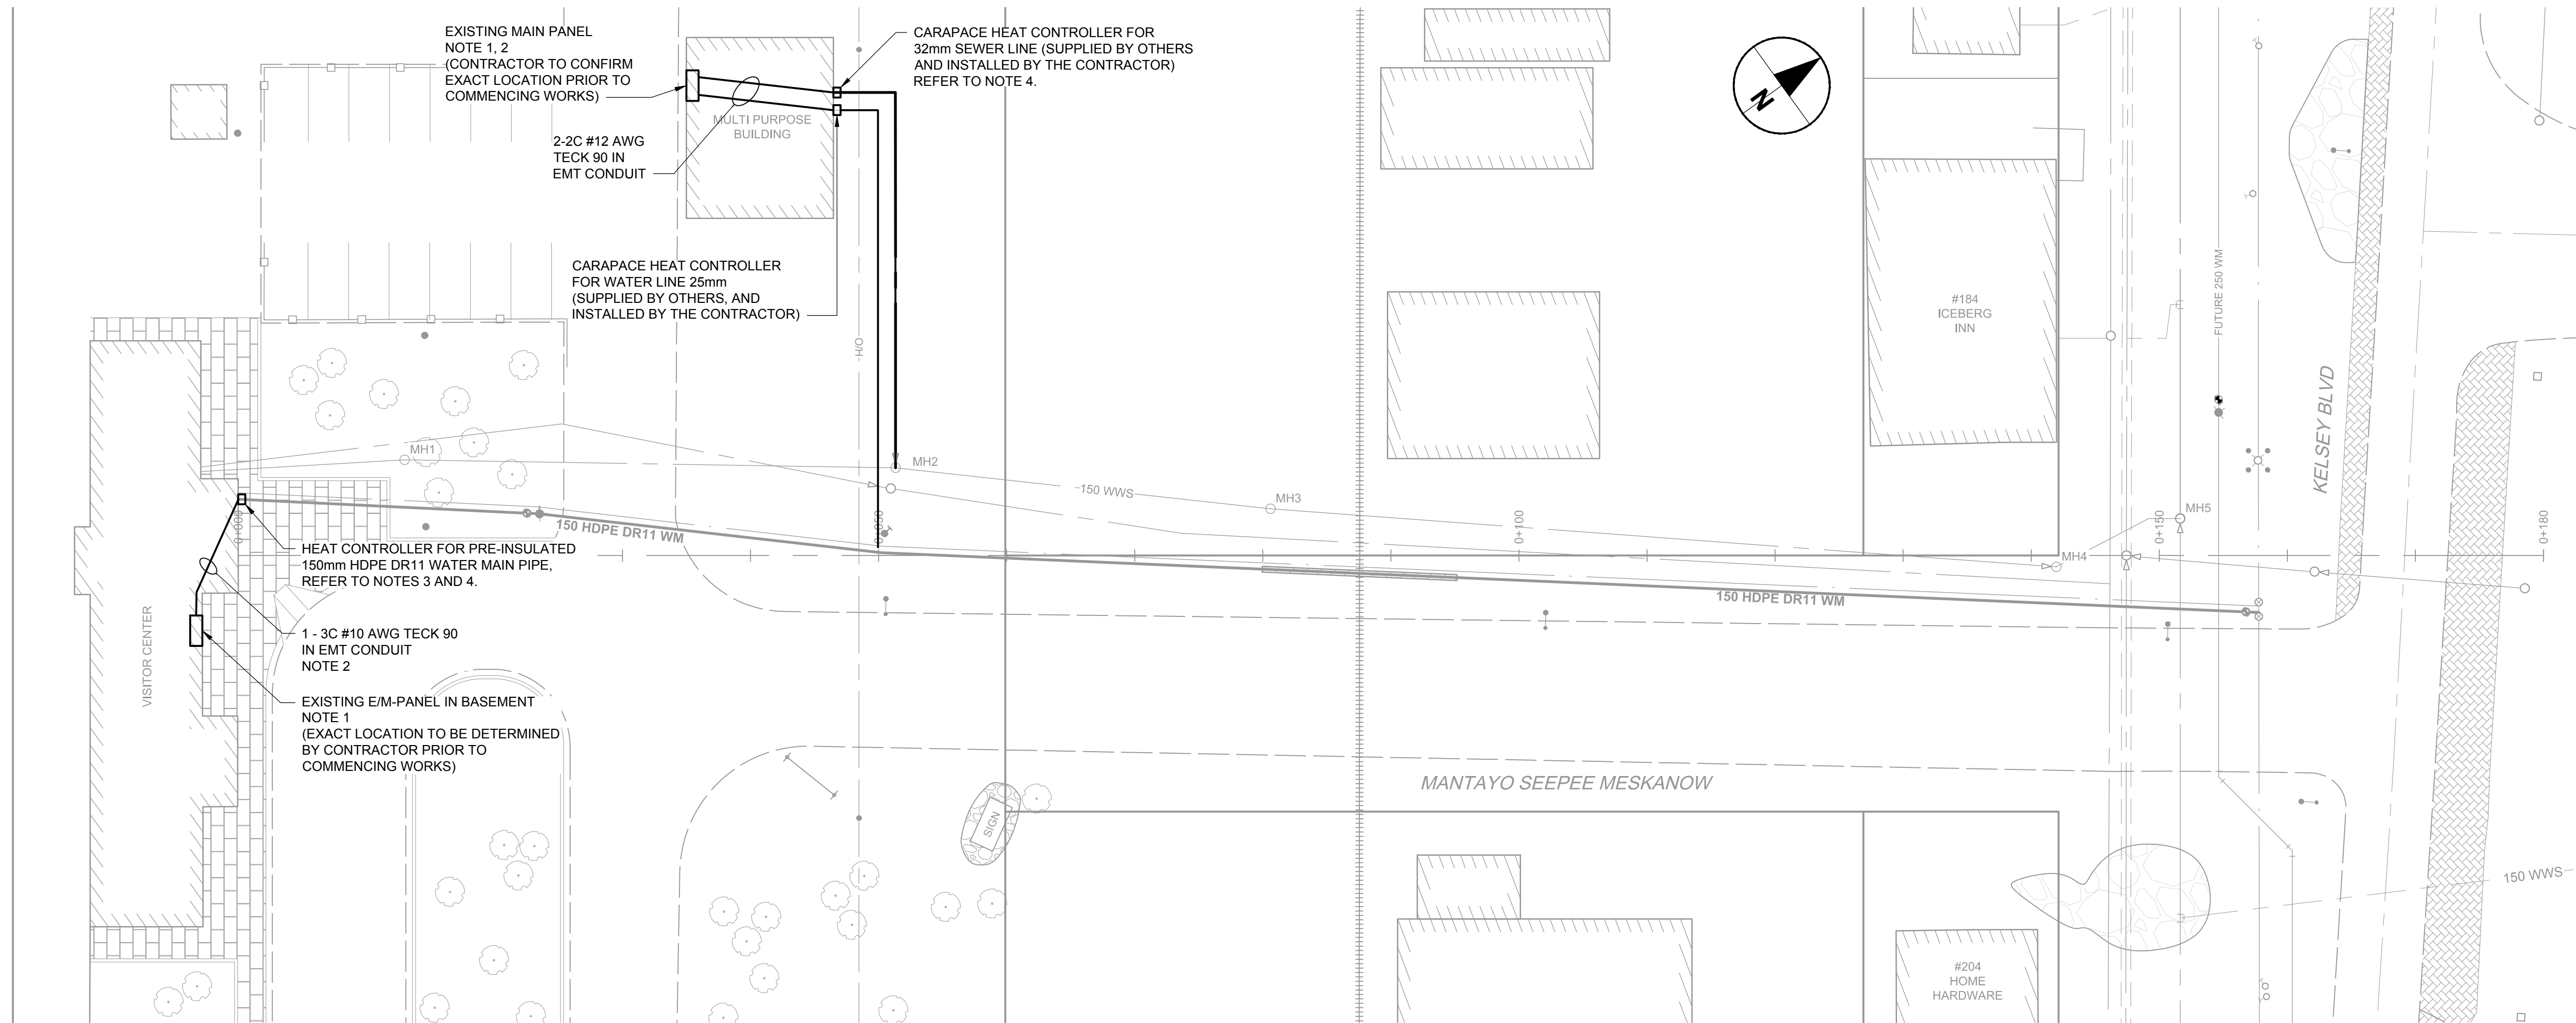

PLAN

Scale 1:300

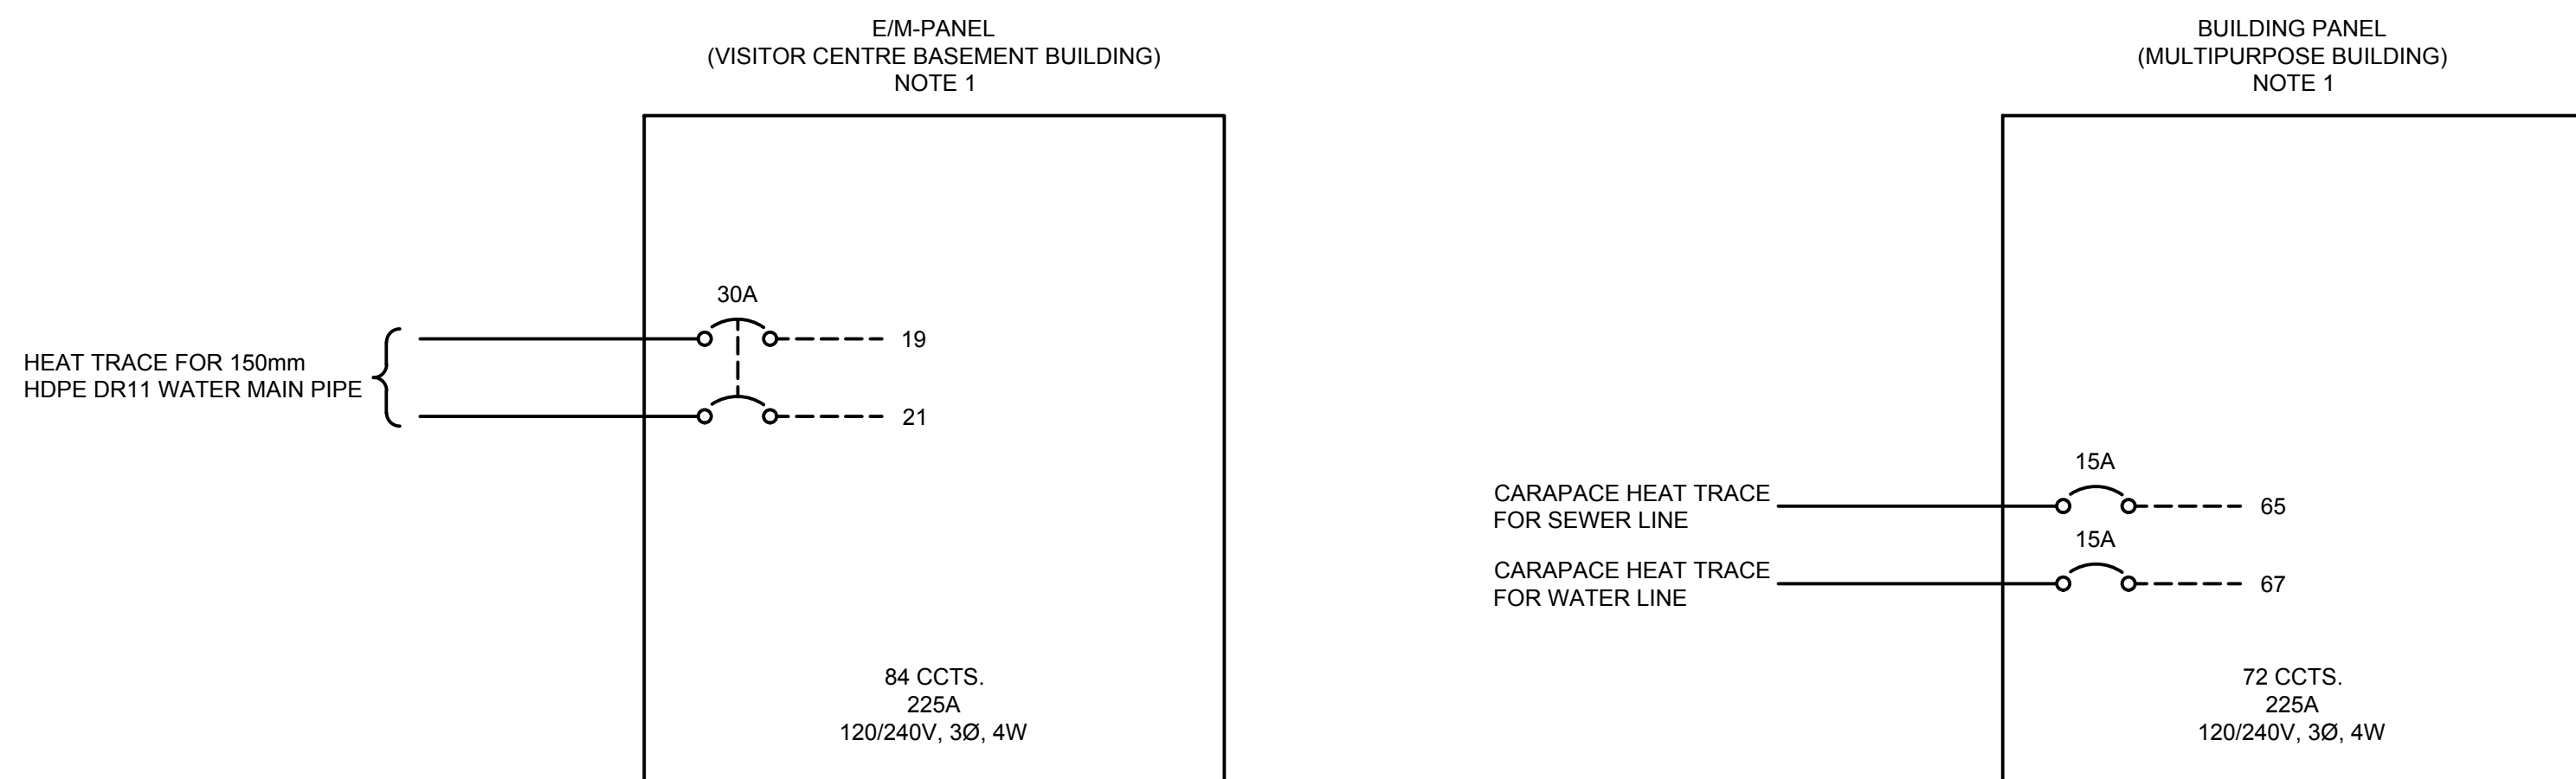

GENERAL NOTES:

1. REFER TO PROJECT SPECIFICATION SECTIONS FOR MORE DETAILS. IN THE EVENT OF DISCREPANCIES BETWEEN THE DIFFERENT SPECIFICATION SECTIONS, CONTACT THE CONSULTANT FOR A RESOLUTION PRIOR TO COMMENCING WORKS.

NOTES:

1. CONFIRM EXACT LOCATION PRIOR TO COMMENCING WORKS.
2. CONFIRM BEST POSSIBLE ROUTE WITH REPRESENTATIVE PRIOR TO COMMENCING THE WORK.
3. INSTALL HEAT TRACE SYSTEM TOGETHER WITH THERMOSTAT AND RTD FOR SELF-REGULATION. REFER TO HEAT TRACE SPECIFICATIONS FOR MORE INFORMATION. ALL INSTALLATIONS TO BE CARRIED OUT ACCORDING TO THE LATEST CEC, LOCAL AND PROVINCIAL AUTHORITY HAVING JURISDICTION'S (A/H)'S RULES AND REGULATIONS.
4. ENSURE THE HEAT TRACE CONTROLLER BOX IS INSTALLED SUCH THAT THE PUBLIC DOES NOT HAVE EASY ACCESS TO TAMPER WITH THE CONTROLLER BOX. IF IT IS ACCESSIBLE, INSTALL IT IN A LOCKABLE ENCLOSURE. MOUNT HEAT TRACE CONTROLLER BOXES / ENCLOSURES ON STAINLESS STEEL UNISTRUT CHANNEL USING STAINLESS STEEL HARDWARE.

