


on sa **DILLON CONSULTING**
Dillon, O'Neill, Scriven
 7071 Bayers Road, Suite 2001, Halifax, NS B3L 2C2
 p: 902.429.0701 f: 902.429.9729 w: www.dillon.ca
 341 Townsend Street, Sydney, NS B1P 5G1
 p: 902.562.8090 f: 902.562.6621
 9 Tamarrack Terrace, Moncton, NB E1A 5R1
 p: 506-883-8731

ROOM No. LAB No.	EXHAUST DEVICE No.	EXHAUST AIR VOLUME/UNIT		TOTAL EXHAUST VOLUME		REMARKS	
		MIN.	MAX.	MIN.	MAX.		
524	1800mm FUME HOOD	1	90	355	90	355	MINIMUM EXHAUST AIRFLOW RESULTS IN 25% MINIMUM HOOD FLOW & 8 ACHs.
TOTAL EXHAUST AIR		MIN = 90		MAX = 355		MINIMUM SUPPLY AIRFLOW MAINTAINS NEGATIVE OFFSET. ONE (1) SUPPLY AIR VALVES.	
TOTAL SUPPLY AIR		MIN = 50		MAX = 270			


1. ADDITIONAL MINIMUM EXHAUST IS REQUIRED FROM THE NEW GENERAL EXHAUST CONNECTED INTO FUME HOOD EXHAUST BRANCH (SEE BELOW). 45 LPS IS REQUIRED AS A MINIMUM TO MAINTAIN 8 ACHs.

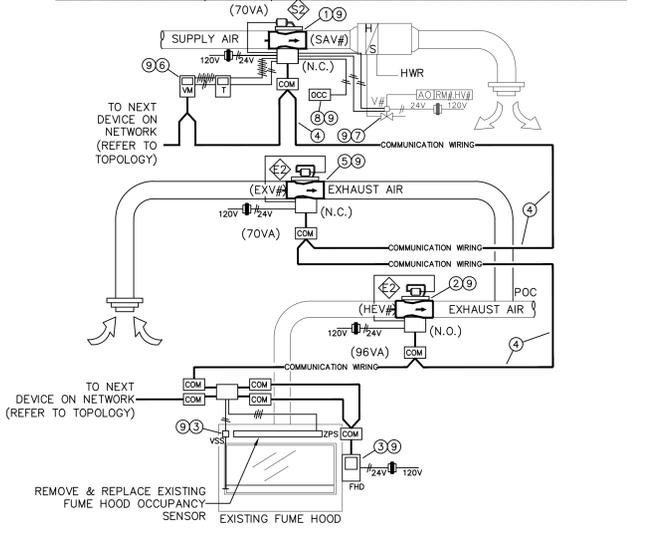

01 LABORATORY 524 CONTROL SCHEMATIC
 H14 SCALE: N.T.S.

ROOM No. LAB No.	EXHAUST DEVICE No.	EXHAUST AIR VOLUME/UNIT		TOTAL EXHAUST VOLUME		REMARKS	
		MIN.	MAX.	MIN.	MAX.		
526	1800mm FUME HOOD	1	90	355	90	355	MINIMUM EXHAUST AIRFLOW RESULTS IN 25% MINIMUM HOOD FLOW & 8 ACHs.
TOTAL EXHAUST AIR		MIN = 90		MAX = 355		MINIMUM SUPPLY AIRFLOW MAINTAINS NEGATIVE OFFSET. ONE (1) SUPPLY AIR VALVES.	
TOTAL SUPPLY AIR		MIN = 50		MAX = 270			

1. ADDITIONAL MINIMUM EXHAUST IS REQUIRED FROM THE NEW GENERAL EXHAUST CONNECTED INTO FUME HOOD EXHAUST BRANCH (SEE BELOW). 45 LPS IS REQUIRED AS A MINIMUM TO MAINTAIN 8 ACHs.

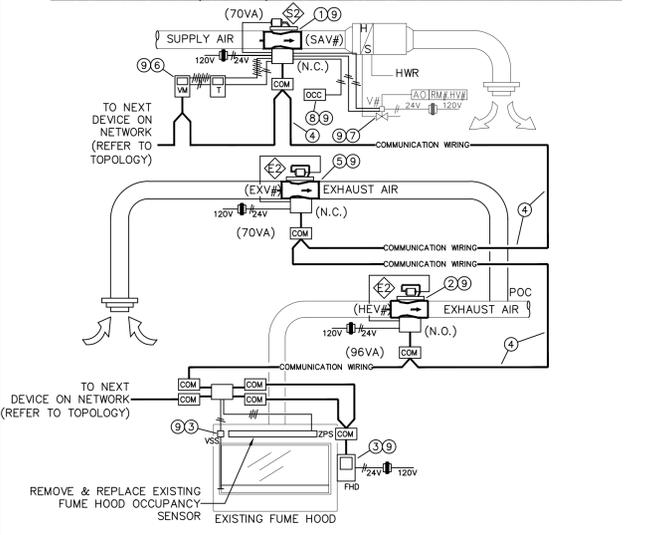


03 LABORATORY 526 CONTROL SCHEMATIC
 H14 SCALE: N.T.S.

GENERAL NOTES

- REMOVE ALL EXISTING 2-POSITION SUPPLY AND GENERAL EXHAUST PNEUMATIC-CONTROLLED AIR VALVES AND REPLACE WITH VARIABLE AIR VOLUME SUPPLY AND GENERAL EXHAUST ELECTRONIC-CONTROLLED AIR VALVES. ACTUATORS SHALL BE ELECTRONIC, FAST-ACTING. ALL COMPONENTS SHALL BE REMOVED AND REPLACED (I.E. NONE OF THE EXISTING COMPONENTS MAY BE RE-USED). REMOVE AND REPLACE EXISTING DUCTWORK TO/FROM AIR VALVE AS REQUIRED TO INSTALL NEW AIR VALVE AS REQUIRED BY MANUFACTURER (I.E. WITH REQUIRED STRAIGHT SECTIONS FOR INLET/OUTLET, ETC.). CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS, CONTROLLERS AND ROOM INTEGRATORS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. SEE DRAWINGS & SPECIFICATIONS FOR ALL REQUIREMENTS. REMOVE ALL EXISTING PNEUMATIC TUBING ASSOCIATED WITH AIR VALVES TO BE REPLACED, CAP TUBING AT NEARBY MAIN.
- REMOVE ALL EXISTING 2-POSITION FUME HOOD EXHAUST PNEUMATIC-CONTROLLED AIR VALVES AND REPLACE WITH VARIABLE AIR VOLUME FUME HOOD EXHAUST ELECTRONIC-CONTROLLED AIR VALVES. ACTUATORS SHALL BE ELECTRONIC, FAST-ACTING. ALL COMPONENTS SHALL BE REMOVED AND REPLACED (I.E. NONE OF THE EXISTING COMPONENTS MAY BE RE-USED). REMOVE AND REPLACE EXISTING DUCTWORK TO/FROM AIR VALVE AS REQUIRED TO INSTALL NEW AIR VALVE AS REQUIRED BY MANUFACTURER (I.E. WITH REQUIRED STRAIGHT SECTIONS FOR INLET/OUTLET, ETC.). CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS, CONTROLLERS AND ROOM INTEGRATORS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. SEE DRAWINGS & SPECIFICATIONS FOR ALL REQUIREMENTS. REMOVE ALL EXISTING PNEUMATIC TUBING ASSOCIATED WITH AIR VALVES TO BE REPLACED, CAP TUBING AT NEARBY MAIN.
- REMOVE AND REPLACE THE FOLLOWING EXISTING FUME HOOD CONTROL COMPONENTS, INCLUDING ALL OF THEIR ASSOCIATED COMPONENTS AND WIRING, (A) FUME HOOD DISPLAY/MONITOR ("FHD"), (B) VERTICAL SLASH MONITOR ("VSS"), AND (C) ZONE PRESENCE HOOD OCCUPANCY SENSOR ("ZPS"). ALL NEW DEVICES SHALL BE COMPATIBLE WITH NEW VARIABLE AIR VOLUME FUME HOOD EXHAUST AIR VALVES AND CONTROLLERS. CONNECT DEVICES INTO NEW FUME HOOD MONITOR. CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS, CONTROLLERS AND ROOM INTEGRATORS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. SEE DRAWINGS & SPECIFICATIONS FOR ALL REQUIREMENTS.
- REMOVE AND REPLACE EXISTING COMMUNICATION WIRING. PROVIDE NEW WIRING AS REQUIRED FOR NEW AIR VALVE AND CONTROLLER REQUIREMENTS. CONTRACTOR TO CONFIRM SPECIFIC REQUIREMENTS OF COMMUNICATION WIRING WITH MANUFACTURER (TO BE EITHER LON, BACNET MS/TIP OR BACNET IP BASED COMMUNICATION). REMOVE ALL REDUNDANT EXISTING CONTROL WIRING. REMOVE ALL EXISTING PNEUMATIC TUBING ASSOCIATED WITH AIR VALVES TO BE REPLACED, CAP TUBING AT NEARBY MAIN.
- PROVIDE NEW GENERAL EXHAUST ELECTRONIC AIR VALVE. CONNECT INTO EXHAUST AIR DUCTWORK DOWNSTREAM OF EXISTING FUME HOOD EXHAUST AIR VALVE (I.E. DO NOT CONNECT BETWEEN THE FUME HOOD AND THE FUME HOOD CONTROL VALVE). REFER TO VENTILATION LAYOUTS FOR LOCATIONS, SIZING AND CONNECTION REQUIREMENTS.
 - PROVIDE NEW FIRE DAMPER (FD) WITHIN NEW DUCTWORK WHERE IT PENETRATES THE WALL BETWEEN THE SERVICE CORRIDOR AND LABORATORY SPACE.
 - CONNECT NEW SERVICES (n) INTO EXISTING SERVICES (e) TO REMAIN INSTALLED, POINT OF CONNECTION (P.O.C.). MODIFY EXISTING TO THE FULL EXTENT REQUIRED TO COMPLETE CONNECTION. CONFIRM AND DETERMINE EXACT LOCATIONS, SIZES AND ELEVATIONS ON-SITE.
 ACTUATORS SHALL BE ELECTRONIC, FAST-ACTING. INSTALL NEW AIR VALVE AS REQUIRED BY MANUFACTURER (I.E. WITH REQUIRED STRAIGHT SECTIONS FOR INLET/OUTLET, ETC.). CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS, CONTROLLERS AND ROOM INTEGRATORS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. SEE DRAWINGS & SPECIFICATIONS FOR ALL REQUIREMENTS.
- PROVIDE NEW WALL-MOUNTED VIEW MONITOR / CONTROLLER FOR LABORATORY VENTILATION SYSTEM ("VM"). CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS AND CONTROLLERS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. REMOVE AND REPLACE EXISTING WALL-MOUNTED THERMOSTATS WITH NEW ELECTRONIC TEMPERATURE THERMOSTAT ("TT") COMPLETE WITH TEMPERATURE SENSOR, HUMIDITY SENSOR, DISPLAY, LABORATORY VENTILATION OVERRIDE AND SET-POINT ADJUSTMENT. THERMOSTAT TO BE COMPATIBLE WITH NEW AIR VALVE CONTROLLERS AND CONTROL PACKAGE. MANUFACTURER TO CONFIRM ALL OTHER REQUIREMENTS. PROVIDE ADDITIONAL COMPONENTS AS NECESSARY TO PROVIDE FUNCTIONAL SYSTEM.
- EXISTING BELIMO MODULATING ZONE REHEAT CONTROL VALVE TO REMAIN, TO BE CONTROLLED VIA THE RESPECTIVE AIR VALVE CONTROLLER. PROVIDE ALL WIRING NECESSARY BETWEEN AIR VALVE CONTROLLER AND CONTROL VALVE. MANUFACTURER TO CONFIRM ALL OTHER REQUIREMENTS. PROVIDE ADDITIONAL COMPONENTS AS NECESSARY TO PROVIDE FUNCTIONAL SYSTEM.
- PROVIDE NEW ROOM OCCUPANCY FOR EACH ENTRY DOORWAY INTO ROOM. CONNECT INTO LABORATORY VENTILATION SYSTEM. CONFIRM ALL OTHER REQUIREMENTS, PROVIDE ADDITIONAL COMPONENTS, INCLUDING ALL WIRING, TRANSFORMERS, CONTROLLERS AND ROOM INTEGRATORS, AS NECESSARY TO PROVIDE FULLY FUNCTIONAL SYSTEM. SEE DRAWINGS & SPECIFICATIONS FOR ALL REQUIREMENTS.
- ALL ELECTRICAL (120V) WIRING, INCLUDING CIRCUIT BREAKERS, SHALL BE PROVIDED (I.E. SUPPLIED & INSTALLED) BY THE CONTRACTOR. ALL LOW VOLTAGE (24V) WIRING, INCLUDING 120/24VDC CONTROL TRANSFORMERS, SHALL BE PROVIDED (I.E. SUPPLIED & INSTALLED) BY THE CONTRACTOR. ALL NETWORK/COMMUNICATION WIRING, INCLUDING DATA CONNECTIONS & DROPS, SHALL BE PROVIDED (I.E. SUPPLIED & INSTALLED) BY THE CONTRACTOR.

ROOM No. LAB No.	EXHAUST DEVICE No.	EXHAUST AIR VOLUME/UNIT		TOTAL EXHAUST VOLUME		REMARKS	
		MIN.	MAX.	MIN.	MAX.		
525	1800mm FUME HOOD	2	90	355	180	710	MINIMUM EXHAUST AIRFLOW RESULTS IN 25% MINIMUM HOOD FLOW & 8 ACHs.
TOTAL EXHAUST AIR		MIN = 180		MAX = 710		MINIMUM SUPPLY AIRFLOW MAINTAINS NEGATIVE OFFSET. TWO (2) SUPPLY AIR VALVES.	
TOTAL SUPPLY AIR		MIN = 100		MAX = 540			


1. ADDITIONAL MINIMUM EXHAUST IS REQUIRED FROM THE NEW GENERAL EXHAUST CONNECTED INTO FUME HOOD EXHAUST BRANCH (SEE BELOW). 90 LPS IS REQUIRED AS A MINIMUM TO MAINTAIN 8 ACHs.

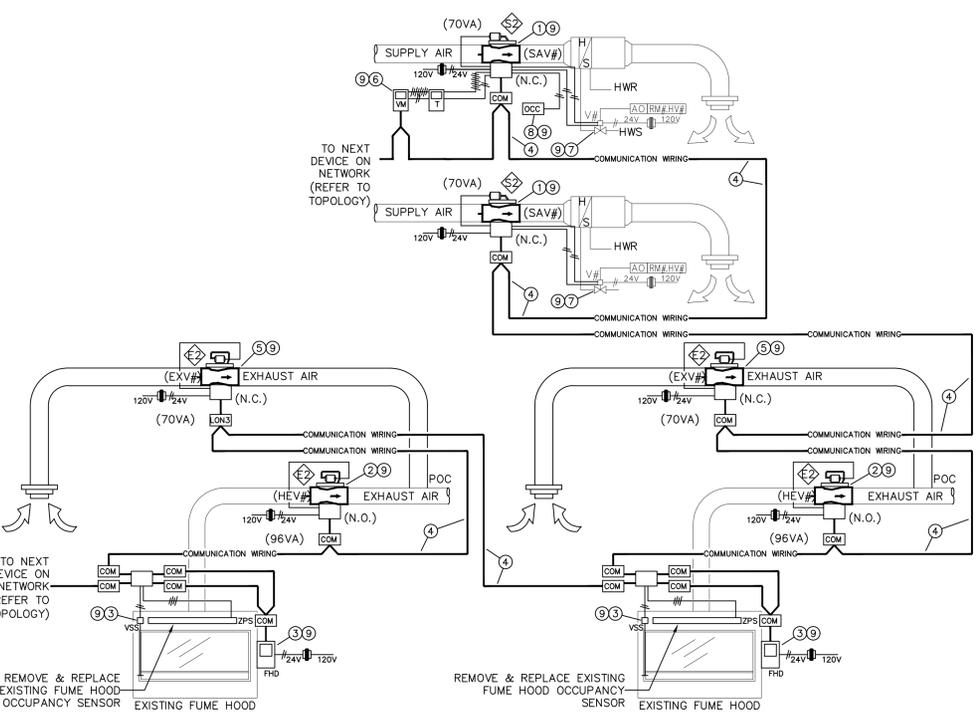

02 LABORATORY 525 CONTROL SCHEMATIC
 H14 SCALE: N.T.S.

ROOM No. LAB No.	EXHAUST DEVICE No.	EXHAUST AIR VOLUME/UNIT		TOTAL EXHAUST VOLUME		REMARKS	
		MIN.	MAX.	MIN.	MAX.		
535	1800mm FUME HOOD	1	90	355	90	355	MINIMUM EXHAUST AIRFLOW RESULTS IN 25% MINIMUM HOOD FLOW & 8 ACHs.
TOTAL EXHAUST AIR		MIN = 90		MAX = 355		MINIMUM SUPPLY AIRFLOW MAINTAINS NEGATIVE OFFSET. ONE (1) SUPPLY AIR VALVES.	
TOTAL SUPPLY AIR		MIN = 50		MAX = 270			


1. SPACE WAS MODIFIED BETWEEN AFTER RECORD DRAWINGS PREPARED. NO UP-TO-DATE TAB REPORT AVAILABLE. AIRFLOW ESTIMATED.

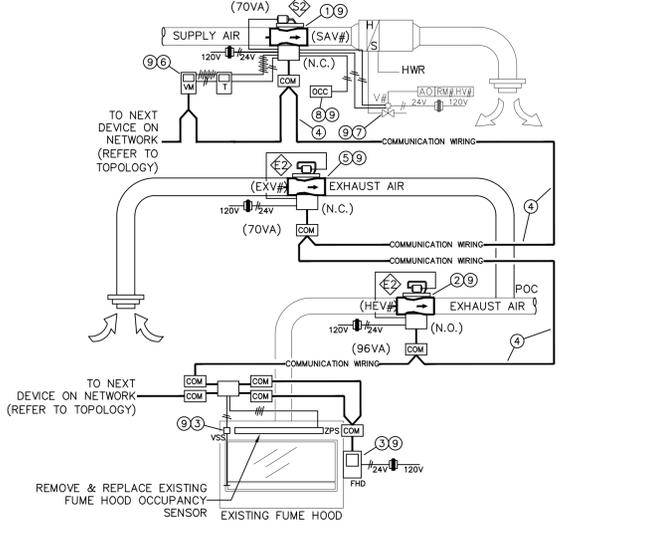

04 LABORATORY 535 CONTROL SCHEMATIC
 H14 SCALE: N.T.S.

ROOM No. LAB No.	EXHAUST DEVICE No.	EXHAUST AIR VOLUME/UNIT		TOTAL EXHAUST VOLUME		REMARKS	
		MIN.	MAX.	MIN.	MAX.		
527	GENERAL EXHAUST	1	135	160	135	160	MINIMUM EXHAUST AIRFLOW RESULTS IN 8 ACHs.
TOTAL EXHAUST AIR		MIN = 135		MAX = 160		MINIMUM SUPPLY AIRFLOW MAINTAINS NEGATIVE OFFSET. ONE (1) SUPPLY AIR VALVES.	
TOTAL SUPPLY AIR		MIN = 110		MAX = 130			

1. SPACE WAS MODIFIED BETWEEN AFTER RECORD DRAWINGS PREPARED. NO UP-TO-DATE TAB REPORT AVAILABLE. AIRFLOW ESTIMATED.
 2. ADDITIONAL MINIMUM EXHAUST IS REQUIRED FROM THE NEW GENERAL EXHAUST CONNECTED INTO FUME HOOD EXHAUST BRANCH (SEE BELOW). 45 LPS IS REQUIRED AS A MINIMUM TO MAINTAIN 8 ACHs.

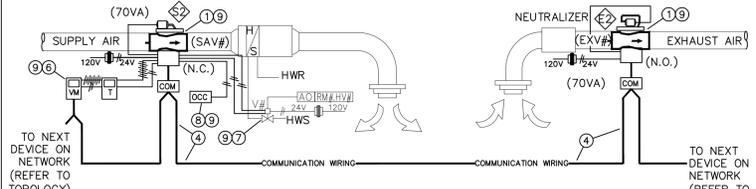

05 LABORATORY 527 CONTROL SCHEMATIC
 H14 SCALE: N.T.S.

1	ISSUED FOR TENDER	JUL 24 2020
revisions		date
project		project

ELLIS LABORATORY VENTILATION UPGRADES BEDFORD INSTITUTE OF OCEANOGRAPHY DARTMOUTH, N.S.

CONTROL SCHEMATICS

designed D.G.I.	conqu
date JUL 24, 2020	
drawn D.G.I.	dessine
date JUL 24, 2020	
approved D.G.I.	approuve
date JUL 24, 2020	
Tender	Soumission
PM/GSC Project Manager	Administrateur de projets TP/GSC
project number	no. du projet
R.082149.003	
drawing no.	no. du dessin
H14	