



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS À:

Bid Receiving Public Works and Government
Services Canada/Réception des soumissions Travaux
publics et Services gouvernementaux Canada
800 Burrard Street, Room 219
800, rue Burrard, pièce 219
Vancouver
British Columbia
V6Z 0B9
Bid Fax: (604) 775-9381

SOLICITATION AMENDMENT MODIFICATION DE L'INVITATION

The referenced document is hereby revised; unless otherwise
indicated, all other terms and conditions of the Solicitation
remain the same.

Ce document est par la présente révisé; sauf indication contraire,
les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address
Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution
Public Works and Government Services Canada - Pacific
Region
800 Burrard Street, Room 219
800, rue Burrard, pièce 219
Vancouver
British C
V6Z 0B9

Title - Sujet IOS MCTS Renovation	
Solicitation No. - N° de l'invitation EZ899-211223/A	Amendment No. - N° modif. 001
Client Reference No. - N° de référence du client	Date 2020-10-30
GETS Reference No. - N° de référence de SEAG PW-\$PWY-043-8849	
File No. - N° de dossier PWY-0-43116 (043)	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM on - le 2020-11-10	Time Zone Fuseau horaire Pacific Standard Time PST
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input checked="" type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Dumay (PWY), Clara	Buyer Id - Id de l'acheteur pwy043
Telephone No. - N° de téléphone (604) 499-9708 ()	FAX No. - N° de FAX () -
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction: DFO – Institute of Ocean Science – Sidney, BC	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

Solicitation No. - N° de l'invitation
EZ899-211223/A

Amd. No. - N° de la modif.
001

Buyer ID - Id de l'acheteur
PWY043

Client Ref. No. - N° de réf. du client
R.108854.001

File No. - N° du dossier
PWY-0-43116

CCC No./N° CCC - FMS No./N° VME

Les documents français seront disponibles sur demande

This Amendment 001 is raised to incorporate Addendum No. 1.

See the attached Addendum No. 1.

ALL OTHER TERMS AND CONDITIONS REMAIN UNCHANGED.

This Addendum shall be read in conjunction with and considered as an integral part of the Contract Documents; revisions supersede the information contained in the original drawings, specifications or previously issued Addendum. Tender Price submitted shall include all items of this Addendum.

No consideration will be allowed for any extras due to Bidder not being familiar with the contents of this Addendum.

1.0 ARCHITECTURAL/GENERAL

1.1 QUESTIONS:

- .1 "Will the area of work be shut down for the duration of the project or will the area be used during working hours? "

RESPONSE: No, area will not be shut down, area is still used during clients working hours.

Assume contractors working hours could be from 0800 to 2100 hours only.

Final co-ordination re: actual work times required with "Departmental Representative" upon award.

- .2 Please provide a spec for the ACT tile to be repaired/replaced.

RESPONSE: per spec "Acoustic units to match existing units as closely as possible"

- .3 Is there any "attic stock" of the existing finished floor material available?

RESPONSE: No attic stock available.

- .4 If no "attic stock" is available, please provide a spec for the existing flooring so we can match existing.

RESPONSE: per spec, "To match existing carpet tile as closely as possible."

- .5 Please confirm whether the HVAC ducting demo shown in detail 1/M1.00 is under the existing access flooring or above the t-bar.

RESPONSE: Demo is above the t-bar.

- .6 If the demo is under the access floor, please advise whether the flooring is being replaced in this area.

RESPONSE: Refer to .5 above.

- .7 If the demo is above the t-bar, please advise whether the t-bar grid is to be replaced in this area.

RESPONSE: T-bar is to be removed and reinstated.


- .8 For the relocated floor grilles shown on detail 2/M1.00 between gridlines E and F along gridline 2.5, please confirm where these ducts are being fed from. The same question applies to the grille shown at gridline D"/1.6. There doesn't appear to be an HVAC duct branch shown that feeds these locations.

RESPONSE: The floor grilles to be relocated and added are utilizing the floor plenum and therefore no duct connections required for these grilles.

..over

Photos for reference



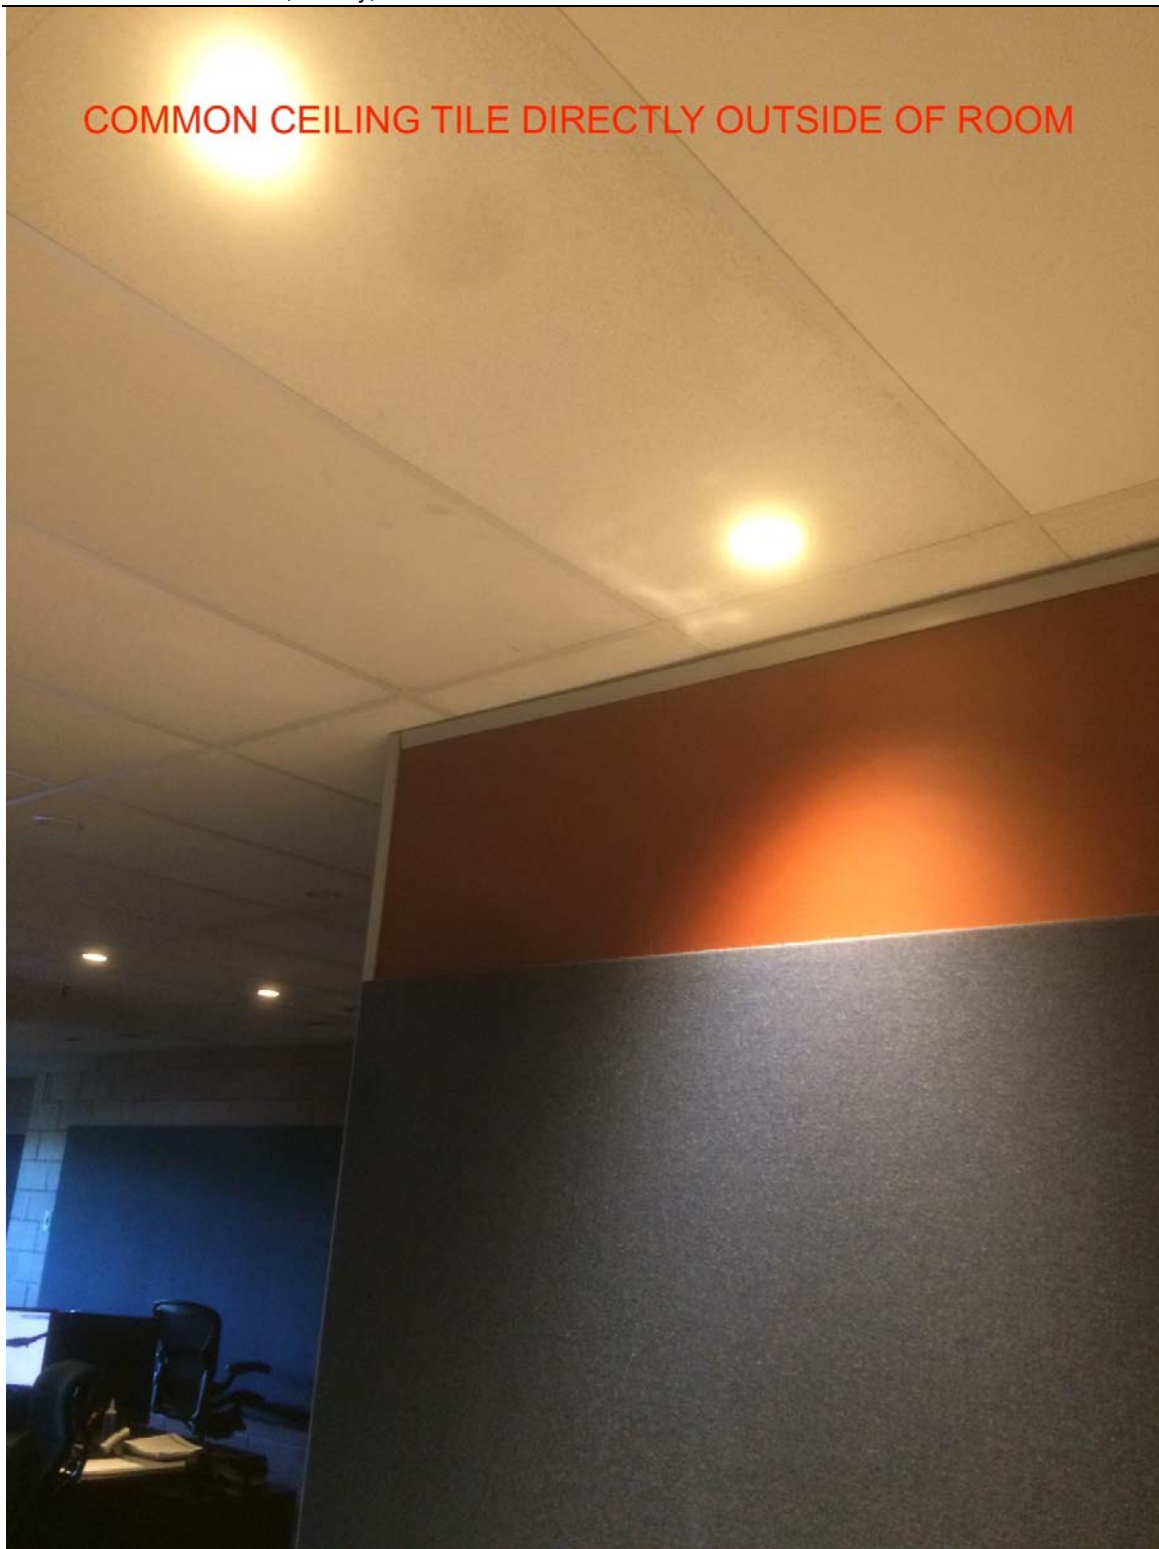



...end

END OF ARCHITECTURAL ADDENDUM - 1