


key plan




GENERAL NOTES:

EXISTING SIEMENS FIRE ALARM SYSTEM IS TO BE REPLACED WITH NEW GENERATION ADDRESSABLE FIRE ALARM SYSTEM.
 EXISTING INITIATING AND SIGNAL CIRCUIT WIRING IS TO BE MAINTAINED, UNLESS INDICATED OTHERWISE.
 EXISTING SPRINKLER COMPONENTS ARE NOT TO BE MODIFIED, ONLY ADDRESSABLE MODULES ARE TO BE REPLACED UNLESS INDICATED OTHERWISE.

FIRE ALARM NOTES:


- 1 EXISTING INITIATING CIRCUIT DEVICE TO BE REPLACED WITH NEW DEVICE.
- 2 EXISTING BELL/STROBE SIGNAL CIRCUIT DEVICE TO BE REPLACED WITH NEW HORN/STROBE DEVICE.
- 3 REMOVE FUSIBLE LINKS FROM EXISTING FIRE SHUTTERS. PROVIDE ELECTRIC SOLENOID KITS TO RELEASE SHUTTER ON ACTUATION OF SECOND STAGE FIRE ALARM. FEED FROM SPARE 15A-1P CIRCUIT BREAKER IN EXISTING PANEL "PB8B".
- 4 RELOCATE EXISTING MANUAL PULL STATION SUCH THAT IT IS 1100mm ABOVE THE FINISHED FLOOR. REPAIR WALL AND REPAIR WALL FINISH TO MATCH EXISTING FINISH.
- 5 EXTEND EXISTING FIRE ALARM INITIATING CIRCUITRY TO NEW DEVICE.
- 6 EXTEND EXISTING FIRE ALARM SIGNAL CIRCUITRY TO NEW DEVICE.
- 7 EXISTING ELEVATOR SHAFT SMOKE DETECTOR TO BE REMOVED AND REPLACED WITH NEW SAMPLING POINT.

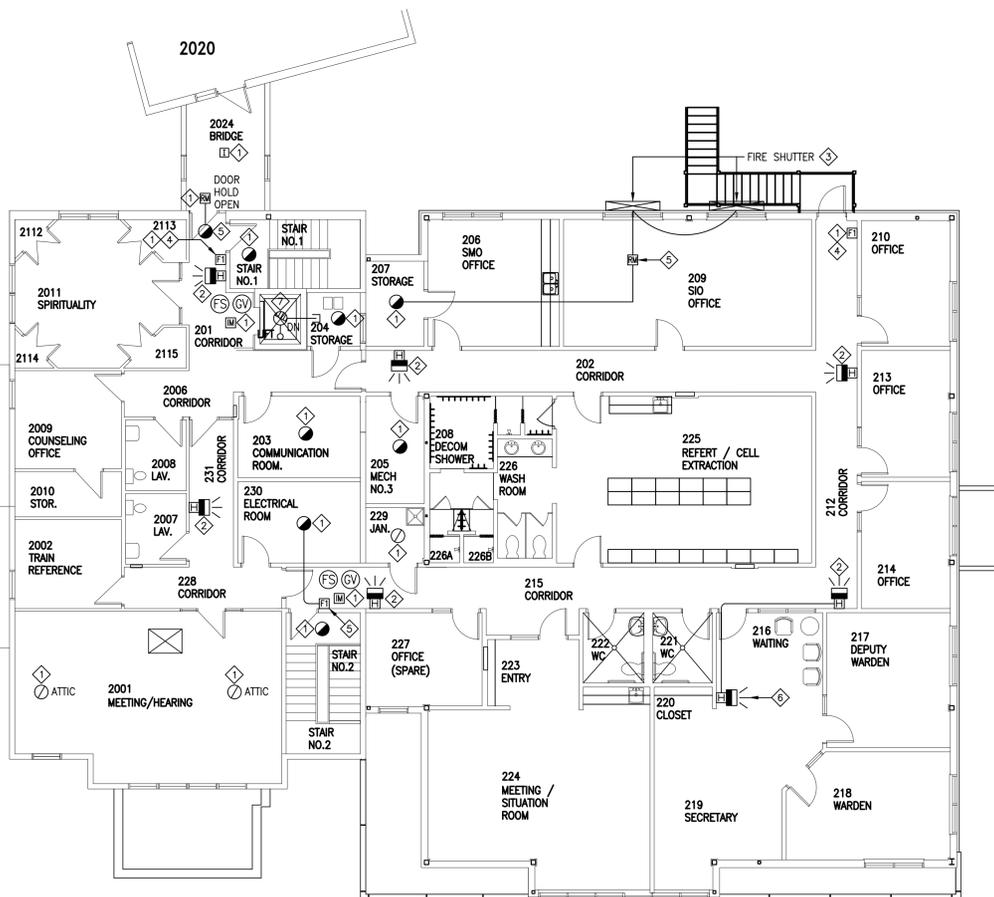

LEGEND

- | | | |
|--------------------------|-----------------------------|--------------------------------|
| 2001 - MEETING / HEARING | 201 - CORRIDOR | 218 - WARDEN |
| 2002 - TRAIN REFERENCE | 202 - CORRIDOR | 219 - SECRETARY |
| 2003 - WAITING | 203 - COMMUNICATION ROOM | 220 - CLOSET |
| 2004 - JANITOR | 204 - STORAGE | 221 - WASHROOM |
| 2006 - CORRIDOR | 205 - MECHANICAL ROOM NO. 3 | 222 - WASHROOM |
| 2007 - WASHROOM | 206 - SMO OFFICE | 223 - ENTRY |
| 2008 - WASHROOM | 207 - STORAGE | 224 - MEETING / SITUATION ROOM |
| 2009 - COUNCELING OFFICE | 208 - DECOM SHOWER | 225 - REFERT / CELL EXTRACTION |
| 2010 - STORAGE | 209 - SID OFFICE | 226 - WASHROOM |
| 2011 - SPIRITUALITY | 210 - OFFICE | 226A - SHOWER |
| 2012 - CLOSET | 212 - CORRIDOR | 226B - SHOWER |
| 2013 - CLOSET | 213 - OFFICE | 227 - SPARE OFFICE |
| 2014 - CLOSET | 214 - OFFICE | 228 - CORRIDOR |
| 2015 - CLOSET | 215 - CORRIDOR | 229 - JANITORIAL |
| 2024 - BRIDGE | 216 - WAITING | 230 - ELECTRICAL ROOM |
| | 217 - DEPUTY WARDEN | 231 - CORRIDOR |

SCALE: 1:100



1	ISSUED FOR TENDER	10/27/2020
---	-------------------	------------

revisions		date
-----------	--	------

project		project
---------	--	---------

**FIRE ALARM UPGRADE
NOVA INSTITUTION**

TRURO, NS

drawing		dessin
---------	--	--------

**MAIN BUILDING
SECOND FLOOR
FIRE ALARM PLAN**

designed	PM	conçu
----------	----	-------

date	MARCH 2020	
------	------------	--

drawn	BD	dessiné
-------	----	---------

date	MARCH 2020	
------	------------	--

approved	RGR	approuvé
----------	-----	----------

date	MARCH 2020	
------	------------	--

Tender		Soumission
--------	--	------------

PWGC Project Manager	Administrateur de projets TPSGC	
----------------------	---------------------------------	--

project number		no. du projet
----------------	--	---------------

R.089585.001

drawing no.		no. du dessin
-------------	--	---------------

E-4