



**GENERAL NOTES:**  
 EXISTING SIEMENS FIRE ALARM SYSTEMS TO BE REPLACED WITH NEW GENERATION ADDRESSABLE FIRE ALARM SYSTEM.  
 EXISTING INITIATING AND SIGNAL CIRCUIT WIRING IS TO BE MAINTAINED, UNLESS INDICATED OTHERWISE.  
 EXISTING SPRINKLER COMPONENTS ARE NOT TO BE MODIFIED, ONLY ADDRESSABLE MODULES ARE TO BE REPLACED UNLESS INDICATED OTHERWISE.


**FIRE ALARM NOTES:**  
 ◊ EXISTING INITIATING CIRCUIT DEVICE TO BE REPLACED WITH NEW DEVICE.  
 ◊ EXISTING BELL/STROBE SIGNAL CIRCUIT DEVICE TO BE REPLACED WITH NEW HORN/STROBE DEVICE.  
 ◊ EXISTING FIRE ALARM TRANSPONDER TO BE REPLACED WITH NEW TRANSPONDER.  
 ◊ RELOCATE EXISTING MANUAL PULL STATION SUCH THAT IT IS 1100mm ABOVE THE FINISHED FLOOR. REPAIR WALL AND REPAIR WALL FINISH TO MATCH EXISTING FINISH.  
 ◊ EXTEND EXISTING FIRE ALARM INITIATING CIRCUITRY TO NEW DEVICE.

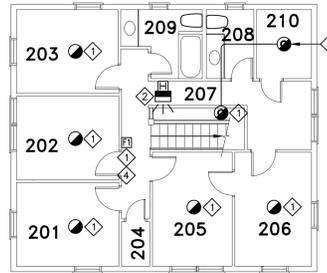


- HOUSE 1  
SECOND FLOOR LEGEND**
- 201 - BEDROOM
  - 202 - BEDROOM
  - 203 - BEDROOM
  - 204 - STORAGE
  - 205 - BEDROOM
  - 206 - BEDROOM
  - 207 - CORRIDOR
  - 208 - WASHROOM
  - 209 - BATHROOM
  - 210 - MECHANICAL

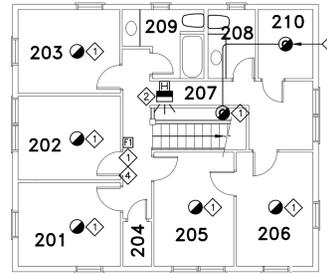


- HOUSE 2  
SECOND FLOOR LEGEND**
- 201 - BEDROOM
  - 202 - BEDROOM
  - 203 - BEDROOM
  - 204 - STORAGE
  - 205 - BEDROOM
  - 206 - BEDROOM
  - 207 - CORRIDOR
  - 208 - WASHROOM
  - 209 - BATHROOM
  - 210 - MECHANICAL

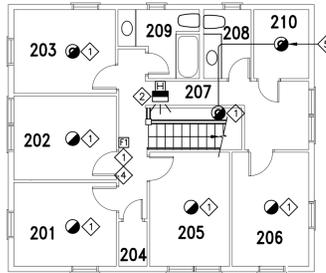


- HOUSE 3  
SECOND FLOOR LEGEND**
- 201 - BEDROOM
  - 202 - BEDROOM
  - 203 - BEDROOM
  - 204 - STORAGE
  - 205 - BEDROOM
  - 206 - BEDROOM
  - 207 - CORRIDOR
  - 208 - WASHROOM
  - 209 - BATHROOM
  - 210 - MECHANICAL

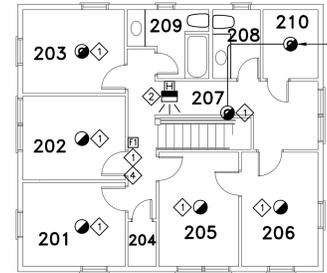


- HOUSE 4  
SECOND FLOOR LEGEND**
- 201 - BEDROOM
  - 202 - BEDROOM
  - 203 - BEDROOM
  - 204 - STORAGE
  - 205 - BEDROOM
  - 206 - BEDROOM
  - 207 - CORRIDOR
  - 208 - WASHROOM
  - 209 - BATHROOM
  - 210 - MECHANICAL

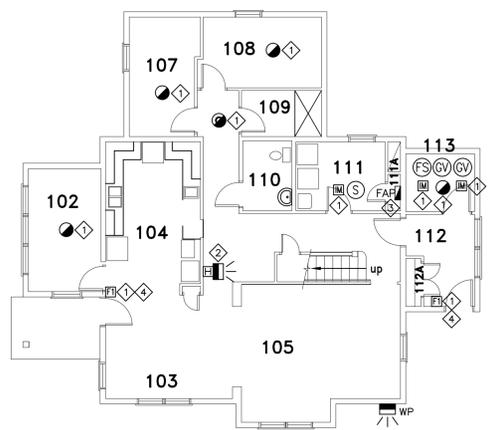


- HOUSE 1  
GROUND FLOOR LEGEND**
- 102 - SUN ROOM
  - 103 - DINING ROOM
  - 104 - KITCHEN
  - 105 - LIVING ROOM
  - 107 - BEDROOM
  - 108 - BEDROOM
  - 109 - BATHROOM
  - 110 - WASHROOM
  - 111 - LAUNDRY
  - 111A - CLOSET
  - 112 - VESTIBULE
  - 112A - CLOSET
  - 113 - ELECTRICAL

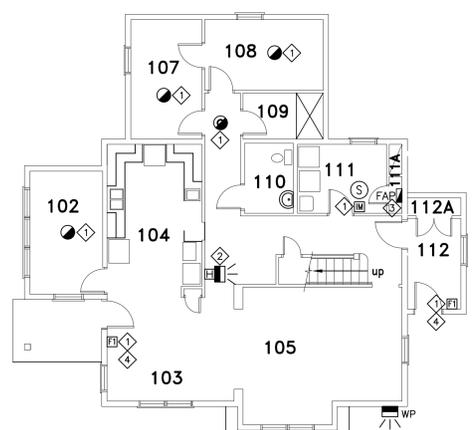

- HOUSE 2  
GROUND FLOOR LEGEND**
- 102 - SUN ROOM
  - 103 - DINING ROOM
  - 104 - KITCHEN
  - 105 - LIVING ROOM
  - 107 - BEDROOM
  - 108 - BEDROOM
  - 109 - BATHROOM
  - 110 - WASHROOM
  - 111 - LAUNDRY
  - 111A - CLOSET
  - 112 - VESTIBULE
  - 112A - CLOSET

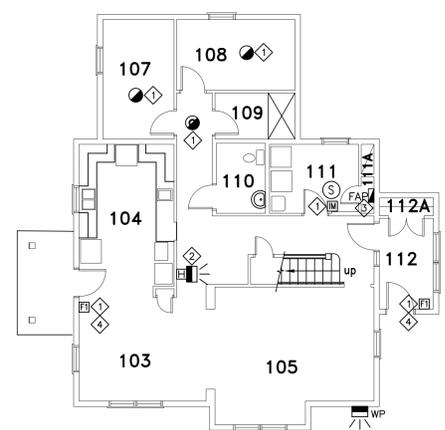

- HOUSE 3  
GROUND FLOOR LEGEND**
- 103 - DINING ROOM
  - 104 - KITCHEN
  - 105 - LIVING ROOM
  - 107 - BEDROOM
  - 108 - BEDROOM
  - 109 - BATHROOM
  - 110 - WASHROOM
  - 111 - LAUNDRY
  - 111A - CLOSET
  - 112 - VESTIBULE
  - 112A - CLOSET

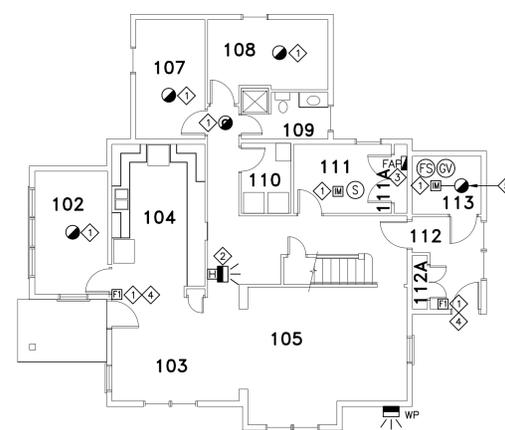

- HOUSE 4  
GROUND FLOOR LEGEND**
- 102 - SUN ROOM
  - 103 - DINING ROOM
  - 104 - KITCHEN
  - 105 - LIVING ROOM
  - 107 - BEDROOM
  - 108 - BEDROOM
  - 109 - BATHROOM
  - 110 - STORAGE
  - 111 - LAUNDRY
  - 111A - CLOSET
  - 112 - VESTIBULE
  - 112A - CLOSET
  - 113 - MECHANICAL



1	ISSUED FOR TENDER	10/27/2020
revisions		date

project: FIRE ALARM UPGRADE NOVA INSTITUTION

TRURO, NS

drawing: ROW HOUSE 1,2,3 & 4 GROUND AND SECOND FLOOR FIRE ALARM PLANS

designed	PM	conçu
date	MARCH 2020	
drawn	BD	dessiné
date	MARCH 2020	
approved	RGR	approuvé
date	MARCH 2020	
Tender		Soumission

PWGC Project Manager / Administrateur de projets TPSGC  
 project number / no. du projet: R.089585.001

drawing no. / no. du dessin: E-9