



**RETURN BIDS TO:**

**RETOURNER LES SOUMISSIONS À:**

Bid Receiving Public Works and Government  
Services Canada/Réception des soumissions Travaux  
publics et Services gouvernementaux Canada  
Cabot Place, Phase II, 2nd Floor  
Box 4600  
St. John's, NL  
A1C 5T2  
Bid Fax: (709) 772-4603

**SOLICITATION AMENDMENT  
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise  
indicated, all other terms and conditions of the Solicitation  
remain the same.

Ce document est par la présente révisé; sauf indication contraire,  
les modalités de l'invitation demeurent les mêmes.

**Comments - Commentaires**

**Vendor/Firm Name and Address**  
**Raison sociale et adresse du**  
**fournisseur/de l'entrepreneur**

**Issuing Office - Bureau de distribution**  
PWGSC / TPGSC - Nfld. Region  
Cabot Place, Phase II, 2nd Floor  
Box 4600  
St. John's, NL  
A1C 5T2

<b>Title - Sujet</b> DND Workplace Furniture	
<b>Solicitation No. - N° de l'invitation</b> EB129-211701/A	<b>Amendment No. - N° modif.</b> 002
<b>Client Reference No. - N° de référence du client</b> EB129-211701	<b>Date</b> 2021-01-13
<b>GETS Reference No. - N° de référence de SEAG</b> PW-\$XAQ-027-7534	
<b>File No. - N° de dossier</b> XAQ-0-43122 (027)	<b>CCC No./N° CCC - FMS No./N° VME</b>
<b>Solicitation Closes - L'invitation prend fin</b> <b>at - à 02:00 PM</b> Newfoundland Standard Time NST <b>on - le 2021-01-14</b> Heure Normale de Terre-Neuve HNT	
<b>F.O.B. - F.A.B.</b> <b>Plant-Usine:</b> <input type="checkbox"/> <b>Destination:</b> <input checked="" type="checkbox"/> <b>Other-Autre:</b> <input type="checkbox"/>	
<b>Address Enquiries to: - Adresser toutes questions à:</b> Walsh, Heather	<b>Buyer Id - Id de l'acheteur</b> xaq027
<b>Telephone No. - N° de téléphone</b> (709) 631-1853 ( )	<b>FAX No. - N° de FAX</b> ( ) -
<b>Destination - of Goods, Services, and Construction:</b> <b>Destination - des biens, services et construction:</b> Department of National Defence 84-86 Elizabeth Avenue, Regatta Plaza II, St. John's, NL A1B2E6	

**Instructions: See Herein**

**Instructions: Voir aux présentes**

<b>Delivery Required - Livraison exigée</b>	<b>Delivery Offered - Livraison proposée</b>
<b>Vendor/Firm Name and Address</b> <b>Raison sociale et adresse du fournisseur/de l'entrepreneur</b>	
<b>Telephone No. - N° de téléphone</b> <b>Facsimile No. - N° de télécopieur</b>	
<b>Name and title of person authorized to sign on behalf of Vendor/Firm</b> <b>(type or print)</b> <b>Nom et titre de la personne autorisée à signer au nom du fournisseur/</b> <b>de l'entrepreneur (taper ou écrire en caractères d'imprimerie)</b>	
<b>Signature</b>	<b>Date</b>

Solicitation No. - N° de l'invitation  
EB129-211701/A  
Client Ref. No. - N° de réf. du client  
EB129-211701

Amd. No. - N° de la modif.  
002  
File No. - N° du dossier  
XAQ-0-43122

Buyer ID - Id de l'acheteur  
xaq027  
CCC No./N° CCC - FMS No./N° VME

## CONTRACT AMENDMENT 002

\*\*\*\*\*  
\*\*\*\*\*

THE FOLLOWING AMENDMENT TO THE CONTRACT DOCUMENTS IS  
EFFECTIVE IMMEDIATELY. THE AMENDMENT SHALL FORM A PART OF  
THE CONTRACT DOCUMENTS.

### Questions and Answers:

Q1: Re CAT6B NSA line # 42


- a) would an all laminate panel system application that carries power/data through a base raceway be acceptable as long as power/data can be carried up to the worksurface.

PSPC Response: And all laminate product that carries power/data through a base raceway is acceptable as long as wire management systems is provided to carry power and data to the desktop to ensure cables are easily accessible and tight to the systems to ensure clear space under the desk for the end user.

- b) ADA defines an accessible table has a surface height of no more than 34 inches and no less than 28 inches above the floor. A wheelchair will fit with a clearance of 28"H, would this be acceptable given the total width of the accessible surface is barrier free to fit a wheelchair?

PSPC Response: The CAN/CSA B651-18 standard states a 680 mm min distance from the floor to the underside of the counter. The countertop must be in the range of 810-860mm high from the floor. These requirements must be met to be acceptable.

*Barrier-Free Design*

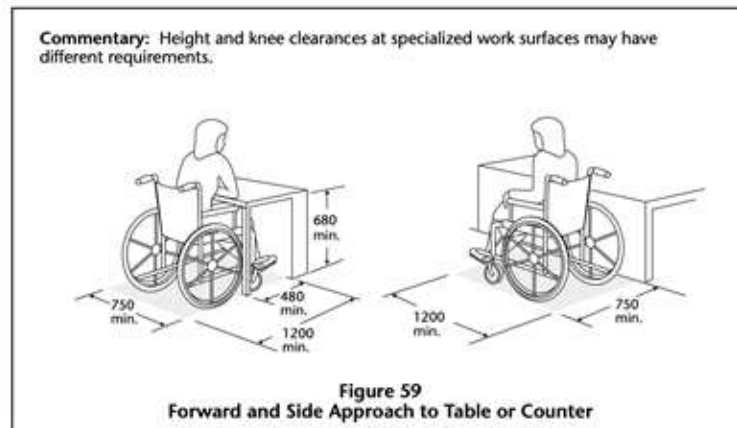

**8.2 Viewing Positions**

Each wheelchair viewing position shall be a clear, level ground or floor area of at least 850 × 120mm.

Q2: Can you please provide a floor plan to understand how to specify CAT6B NSA items 42 and especially 43. This is essential to the parts and hardware required.

PSPC Response: The floor plan was provided with the tender documentation. See Rooms 103 for product items #42 Desk #02 and Room 101 for items #43 Desk #01

\*\*\*\*\*  
\*\*\*\*\*

ALL OTHER TERMS AND CONDITIONS REMAIN UNCHANGED.

\*\*\*\*\*  
\*\*\*\*\*