



RETURN BIDS TO:

RETOURNER LES SOUMISSIONS À:

Bid Receiving - PWGSC / Réception des soumissions -
TPSGC

11 Laurier St./11 rue Laurier

Place du Portage, Phase III

Core 0B2 / Noyau 0B2

Gatineau, Québec K1A 0S5

**SOLICITATION AMENDMENT
MODIFICATION DE L'INVITATION**

The referenced document is hereby revised; unless otherwise
indicated, all other terms and conditions of the Solicitation
remain the same.

Ce document est par la présente révisé; sauf indication contraire,
les modalités de l'invitation demeurent les mêmes.

Comments - Commentaires

Vendor/Firm Name and Address

Raison sociale et adresse du
fournisseur/de l'entrepreneur

Issuing Office - Bureau de distribution

Construction Services Division/Division des services de
construction

140 O'Connor Street

140, rue O'Connor

Ontario

Ottawa

K1A 0S5

Title - Sujet Bay 3 Refit	
Solicitation No. - N° de l'invitation 9F023-200546/A	Amendment No. - N° modif. 007
Client Reference No. - N° de référence du client 20200546	Date 2022-01-06
GETS Reference No. - N° de référence de SEAG PW-\$\$\$FG-380-80685	
File No. - N° de dossier fg380.9F023-200546	CCC No./N° CCC - FMS No./N° VME
Solicitation Closes - L'invitation prend fin at - à 02:00 PM Eastern Standard Time EST on - le 2022-01-21 Heure Normale du l'Est HNE	
F.O.B. - F.A.B. Plant-Usine: <input type="checkbox"/> Destination: <input type="checkbox"/> Other-Autre: <input type="checkbox"/>	
Address Enquiries to: - Adresser toutes questions à: Turner, Jason	Buyer Id - Id de l'acheteur fg380
Telephone No. - N° de téléphone (343) 574-2818 ()	FAX No. - N° de FAX () -
Destination - of Goods, Services, and Construction: Destination - des biens, services et construction:	

Instructions: See Herein

Instructions: Voir aux présentes

Delivery Required - Livraison exigée	Delivery Offered - Livraison proposée
Vendor/Firm Name and Address Raison sociale et adresse du fournisseur/de l'entrepreneur	
Telephone No. - N° de téléphone Facsimile No. - N° de télécopieur	
Name and title of person authorized to sign on behalf of Vendor/Firm (type or print) Nom et titre de la personne autorisée à signer au nom du fournisseur/ de l'entrepreneur (taper ou écrire en caractères d'imprimerie)	
Signature	Date

The following changes to the tender documents are effective immediately.

This amendment will form part of the contract documents.

Amendment 007 is issued for the following:

(1) Questions and Answers

Question 1: Section 26 05 00, 3.4.5 mentions hot spot testing. Is this required?

Answer 1: Yes, hot spot testing is required as part of the quality assurance.

Question 2: Hoarding – What exactly needs to be hoarded up? A section in front of the mechanical wall? Can we do a floor to ceiling barrier in front of the mechanical wall?

Answer 2: The areas outside of the construction zone inside Bay 3 will need to be protected from construction activities (ex. dust, smoke, and debris etc.) as part of the hoarding. The construction of the floor to ceiling tarp barrier inside Bay 3 in front of the mechanical wall will need to meet the project specification and requirement.

Question 3: Louvre Curb – what material is the curb to be constructed of? 1/M02 shows details of the roof construction but not the curb materials.

Answer 3: Refer to specification section 23 37 20 - Louvres

Question 4: Need to know who the fire alarm service company is that takes care of this building?

Answer 4: Refer to Specification Section 28 31 00 Fire Detection and Alarm – 1.5 Designated Contractor.

Question 5: For panel M6-1-SP we need to know the make and model of the panel and the KA rating of the two 150 amp breakers.

Answer 5: Please see photos below.

Solicitation No. - N° de l'invitation
9F023-200546

Amd. No. - N° de la modif.
007

Buyer ID - Id de l'acheteur
FG 380

Client Ref. No. - N° de réf. du client

File No. - N° du dossier

CCC No./N° CCC - FMS No./N° VME



Solicitation No. - N° de l'invitation
9F023-200546


Amd. No. - N° de la modif.
007

Buyer ID - Id de l'acheteur
FG 380

Client Ref. No. - N° de réf. du client

File No. - N° du dossier

CCC No./N° CCC - FMS No./N° VME

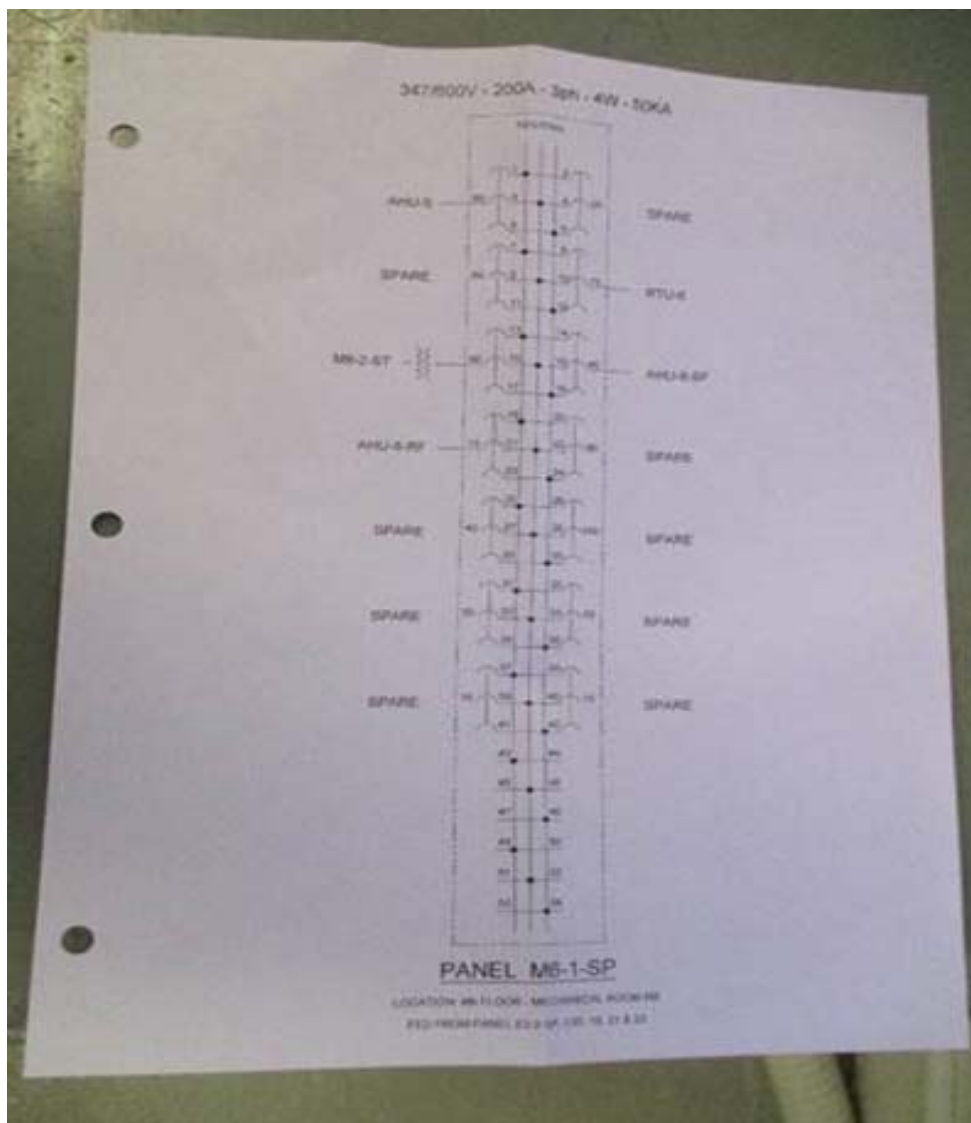

Solicitation No. - N° de l'invitation
9F023-200546

Amd. No. - N° de la modif.
007

Buyer ID - Id de l'acheteur
FG 380

Client Ref. No. - N° de réf. du client

File No. - N° du dossier

CCC No./N° CCC - FMS No./N° VME



Question 6: Is there an insulation specs available for the tender?

Answer 6: Refer to specification section 23 31 13 – Metal Ducts – High Pressure to 2500 Pa. As per note 15 on M08 and note 9 on M09, unless otherwise indicated, ductwork shall be c/w thermal insulation, jacket and tagging.

Question 7: Is cooling coil for each AHU shipped loosed to be installed in bypass duct? If so, it is unclear on the drawings where these bypass ducts go. Are there two AHU openings, and this duct connects only to the AHU's?

Answer 7: Cooling coils are located in the AHUs. AHUs have two openings on top and the bypass ductwork shall connect the two openings to bypass the cooling coil in the AHU.

Question 8: Can you clarify if trucks will be able to drive to the loading dock to unload/load material and equipment?

Answer 8: Yes, request for deliveries to unload materials at the DFL building (ex. Large Loading Dock) for construction is required to be submitted a minimum of 48 hours in advance. The delivery company name and a description of goods will need to be provided at the time of request.

Solicitation No. - N° de l'invitation
9F023-200546

Amd. No. - N° de la modif.
007

Buyer ID - Id de l'acheteur
FG 380

Client Ref. No. - N° de réf. du client

File No. - N° du dossier

CCC No./N° CCC - FMS No./N° VME

ALL OTHER TERMS AND CONDITIONS REMAIN THE SAME