

R.100644.001 Joyceville Institution Dairy Facility and Livestock Barn Project

Subject: Electrical service question


Ref: Issued for Tender Drawing Set 01, Sheet E-1.1.


Screen capture from Joyceville Institution Site Services Master Plan dated 2016-12-30

Please see also .pdf files for building floor plan and Site Services Master Plan


Electrical feed West side of building, Room 105 north wall for the 600 volt panel which has a spare 600 volt, 600 amp breaker.

NTS. All dimensions and services to be confirmed by Contractor on site.

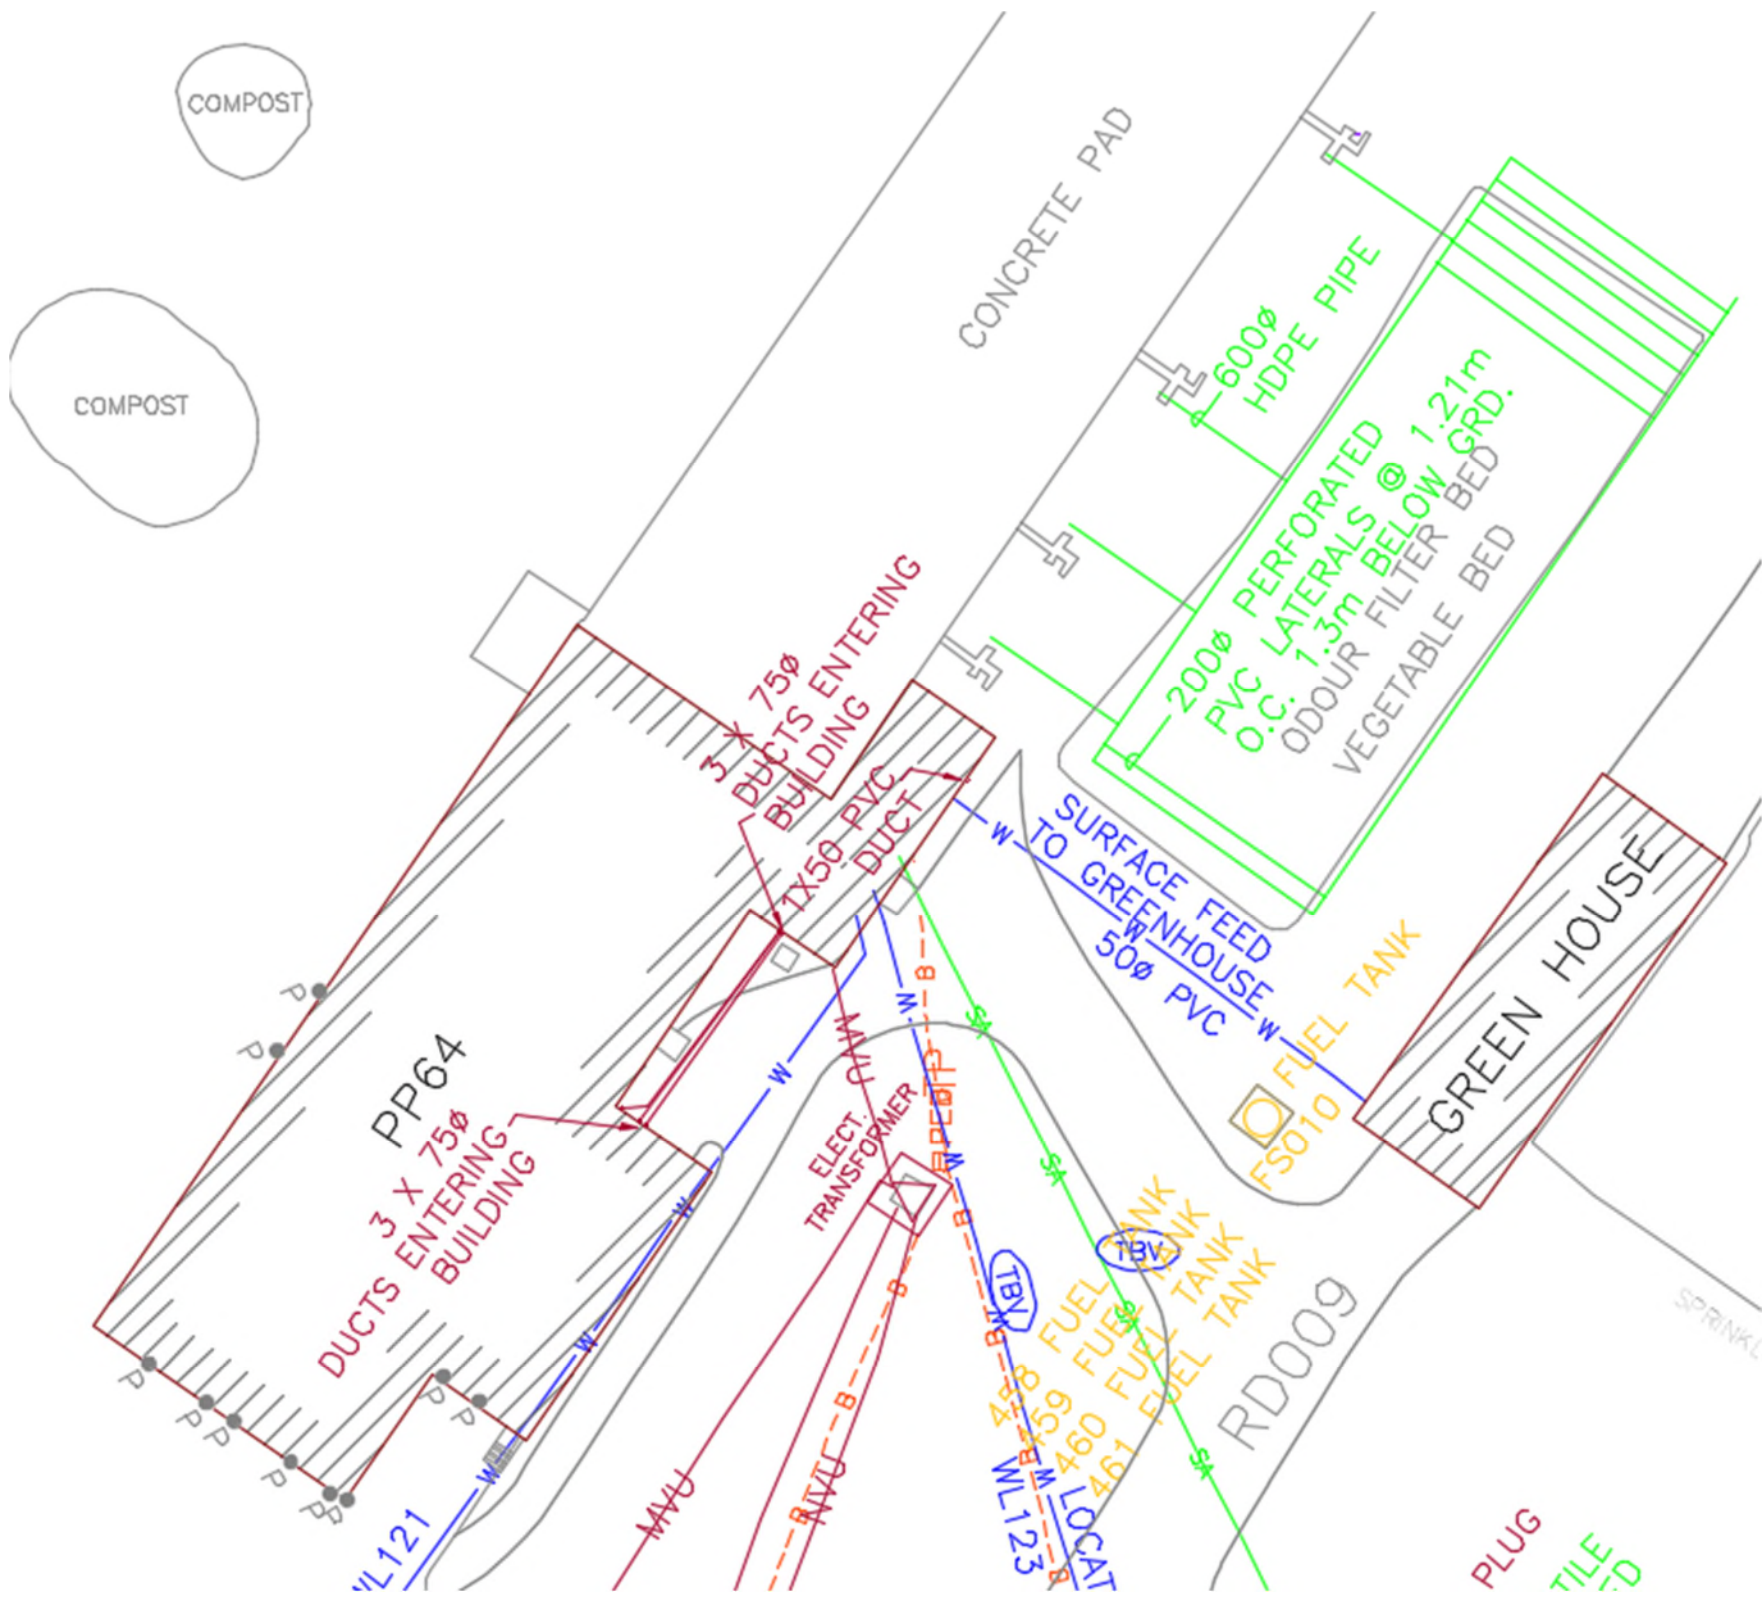



MAXIMUM NUMBER OF PERSONS
NORMALLY OCCUPYING THIS
SPACE IS _____

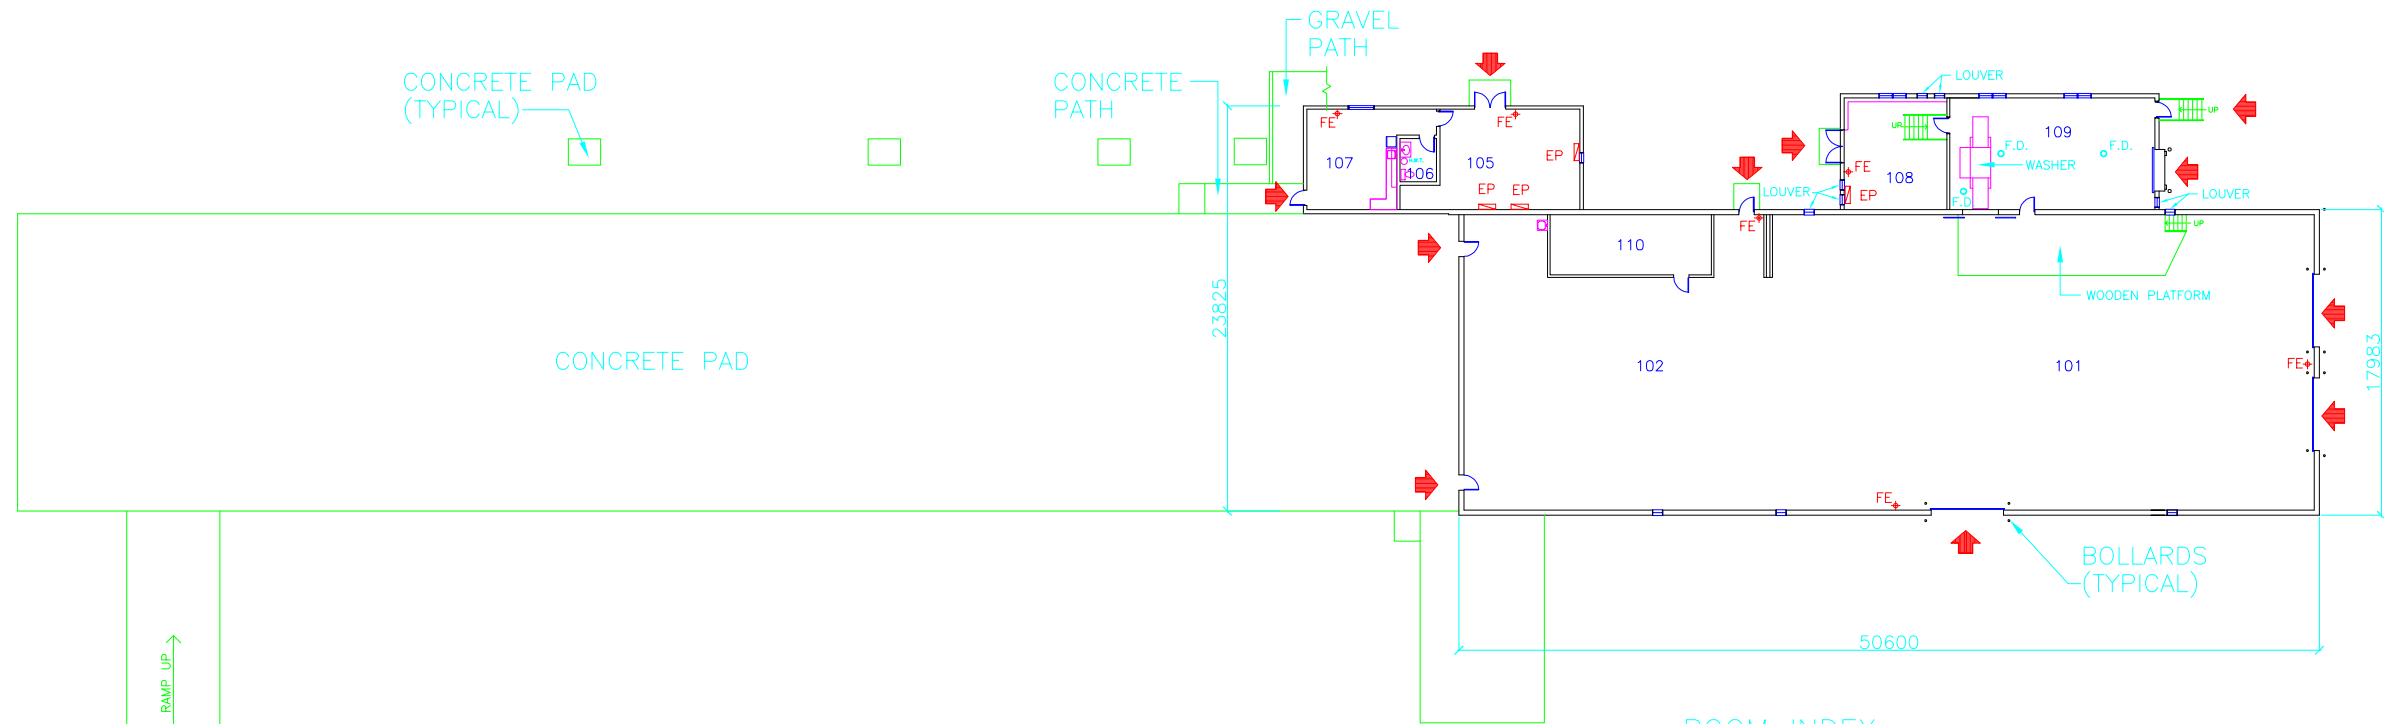

LEGEND

- ENTRANCE
- PS PULL STATION
- FE FIRE EXTINGUISHER
- SIAMESE CONNECTION
- FHC FIRE HOSE CABINET
- FHC/FE FIRE HOSE CABINET C/W FIRE EXTINGUISHER
- FHR FIRE HOSE REEL
- EP ELECTRICAL PANEL
- FAP FIRE ALARM PANEL
- CP COMMUNICATION PANEL

ROOM INDEX

- 101 WASTE RECEIVING
- 102 MIXING AREA
- 105 MCC ROOM
- 106 WASHROOM
- 107 LAB
- 108 UTILITY/STORAGE ROOM
- 109 WASH ROOM
- 110 HOLDING TANK ROOM

FIRST FLOOR PLAN

