

GENERAL NOTES - LIGHTING

- A THESE DRAWINGS AND SPECIFICATIONS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL, INTERIOR DESIGNER'S, MECHANICAL, AND OTHER DIVISIONS DRAWINGS. ALL ELECTRICAL WORK SHALL COMPLY WITH OWNER'S REQUIREMENTS AND BASE BUILDING STANDARDS.
- B "AS REQUIRED, MAKE OPERATIONAL" - DENOTES ELECTRICAL INSTALLATION TO SUIT SITE CONDITIONS, TO CONFORM WITH THE REQUIREMENTS OF ALL APPLICABLE CODES AND STANDARDS AND INSTALLATION TO INCLUDE ALL NECESSARY MATERIAL, EQUIPMENT AND LABOUR (ALTHOUGH NOT SHOWN ON THE DRAWINGS) TO MAKE IT OPERATIONAL. NO ALLOWANCES WILL BE MADE SUBSEQUENTLY FOR ANY CONSIDERATIONS OVERLOOKED.
- C UNLESS NOTED OTHERWISE ALL WIRING AND CONDUITS TO BE CONCEALED.
- D ALL ELECTRICAL EQUIPMENT (LIGHTING FIXTURES, POWER EQUIPMENT AND CABLES) OR ANY OTHER CONTRIVANCE THAT GENERATES EITHER ELECTROMAGNETIC FIELD OR ELECTROMAGNETIC INTERFERENCE ARE TO BE KEPT AT LEAST 12" AWAY FROM THE COMMUNICATION CABLE TRAYS. INSTALL ELECTRICAL EQUIPMENT AND CABLES TO CONFORM TO THE ABOVE EQUIREMENTS.

GENERAL NOTES - LIGHTING

- F UNLESS NOTED OTHERWISE ALL CIRCUIT NUMBERS SHOWN ARE FOR GROUPING PURPOSES ONLY. SHOW ACTUAL CIRCUIT NUMBERS ON AS-BUILT DRAWINGS.
- G FOR EXACT LOCATION OF LIGHTING FIXTURES REFER TO ARCHITECTURAL/INTERIOR DESIGNER'S REFLECTED CEILING PLANS. REPORT TO ENGINEER OF ANY DISCREPANCIES BETWEEN ELECTRICAL LIGHTING DRAWINGS AND ARCHITECTURAL/INTERIOR DESIGNER'S REFLECTED CEILING PLANS. OBTAIN ENGINEER'S APPROVAL BEFORE PROCEEDING. REFER TO INTERIOR ELEVATION DRAWINGS FROM ARCHITECTURAL/INTERIOR DESIGNER PACKAGE FOR MOUNTING HEIGHT OF WALL FIXTURES.
- H ALL EMERGENCY LIGHTING TO BE EQUIPPED WITH EMERGENCY OVERRIDE RELAY TO BYPASS ANY LOCAL SWITCHING OR DIMMING. REFER TO DETAIL 7 ON DRAWING E02-01-01
- I ALL EXIT SIGNS IN THE BUILDING TO BE NEW GREEN PICTOGRAM EXIT SIGNS. REPLACE WITH NEW ALL EXISTING EXIT SIGNS IN THE BUILDING INCLUDING AREAS WHERE EXISTING LIGHTING IS TO REMAIN.

DRAWING KEYNOTES


- L1 LUMINAIRES WITHIN BOUNDARIES INDICATED ON PLANS ARE TO BE CONNECTED NORMAL BRANCH CIRCUIT NOTED UNLESS DESIGNATED. BY HATCH PATTERN AS EMERGENCY LIGHTING WHICH ARE TO BE CONNECTED TO LIFE-SAFETY BRANCH CIRCUIT AS INDICATED. EXIT SIGN IS TO BE FED FROM THE SAME EMERGENCY LIGHTING CIRCUIT IN THE AREA WHERE THE EXIT SIGN IS INSTALLED.

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m


NORR

NORR Architects & Engineers Limited
An Ingenium Group Company
175 Bloor St. East
North Tower, 15th Floor
Toronto, ON Canada M4W 3R8
norr.com


key plan

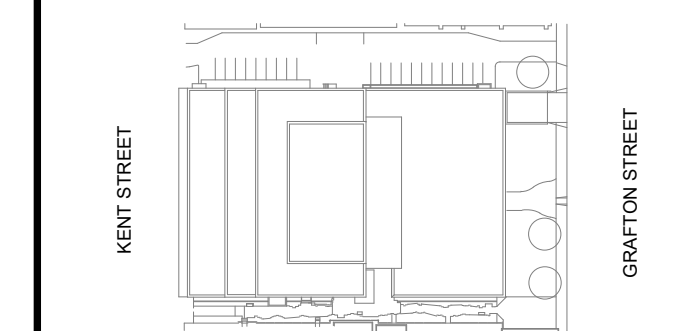

project and true North

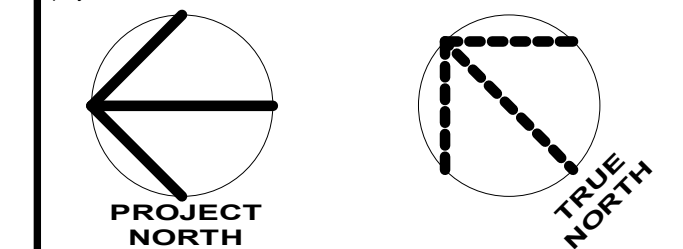

project legend

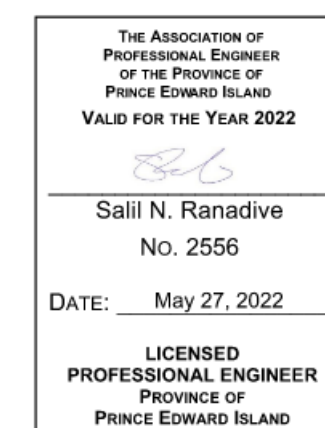

0 ISSUED FOR TENDER 2022-05-27

revisions date

project project

DANIEL J MACDONALD
MODERNIZATION

161 GRAFTON STREET
CHARLOTTETOWN, PEI, C1A 1L1

drawing dessin

**LIGHTING PLAN -
PENTHOUSE FLOOR**

designed NORR compu

date 12/21/18

drawn NORR dessiné

date 12/21/18

approved SR approuvé

date 2022-05-27

Tender Soumission

PWGSC Project Manager Administrateur de projets TPSCG

project number no. du projet

R.056687.005

drawing no. no. du dessin

E20-06