

0	ISSUED FOR TENDER	2022-05-27
revisions		date

project project


# DANIEL J MACDONALD MODERNIZATION

161 GRAFTON STREET CHARLOTTETOWN, PEI, C1A 1L1	
drawing	dessin
LIGHTING PLAN - THIRD FLOOR	

designed	NORR	conçu
date	12/21/18	
drawn	NORR	dessiné
date	12/21/18	
approved	SR	approuvé
date	2022-05-27	
Tender	Soumission	
PWGSC Project Manager    Administrateur de projets TPSCG		
project number	no. du projet	

R.056687.005

drawing no.	no. du dessin
E20-03	

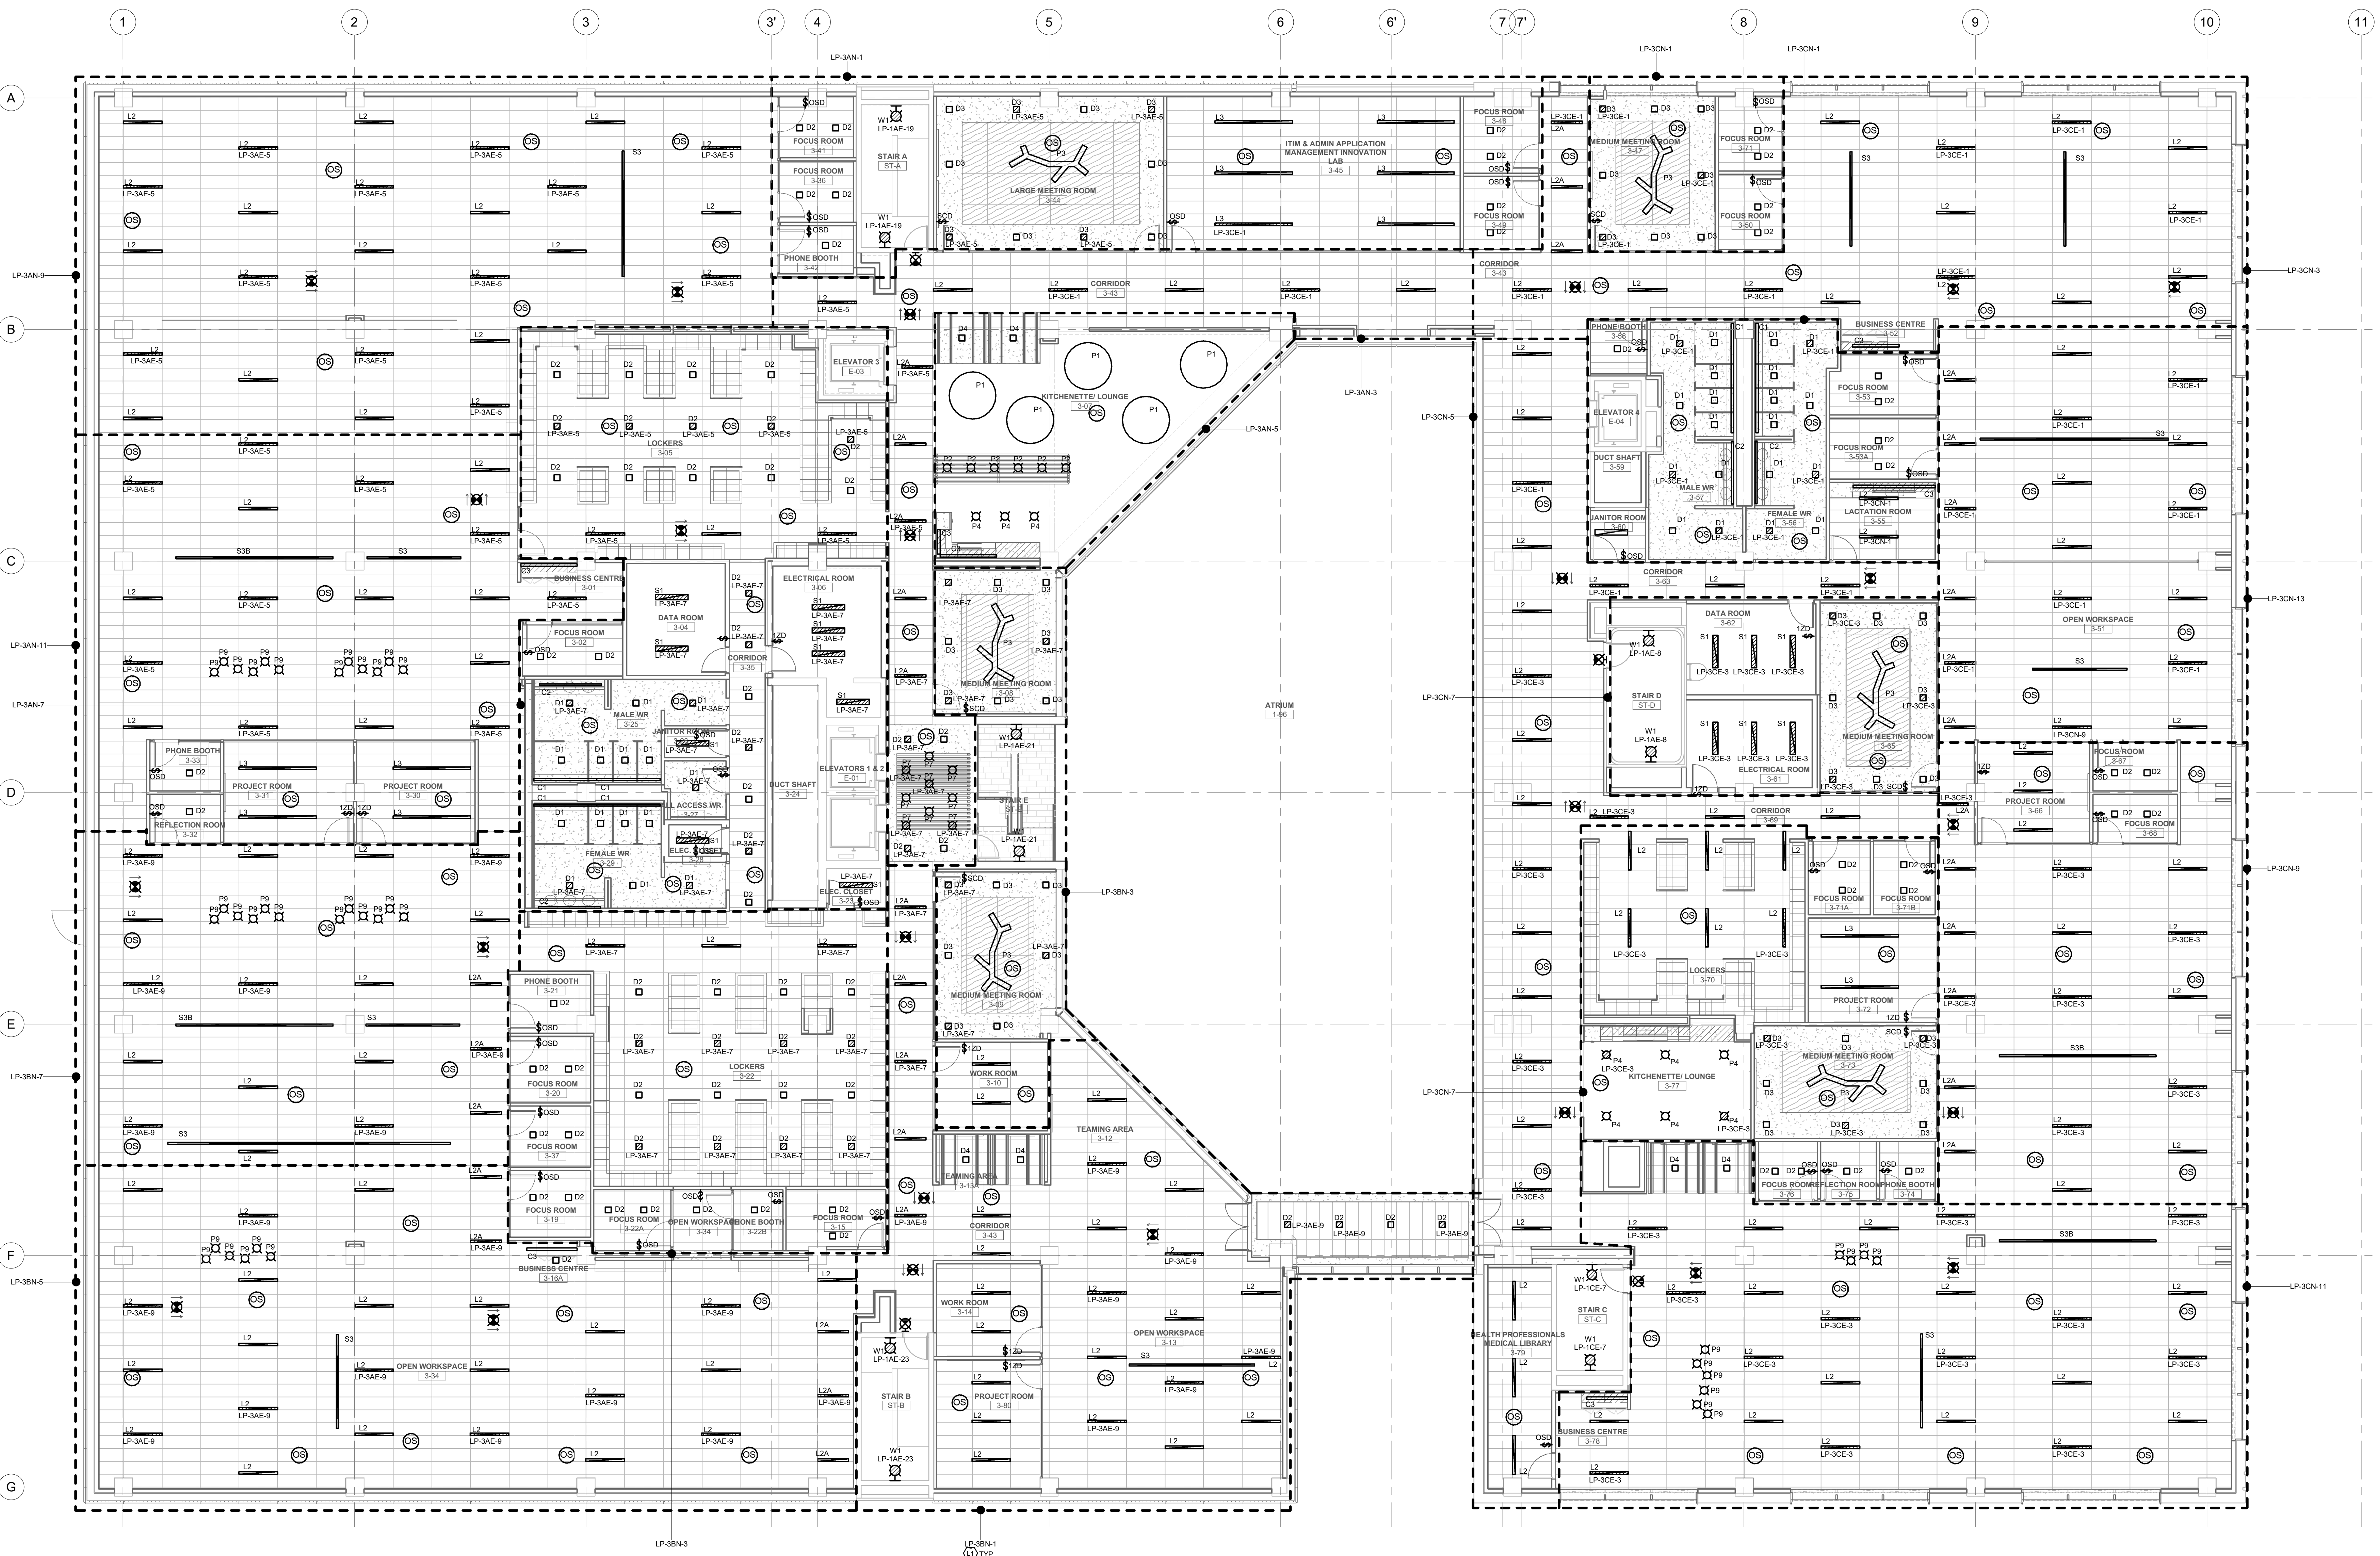

SCALE : 1:100



### GENERAL NOTES - LIGHTING

3. THESE DRAWINGS AND SPECIFICATIONS TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, STRUCTURAL, INTERIOR DESIGNER'S, MECHANICAL, AND OTHER DRAWINGS. THE DRAWING SHALL BE USED TO DETERMINE THE ELECTRICAL REQUIREMENTS AND BASE BUILDING STANDARDS.
4. **AS REQUIRED, MAKE OPERATIONAL -** DENOTES ELECTRICAL INSTALLATION TO SUIT THE CONDITIONS, REQUIREMENTS, AND PRESENTS OF ALL APPLICABLE CODES AND STANDARDS AND INSTALLATION TO INCLUDE ALL NECESSARY MATERIAL, LABOR, AND LABORERS. THE INSTALLATION SHALL BE MADE IN ACCORDANCE WITH OPERATIONAL. NO ALLOWANCES WILL BE MADE SUBSEQUENTLY FOR ANY MODIFICATIONS OR OMISSIONS.
5. **UNLESS NOTED OTHERWISE** ALL WIRING AND CONDUITS TO BE CONCEALED.
6. ALL ELECTRICAL EQUIPMENT (LIGHTING FIXTURES, POWER EQUIPMENT AND CABLES) AND ALL OTHER CODES SHALL BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE. ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED TO PREVENT OR MINIMIZE RADIO OR ELECTROMAGNETIC INTERFERENCE ARE TO BE KEPT AT LEAST 12" AWAY FROM THE COMMUNICATION CABLE TRAYS. INSTALL ELECTRICAL EQUIPMENT AND CABLES IN ACCORDANCE TO THE FOLLOWING:

### GENERAL NOTES - LIGHTING

- |   |   |
|---|---|
| F | UNLESS NOTED OTHERWISE ALL CIRCUIT NUMBERS SHOWN ARE FOR GROUPING PURPOSES ONLY. SHOW ACTUAL CIRCUIT NUMBERS ON AS-BUILT DRAWINGS.  |
| G | FOR EXACT LOCATION OF LIGHTING FIXTURES REFER TO ARCHITECTURAL INTERIOR DESIGNER'S REFLECTED CEILING PLANS. REPORT TO ENGINEER OF ANY DISCREPANCIES BEFORE PROCEEDING. REPORT TO ARCHITECTURAL INTERIOR DESIGNER'S REFLECTED CEILING PLANS. OBTAIN ENGINEER'S APPROVAL BEFORE PROCEEDING. REFER TO INTERIOR ELEVATION DRAWINGS FROM ARCHITECTURAL INTERIOR DESIGNER PACKAGE FOR MOUNTING HEIGHT OF WALL FIXTURES. |
| H | ALL EMERGENCY LIGHTING TO BE EQUIPPED WITH EMERGENCY OVERRIDE RELAY TO BYPASS ANY LOCAL SWITCHING OR DIMMING. REFER TO DETAIL 7 ON DRAWING EDO-01-01.   |
| I | ALL EXIT SIGNS IN THE BUILDING TO BE NEW GREEN PICTOGRAM EXIT SIGNS. REPLACE WITH NEW ALL EXISTING EXIT SIGNS IN THE BUILDING INCLUDING AREAS WHERE EXISTING LIGHTING IS TO REMAIN.   |

## DRAWING KEYNOTES

- |    |  |
|----|--|
| L1 | LUMINAIRES WITHIN BOUNDARIES INDICATED ON PLANS ARE TO BE CONNECTED NORMAL BRANCH CIRCUIT NOTED UNLESS DESIGNATED, BY HATCH PATTERN AS EMERGENCY LIGHTING WHICH ARE TO BE CONNECTED TO LIFE-SAFETY BRANCH CIRCUIT AS INDICATED. EXIT SIGN TO BE FED FROM THE SAME EMERGENCY LIGHTING CIRCUIT IN THE AREA WHERE THE EXIT SIGN IS INSTALLED. |
|----|--|