



NOTES:

1. PROVIDE ONE DEDICATED POWER CONDUIT AND ONE OR TWO DEDICATED LOW VOLTAGE CONDUIT FROM CEILING JUNCTION BOX TO EACH FLOOR BOX. REFER TO FLOOR BOX SCHEDULE FOR EXACT CONDUIT QUANTITY AND SIZE.
2. MOUNT RECEPTACLES IN PARTIAL HEIGHT WALL AT 850mm A.F.F. CO-ORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECTURAL.
3. PROVIDE POWER CONNECTION TO SINK AND TOILET SENSOR POWER SUPPLIES. CONFIRM EXACT REQUIREMENTS WITH MECHANICAL PRIOR TO INSTALLATION. ALL SENSOR POWER SUPPLIES LOCATED IN THE SAME ROOM TO BE SUPPLIED BY SINGLE CIRCUIT.
4. MOUNT RECEPTACLES AT 900mm A.F.F. ROUTE CONDUIT AND WIRING THROUGH BULKHEAD ABOVE. CO-ORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECTURAL.
5. MOUNT RECEPTACLES IN PARTIAL HEIGHT WALL AT 980mm A.F.F. CO-ORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECTURAL.
6. FEED RECEPTACLES USING UNDERSLAB CONDUITS.
7. PROVIDE POWER CONNECTION TO OPERABLE PARTITION. CONFIRM EXACT ELECTRICAL REQUIREMENTS WITH ARCHITECTURAL PRIOR TO INSTALLATION.
8. CONTRACTOR TO ENSURE REPLACEMENT COLUMN RECEPTACLES ARE INSTALLED AT 400mm A.F.F. MINIMUM.
9. SEE FLOOR BOX SCHEDULE ON DRAWING EPC-201 FOR FLOOR BOX SPECIFICATIONS AND ASSOCIATED CONDUIT DETAILS. CO-ORDINATE EXACT FLOOR BOX LOCATIONS WITH ARCHITECTURAL PRIOR TO INSTALLATION.




1	ISSUED FOR CONSTRUCTION	9 JULY 2021
0	ISSUED FOR TENDER	30 APR 2021
revisions		date
project		project

DOMINION PUBLIC BUILDING
1713 BEDFORD ROW
INTERIOR RENOVATIONS
HALIFAX, NS



ELECTRICAL
LEVEL 4
POWER & COMMS PLAN

designed TC	concur
date NOV 2018	
drawn SDC	designé
date APR 2019	
approved	approuvé
date	
Tender	Soumission
PM/SGC Project Manager	Administrateur de projets TP/SGC
project number	no. du projet
R.063820.006	
drawing no.	no. du dessin
EPC-104	

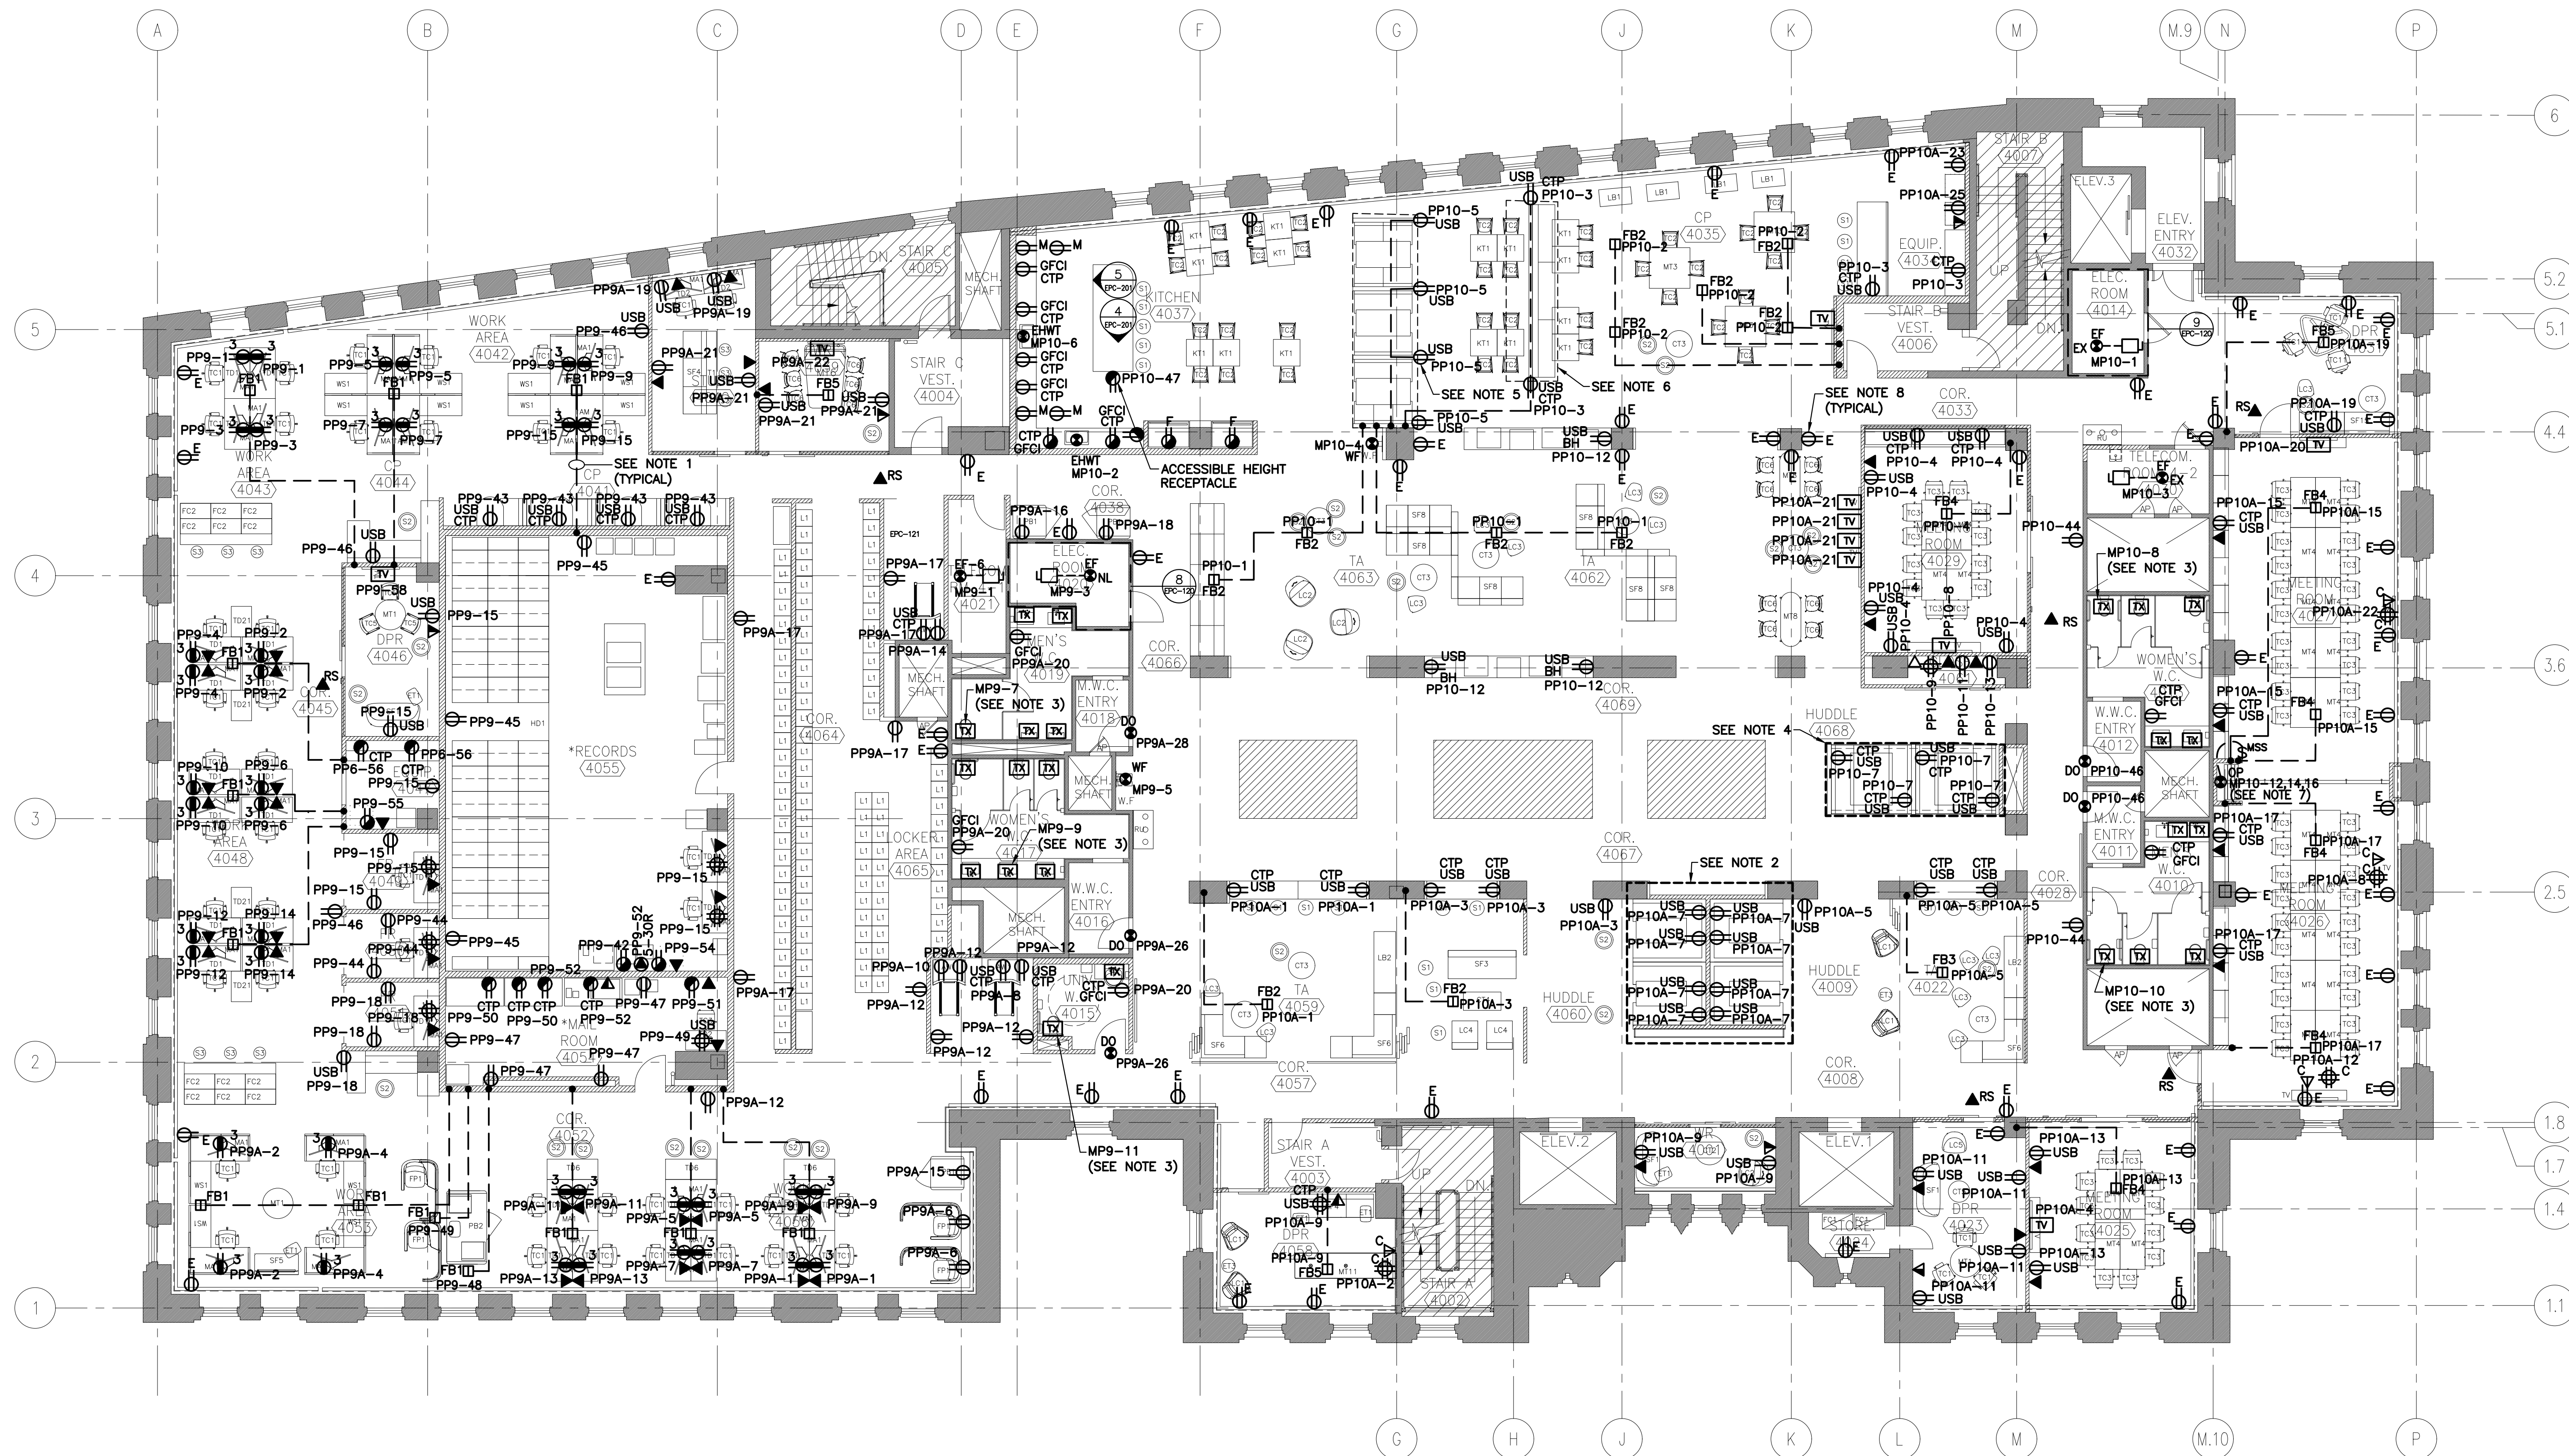


POWER & COMMS PLAN – LEVEL 4
SCALE : 1:100



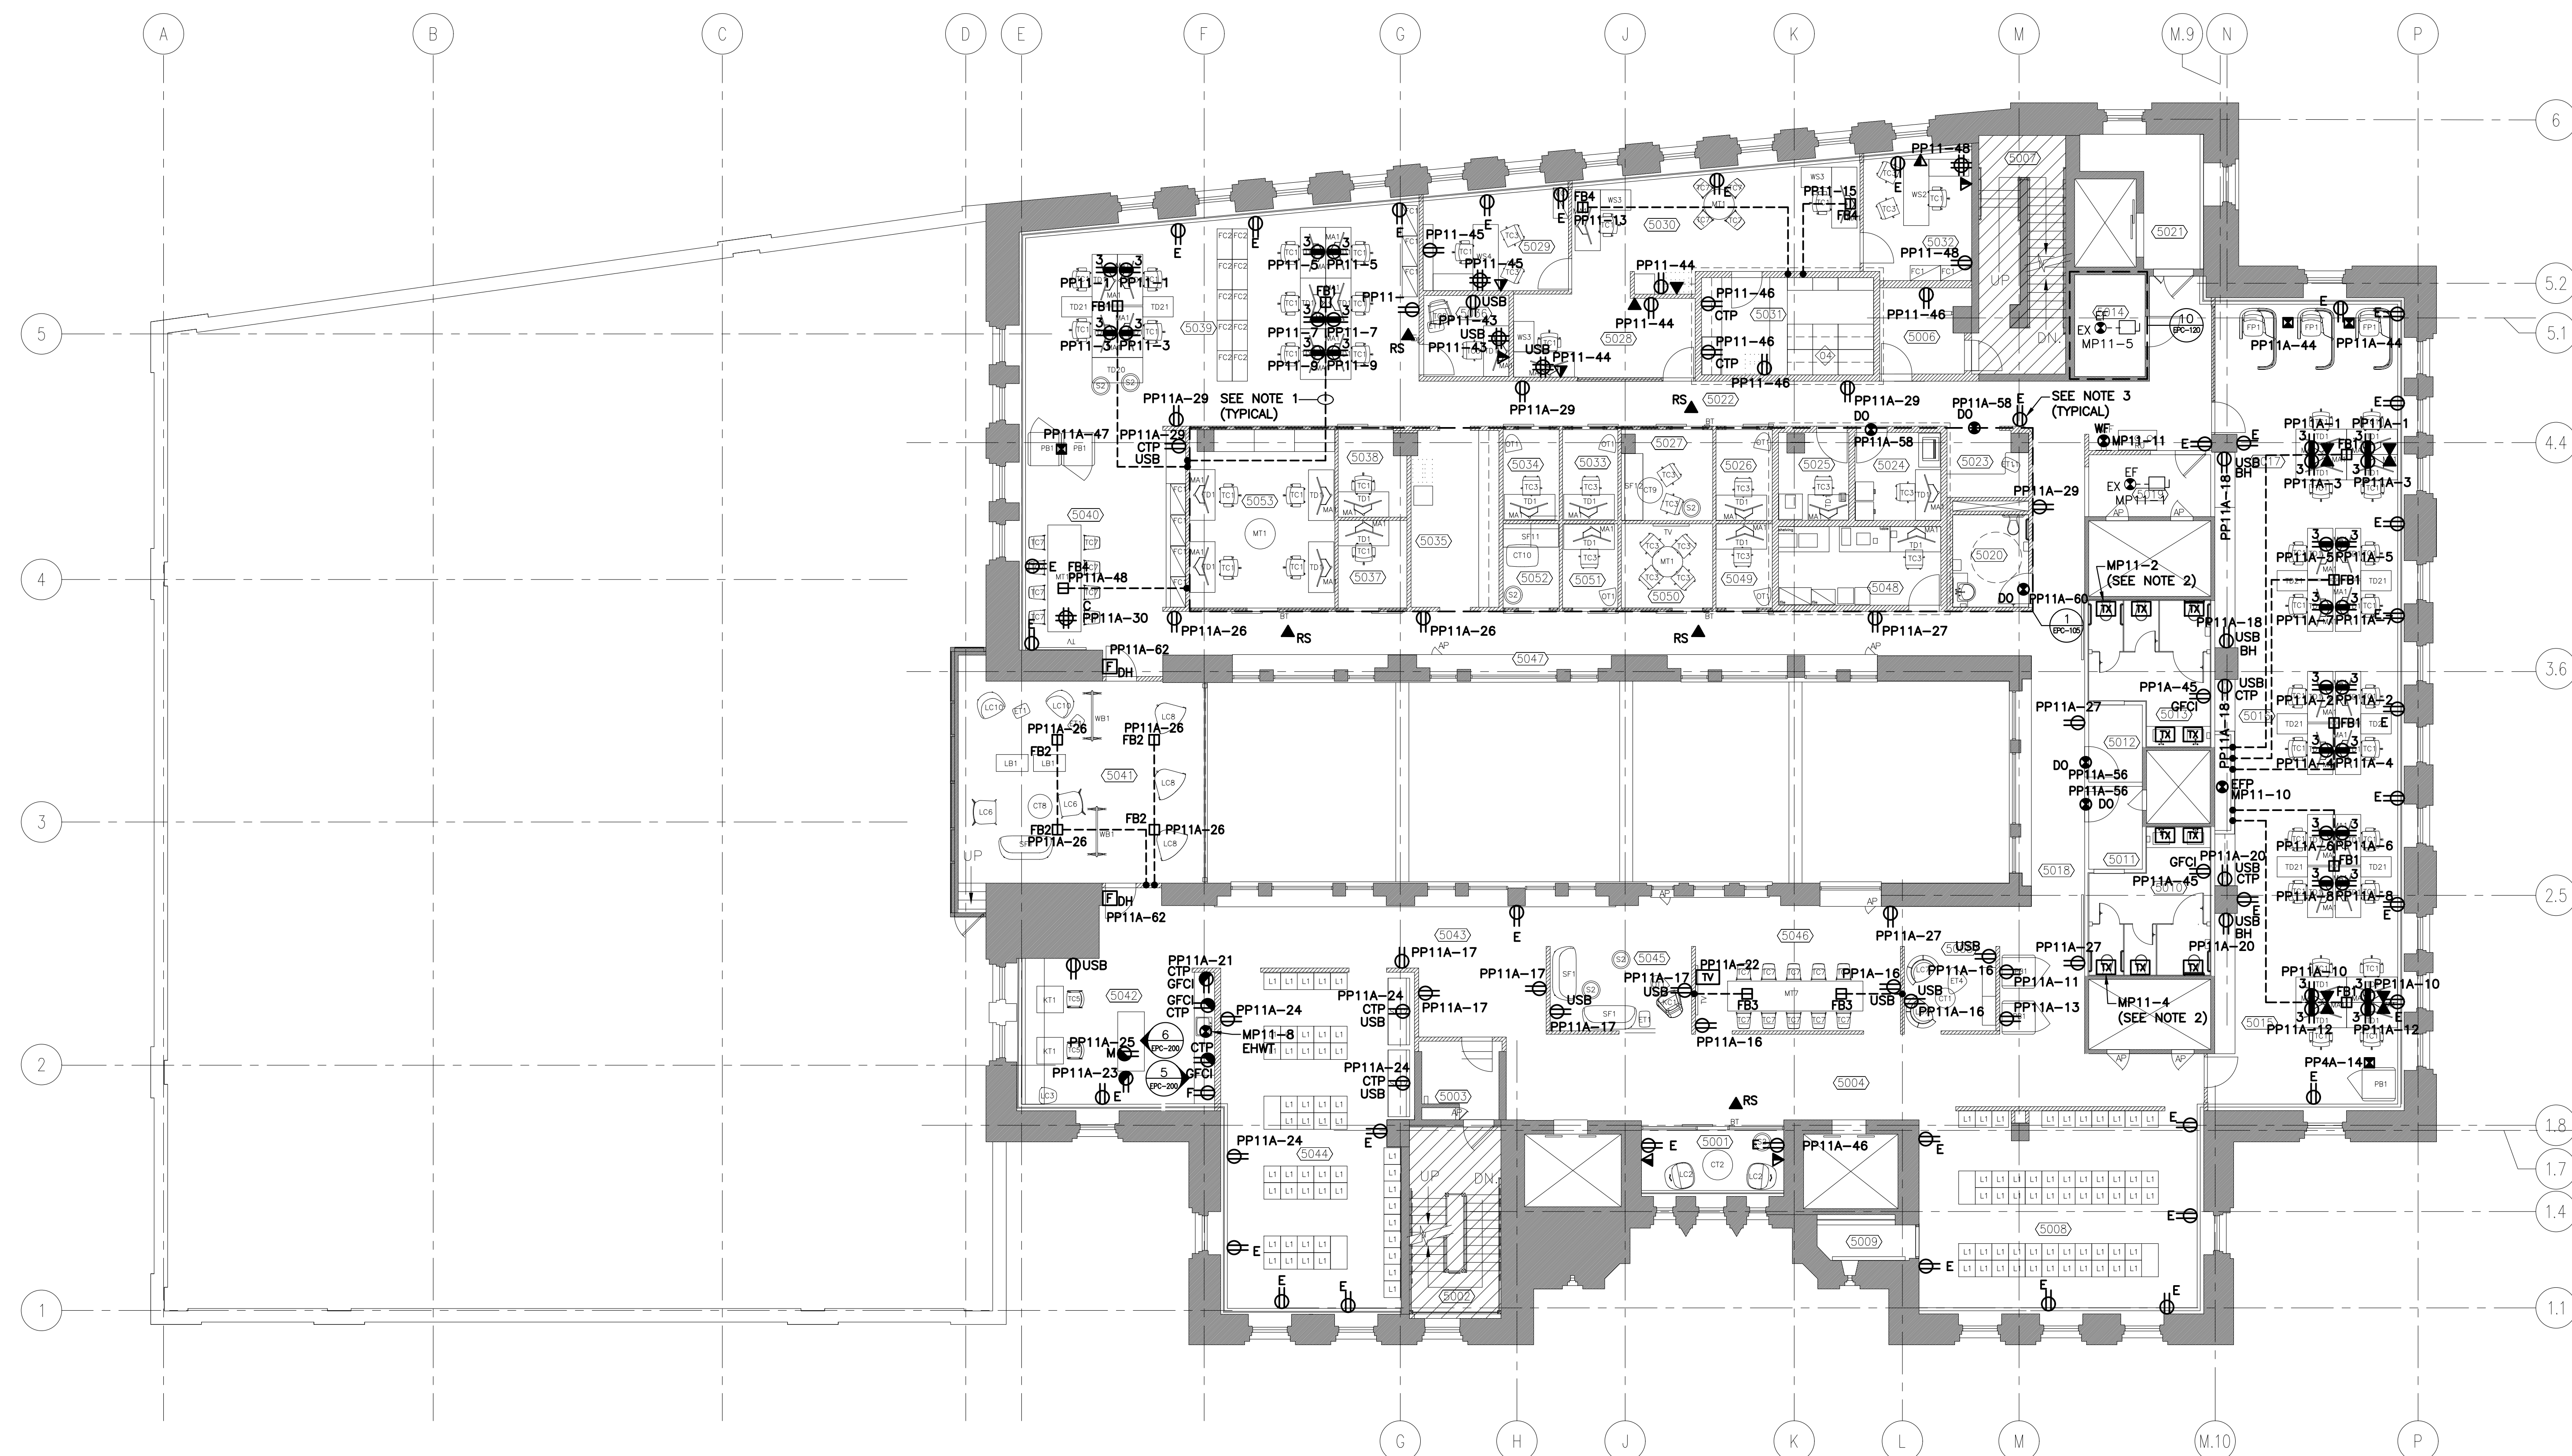

POWER & COMMS PLAN – LEVEL 5
SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

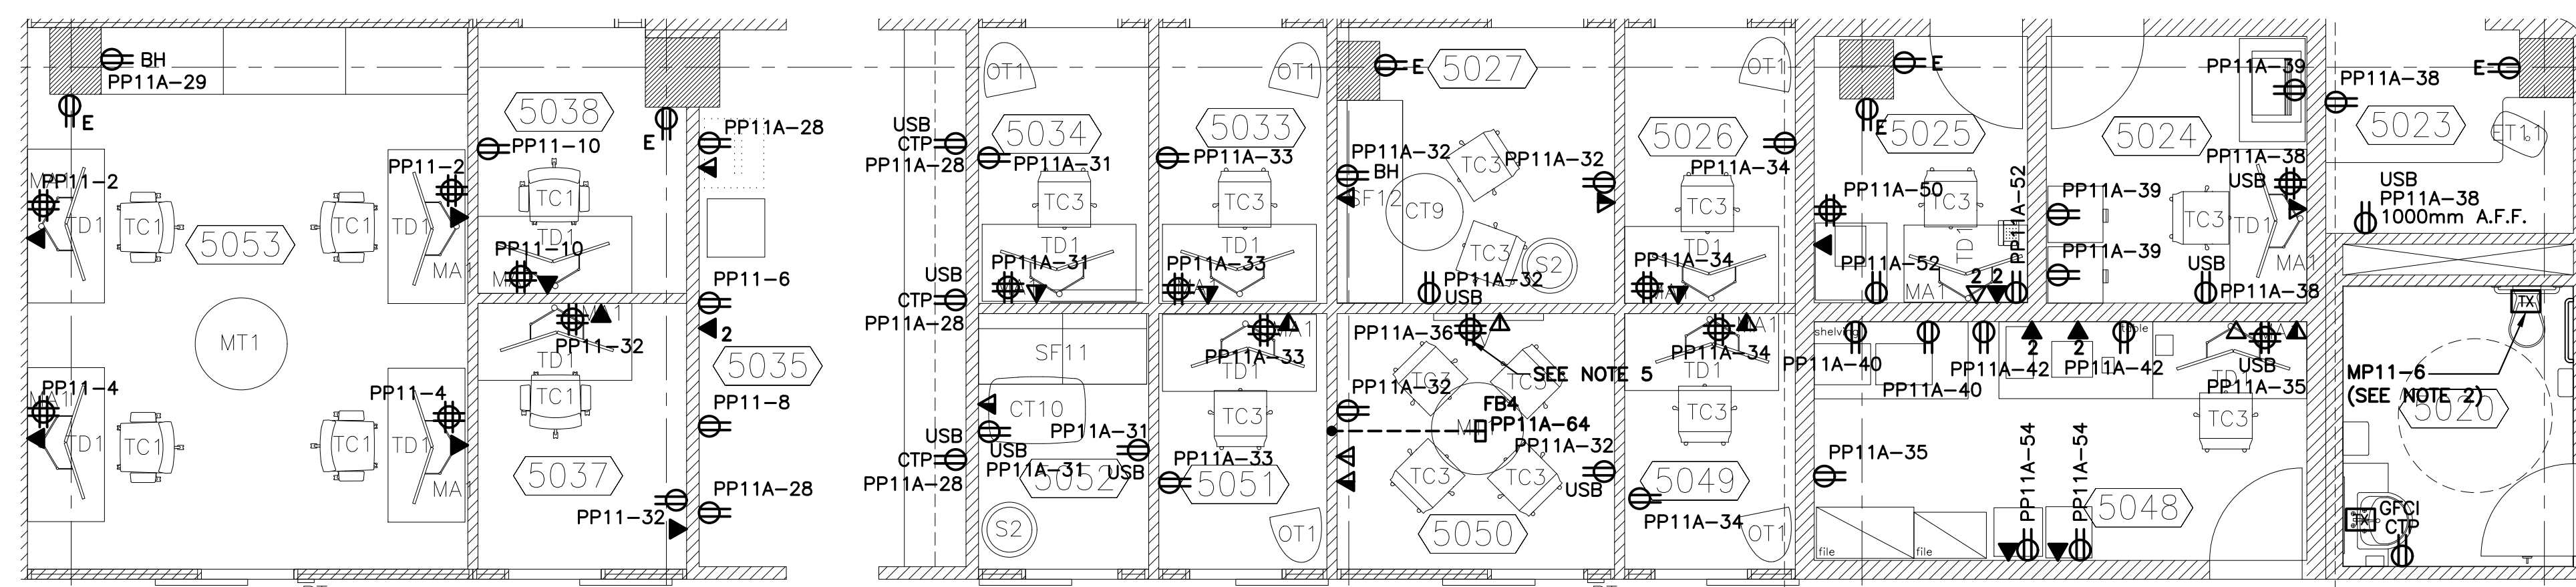

1 PARTAIL FLOOR PLAN – LEVEL 5
SCALE : 1:50
0m 1m 2m 3m 4m 5m

NOTES:

1. PROVIDE ONE DEDICATED POWER CONDUIT AND ONE OR TWO DEDICATED LOW VOLTAGE CONDUIT FROM CEILING JUNCTION BOX TO EACH FLOOR BOX. REFER TO FLOOR BOX SCHEDULE FOR EXACT CONDUIT QUANTITY AND SIZE.
2. PROVIDE POWER CONNECTION TO SINK AND TOILET SENSOR POWER SUPPLIES. CONFIRM EXACT REQUIREMENTS WITH MECHANICAL PRIOR TO INSTALLATION. ALL SENSOR POWER SUPPLIES LOCATED IN THE SAME ROOM TO BE SUPPLIED BY SINGLE CIRCUIT.
3. CONTRACTOR TO ENSURE REPLACEMENT COLUMN RECEPTACLES ARE INSTALLED AT 400MM A.F.F. MINIMUM.
4. SEE FLOOR BOX SCHEDULE ON DRAWING EPC-201 FOR FLOOR BOX SPECIFICATIONS AND ASSOCIATED CONDUIT DETAILS. CO-ORDINATE EXACT FLOOR BOX LOCATIONS WITH ARCHITECTURAL PRIOR TO INSTALLATION.



1	ISSUED FOR CONSTRUCTION	9 JULY 2021
0	ISSUED FOR TENDER	30 APR 2021
revisions		date

project

project

DOMINION PUBLIC BUILDING
1713 BEDFORD ROW
INTERIOR RENOVATIONS
HALIFAX, NS

drawing

descri


ELECTRICAL
LEVEL 5
POWER & COMMS PLAN

designed TC	concur
date NOV 2018	
drawn SDC	designé
date APR 2019	
approved	approuvé
date	
Tender	Soumission
PWGSC Project Manager	Administrateur de projets TPSCG
project number	no. du projet
R.063820.006	
drawing no.	no. du dessin
EPC-105	




NOTES:

1. PROVIDE ONE DEDICATED POWER CONDUIT AND ONE OR TWO DEDICATED LOW VOLTAGE CONDUIT FROM CEILING JUNCTION BOX TO EACH FLOOR BOX. REFER TO FLOOR BOX SCHEDULE FOR EXACT CONDUIT QUANTITY AND SIZE.
2. PROVIDE POWER CONNECTION TO SINK AND TOILET SENSOR POWER SUPPLIES. CONFIRM EXACT REQUIREMENTS WITH MECHANICAL PRIOR TO INSTALLATION. ALL SENSOR POWER SUPPLIES LOCATED IN THE SAME ROOM TO BE SUPPLIED BY SINGLE CIRCUIT.
3. CONTRACTOR TO ENSURE REPLACEMENT COLUMN RECEPTACLES ARE INSTALLED AT 400MM A.F.F. MINIMUM.
4. SEE FLOOR BOX SCHEDULE ON DRAWING EPC-201 FOR FLOOR BOX SPECIFICATIONS AND ASSOCIATED CONDUIT DETAILS. CO-ORDINATE EXACT FLOOR BOX LOCATIONS WITH ARCHITECTURAL PRIOR TO INSTALLATION.

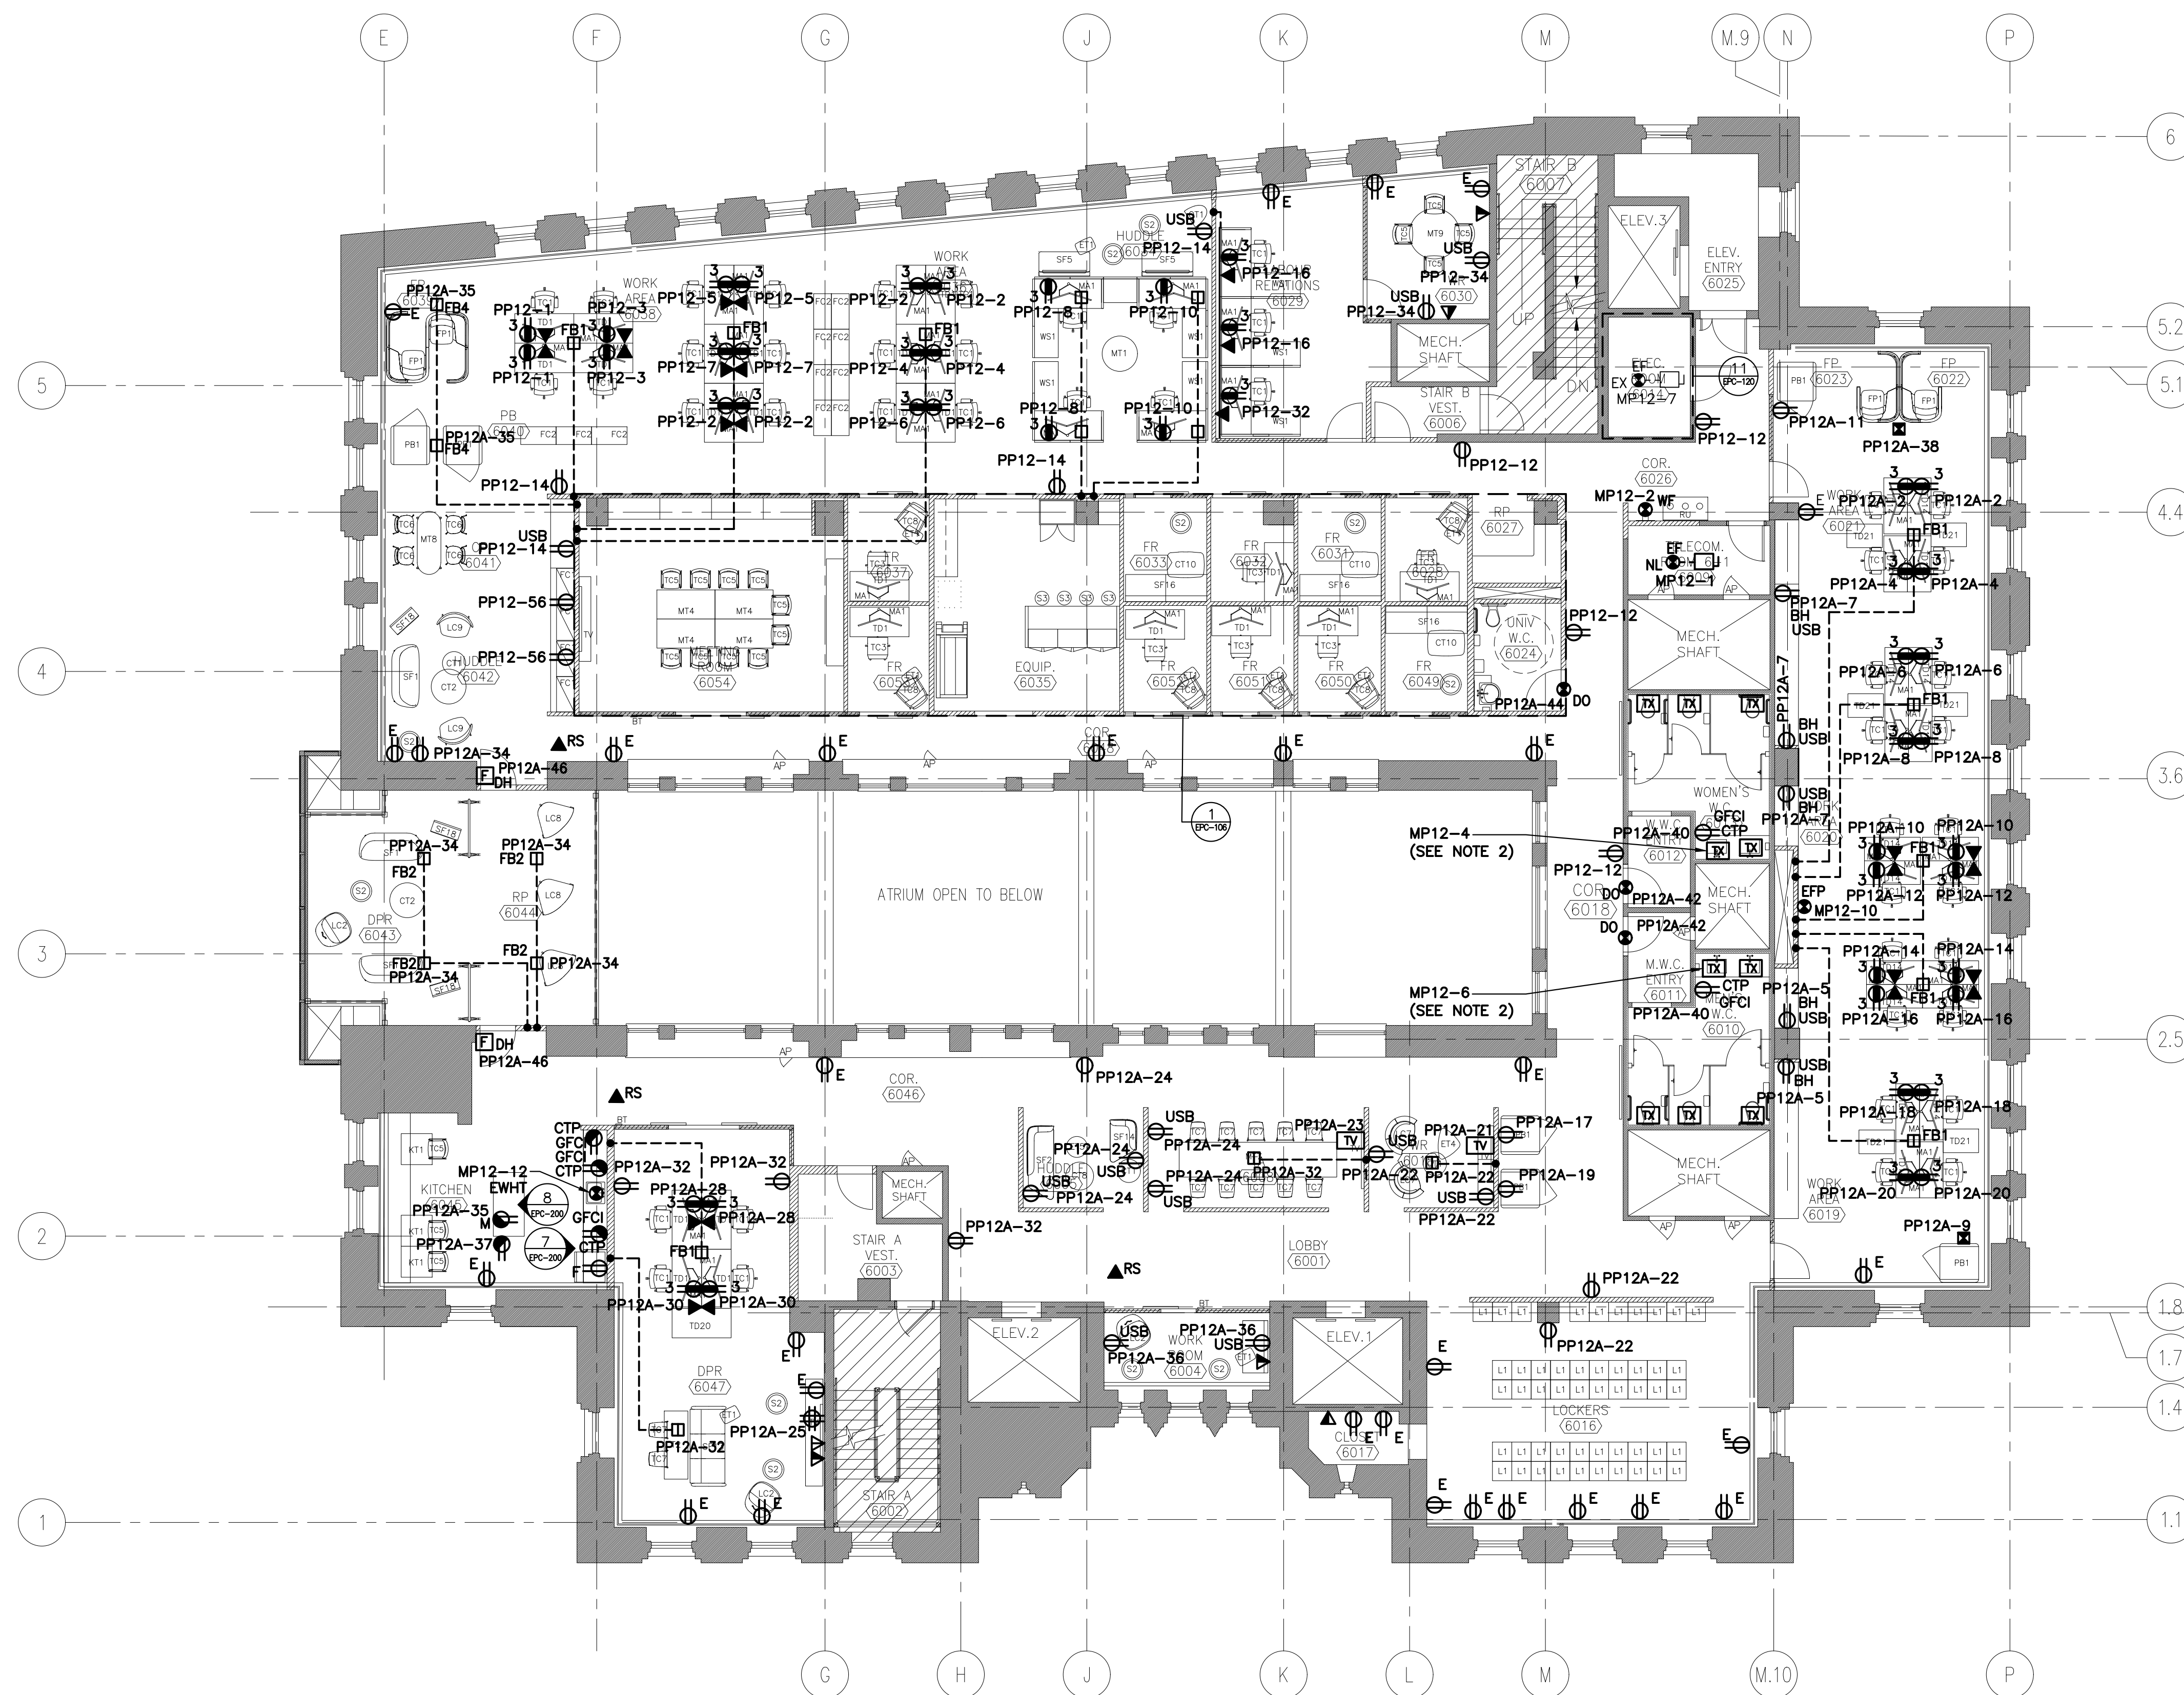


POWER & COMMS PLAN – LEVEL 6

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

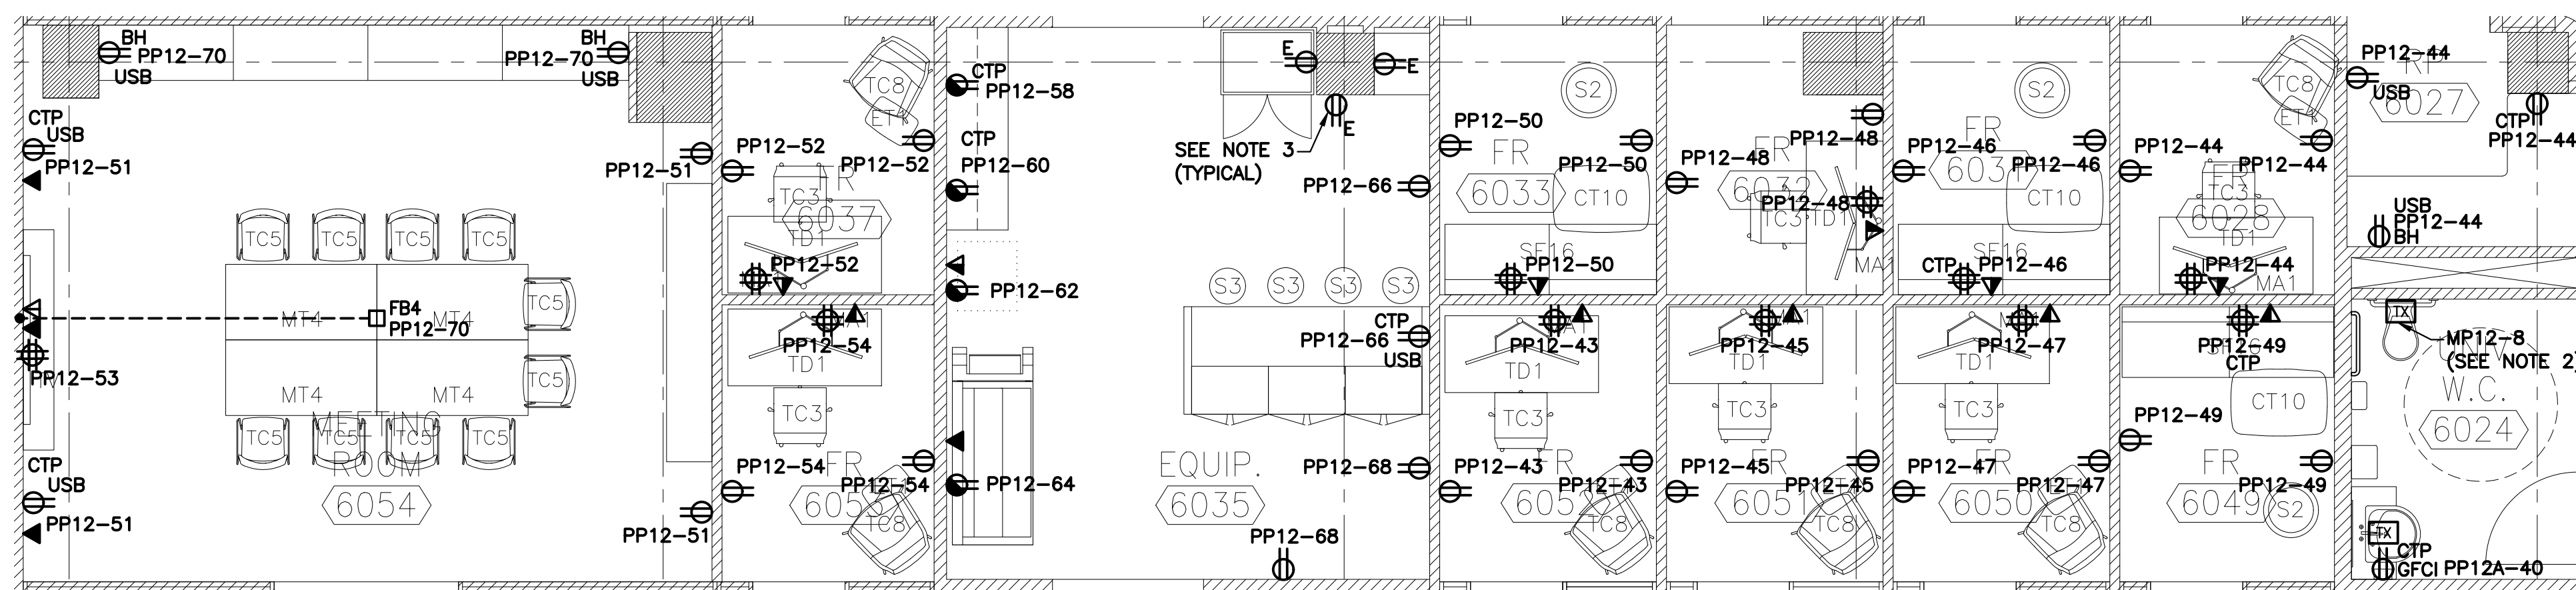

1 PARTAIL FLOOR PLAN – LEVEL 6

SCALE : 1:50
0m 1m 2m 3m 4m 5m



1	ISSUED FOR CONSTRUCTION	9 JULY 2021
0	ISSUED FOR TENDER	30 APR 2021
revisions		date

project


DOMINION PUBLIC BUILDING
1713 BEDFORD ROW
INTERIOR RENOVATIONS
HALIFAX, NS

ELECTRICAL
LEVEL 6
POWER & COMMS PLAN

designed	TC	conçu
date	NOV 2018	
drawn	SDC	dessiné
date	APR 2019	
approved		approuvé
date		
Tender		Soumission
PMWGC Project Manager	Administrateur de projets TPSCG	
project number	no. du projet	
	R.063820.006	
drawing no.	no. du dessin	
	EPC-106	




- NOTES:**
1. PROVIDE ONE DEDICATED POWER CONDUIT AND ONE OR TWO DEDICATED LOW VOLTAGE CONDUIT FROM CEILING JUNCTION BOX TO EACH FLOOR BOX. REFER TO FLOOR BOX SCHEDULE FOR EXACT CONDUIT QUANTITY AND SIZE.
 2. PROVIDE POWER CONNECTION TO SINK AND TOILET SENSOR POWER SUPPLIES. CONFIRM EXACT REQUIREMENTS WITH MECHANICAL PRIOR TO INSTALLATION. ALL SENSOR POWER SUPPLIES LOCATED IN THE SAME ROOM TO BE SUPPLIED BY SINGLE CIRCUIT.
 3. CONTRACTOR TO ENSURE REPLACEMENT COLUMN RECEPTACLES ARE INSTALLED AT 400MM A.F.F. MINIMUM.
 4. SEE FLOOR BOX SCHEDULE ON DRAWING EPC-201 FOR FLOOR BOX SPECIFICATIONS AND ASSOCIATED CONDUIT DETAILS. CO-ORDINATE EXACT FLOOR BOX LOCATIONS WITH ARCHITECTURAL PRIOR TO INSTALLATION.

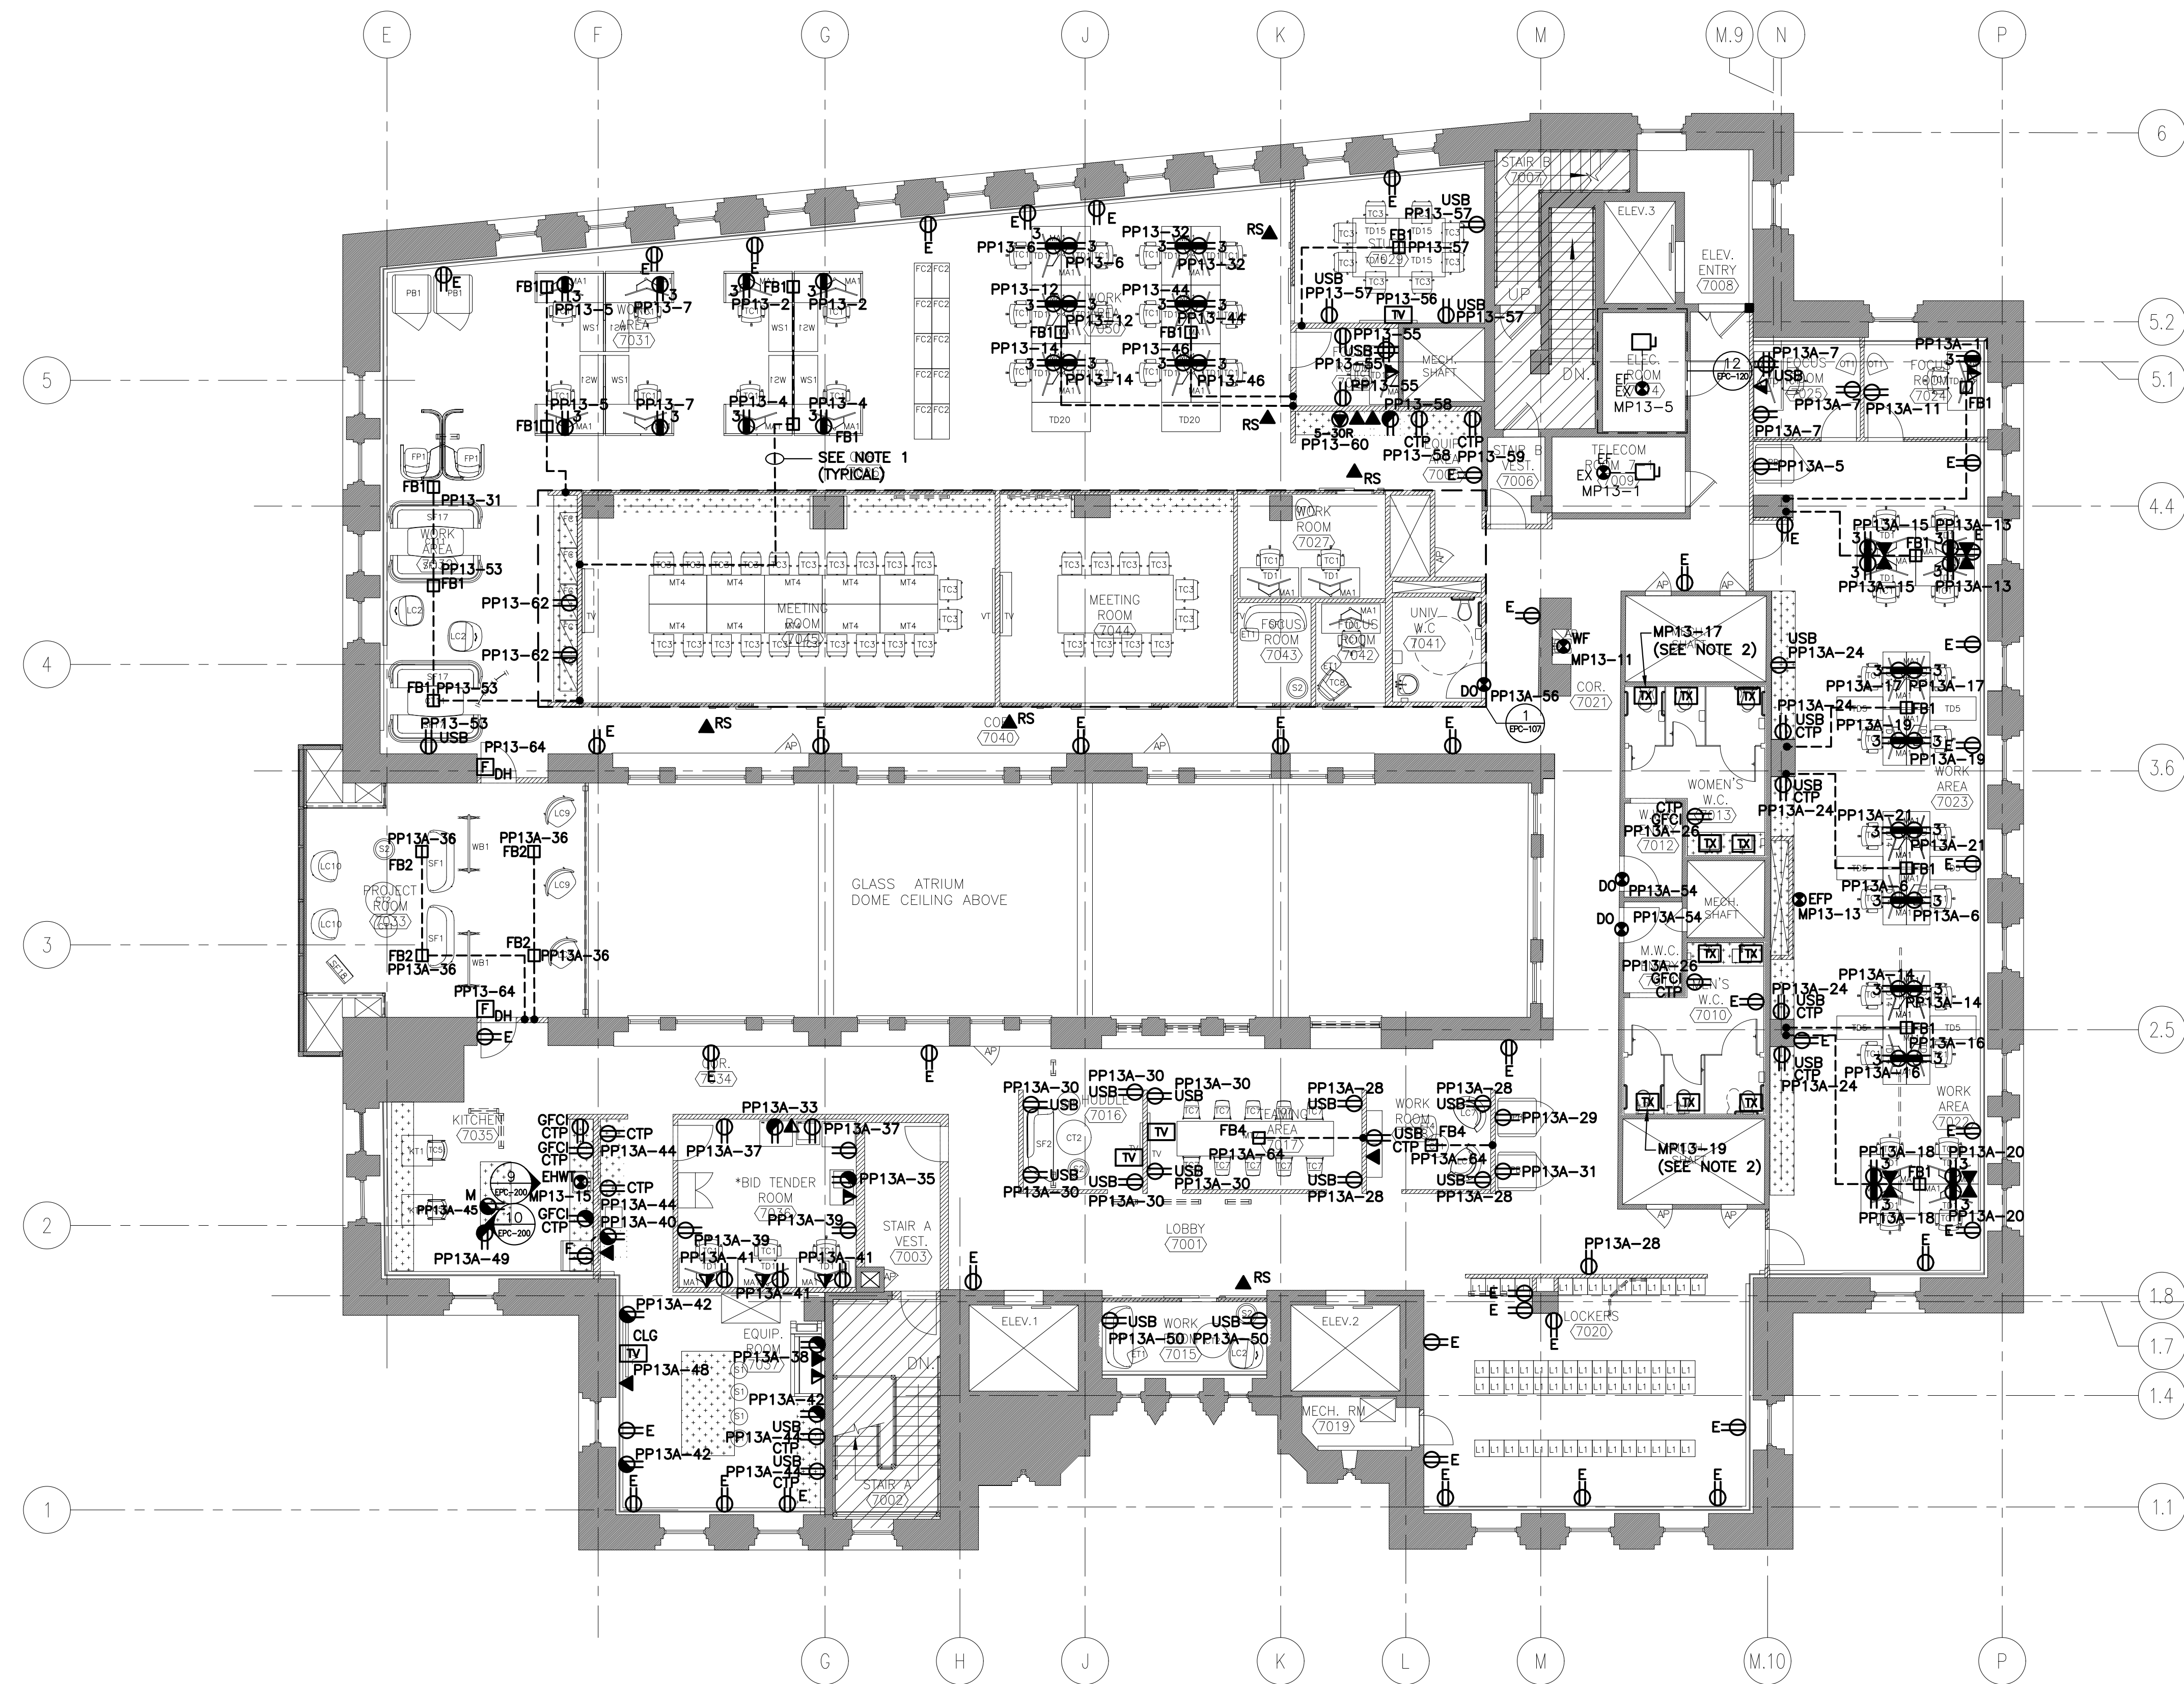


POWER & COMMS PLAN - LEVEL 7

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m

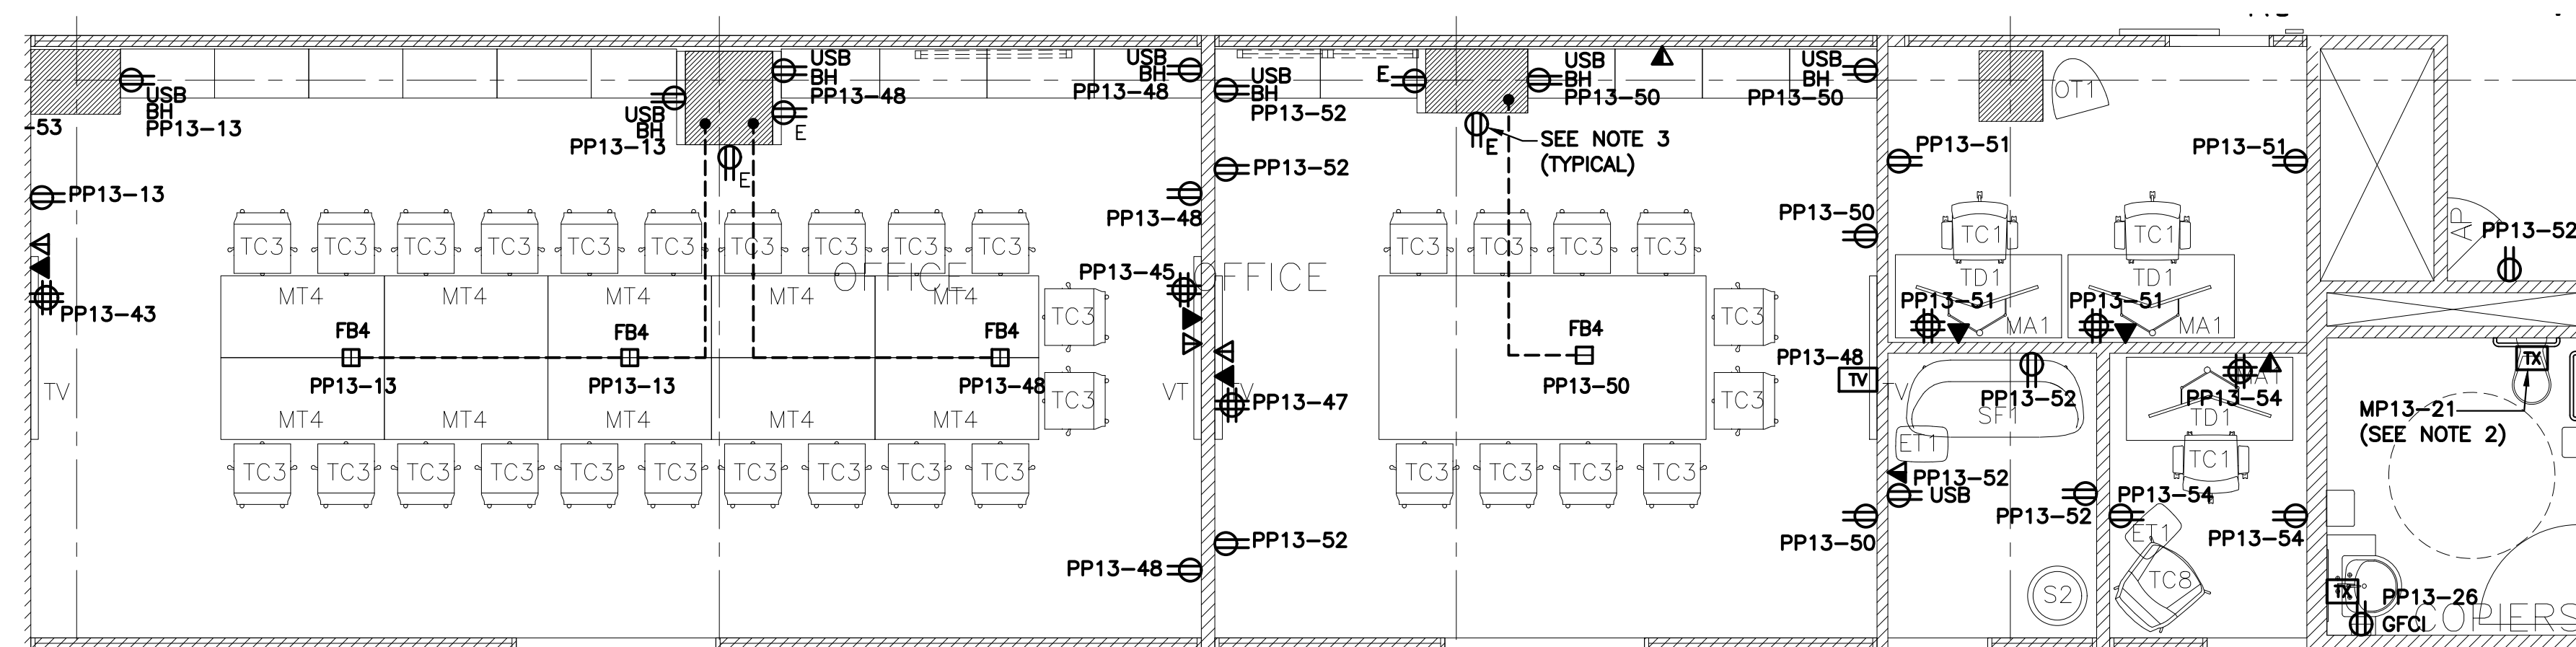

1 PARTIAL FLOOR PLAN - LEVEL 7

SCALE : 1:50
0m 1m 2m 3m 4m 5m

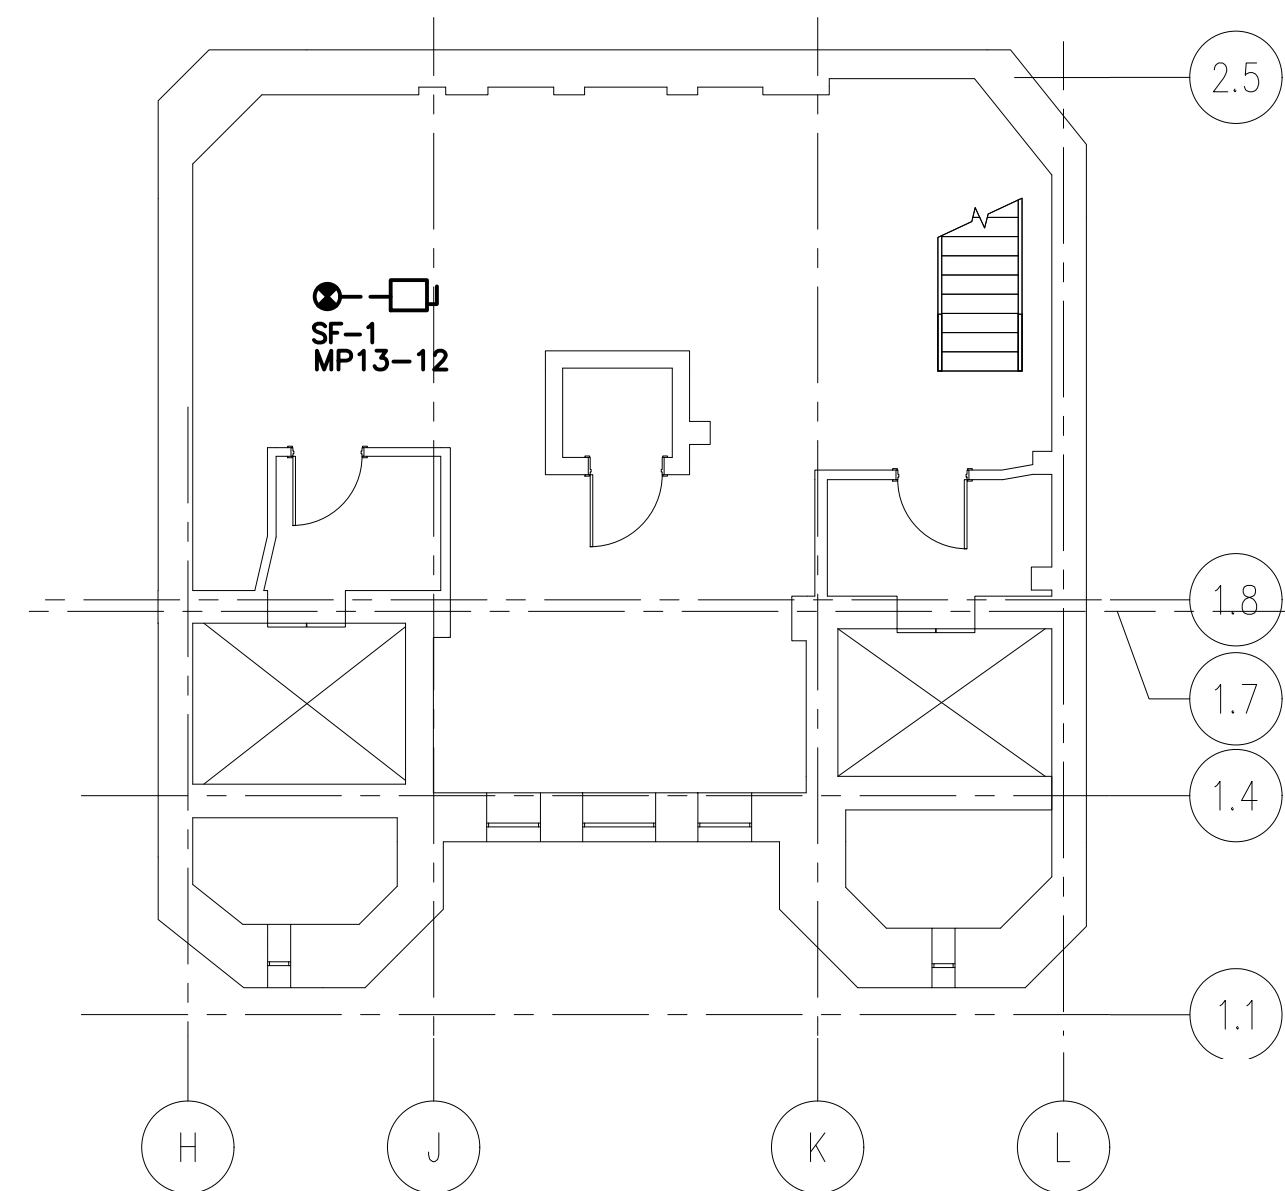

EIGHTH FLOOR PLAN

SCALE : 1:100
0m 1m 2m 3m 4m 5m 6m 7m 8m 9m 10m



1	ISSUED FOR CONSTRUCTION	9 JULY 2021
0	ISSUED FOR TENDER	30 APR 2021
revisions		date

project
DOMINION PUBLIC BUILDING
1713 BEDFORD ROW
INTERIOR RENOVATIONS
HALIFAX, NS

drawing
**ELECTRICAL
LEVEL 7
POWER & COMMS PLAN**

designed TC	concur
date NOV 2018	designé
drawn SDC	
date APR 2019	approved
approved	
date	
Tender	Submission
PMWGC Project Manager	Administrateur de projets TPWGC
project number	no. du projet
R.063820.006	
drawing no.	no. du dessin
EPC-107	