

BIG HOUSE- BASEMENT FLOOR PLAN

1:100

FIRE ALARM LEGEND		
ITEM	SYMBOL	REMARKS
FIRE ALARM CONTROL PANEL	FACP	EXISTING TO REMAIN
FIRE ALARM DEMARCATION BOX	FAD	NEW

EQUIPMENT		
ITEM	SYMBOL	REMARKS
EQUIPMENT CONNECTION	⬆	
NITROGEN GENERATOR	NG-#	NEW

BIG HOUSE CONSTRUCTION NOTES - BASEMENT:	
01	RECONNECT WATERFLOW PRESSURE ALARM SWITCH & LOW AIR PRESSURE ALARM SWITCH TO ELECTRICAL POWER SUPPLY. REFER TO MECHANICAL DRAWINGS FOR INSTRUCTIONS ON PROCEDURE OF EQUIPMENT INSTALLATION. TEST CONNECTION TO ALARM SYSTEM.
02	INSTALL NEW FIRE ALARM DEMARCATION BOX. SEE FIGURE E1.
BIG HOUSE GENERAL CONSTRUCTION NOTES:	
-	CONNECT POWER TO NITROGEN GENERATOR.



Parks Canada



Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest




DGH  
ENGINEERING LTD.

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

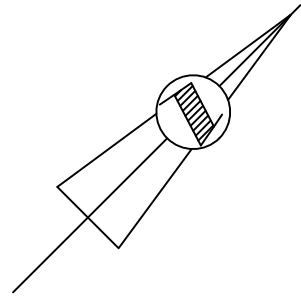

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08

Revision	Description	Date
Client		Client

PARKS CANADA AGENCY


220 4 AVE SE, SUITE 720  
CALGARY, AB. T2G 4X3

Project title	Projet
LOWER FORT GARRY NATIONAL HISTORIC SITE ST. ANDREWS, MB.	
REHABILITATION FROM WATER DAMAGE LOWER FORT GARRY	

Designed by	Conçu par
KAS	
Drawn by	Dessiné par
RTD	
Approved by	Approuvé par
LL	
Project Manager	Administrateur de Projets
CHRISTINE LeCLERC	TPSGC

Drawing title	Titre du dessin
BIG HOUSE FIRE ALARM SYSTEM PLAN BASEMENT FLOOR	
.	
.	
.	


Project No./No. du projet	Drawing No./No. du dessin	Revision No.
5P468-21-0054	E1.1	R00
	34 OF 42	

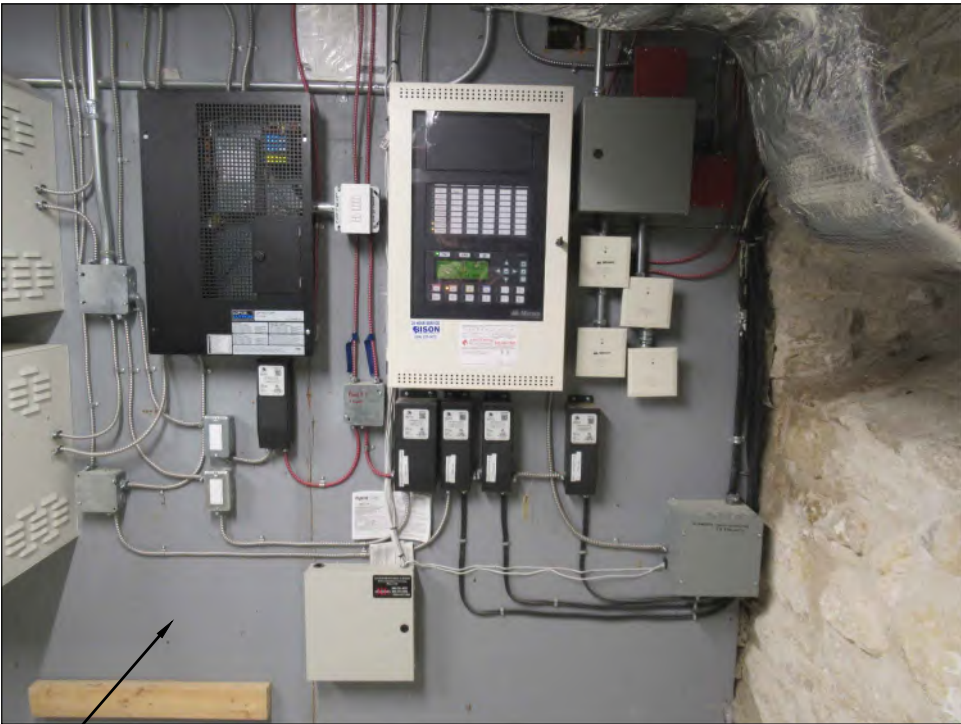

LOCATION OF NEW FIRE  
ALARM DEMARCATION BOX


FIGURE E1



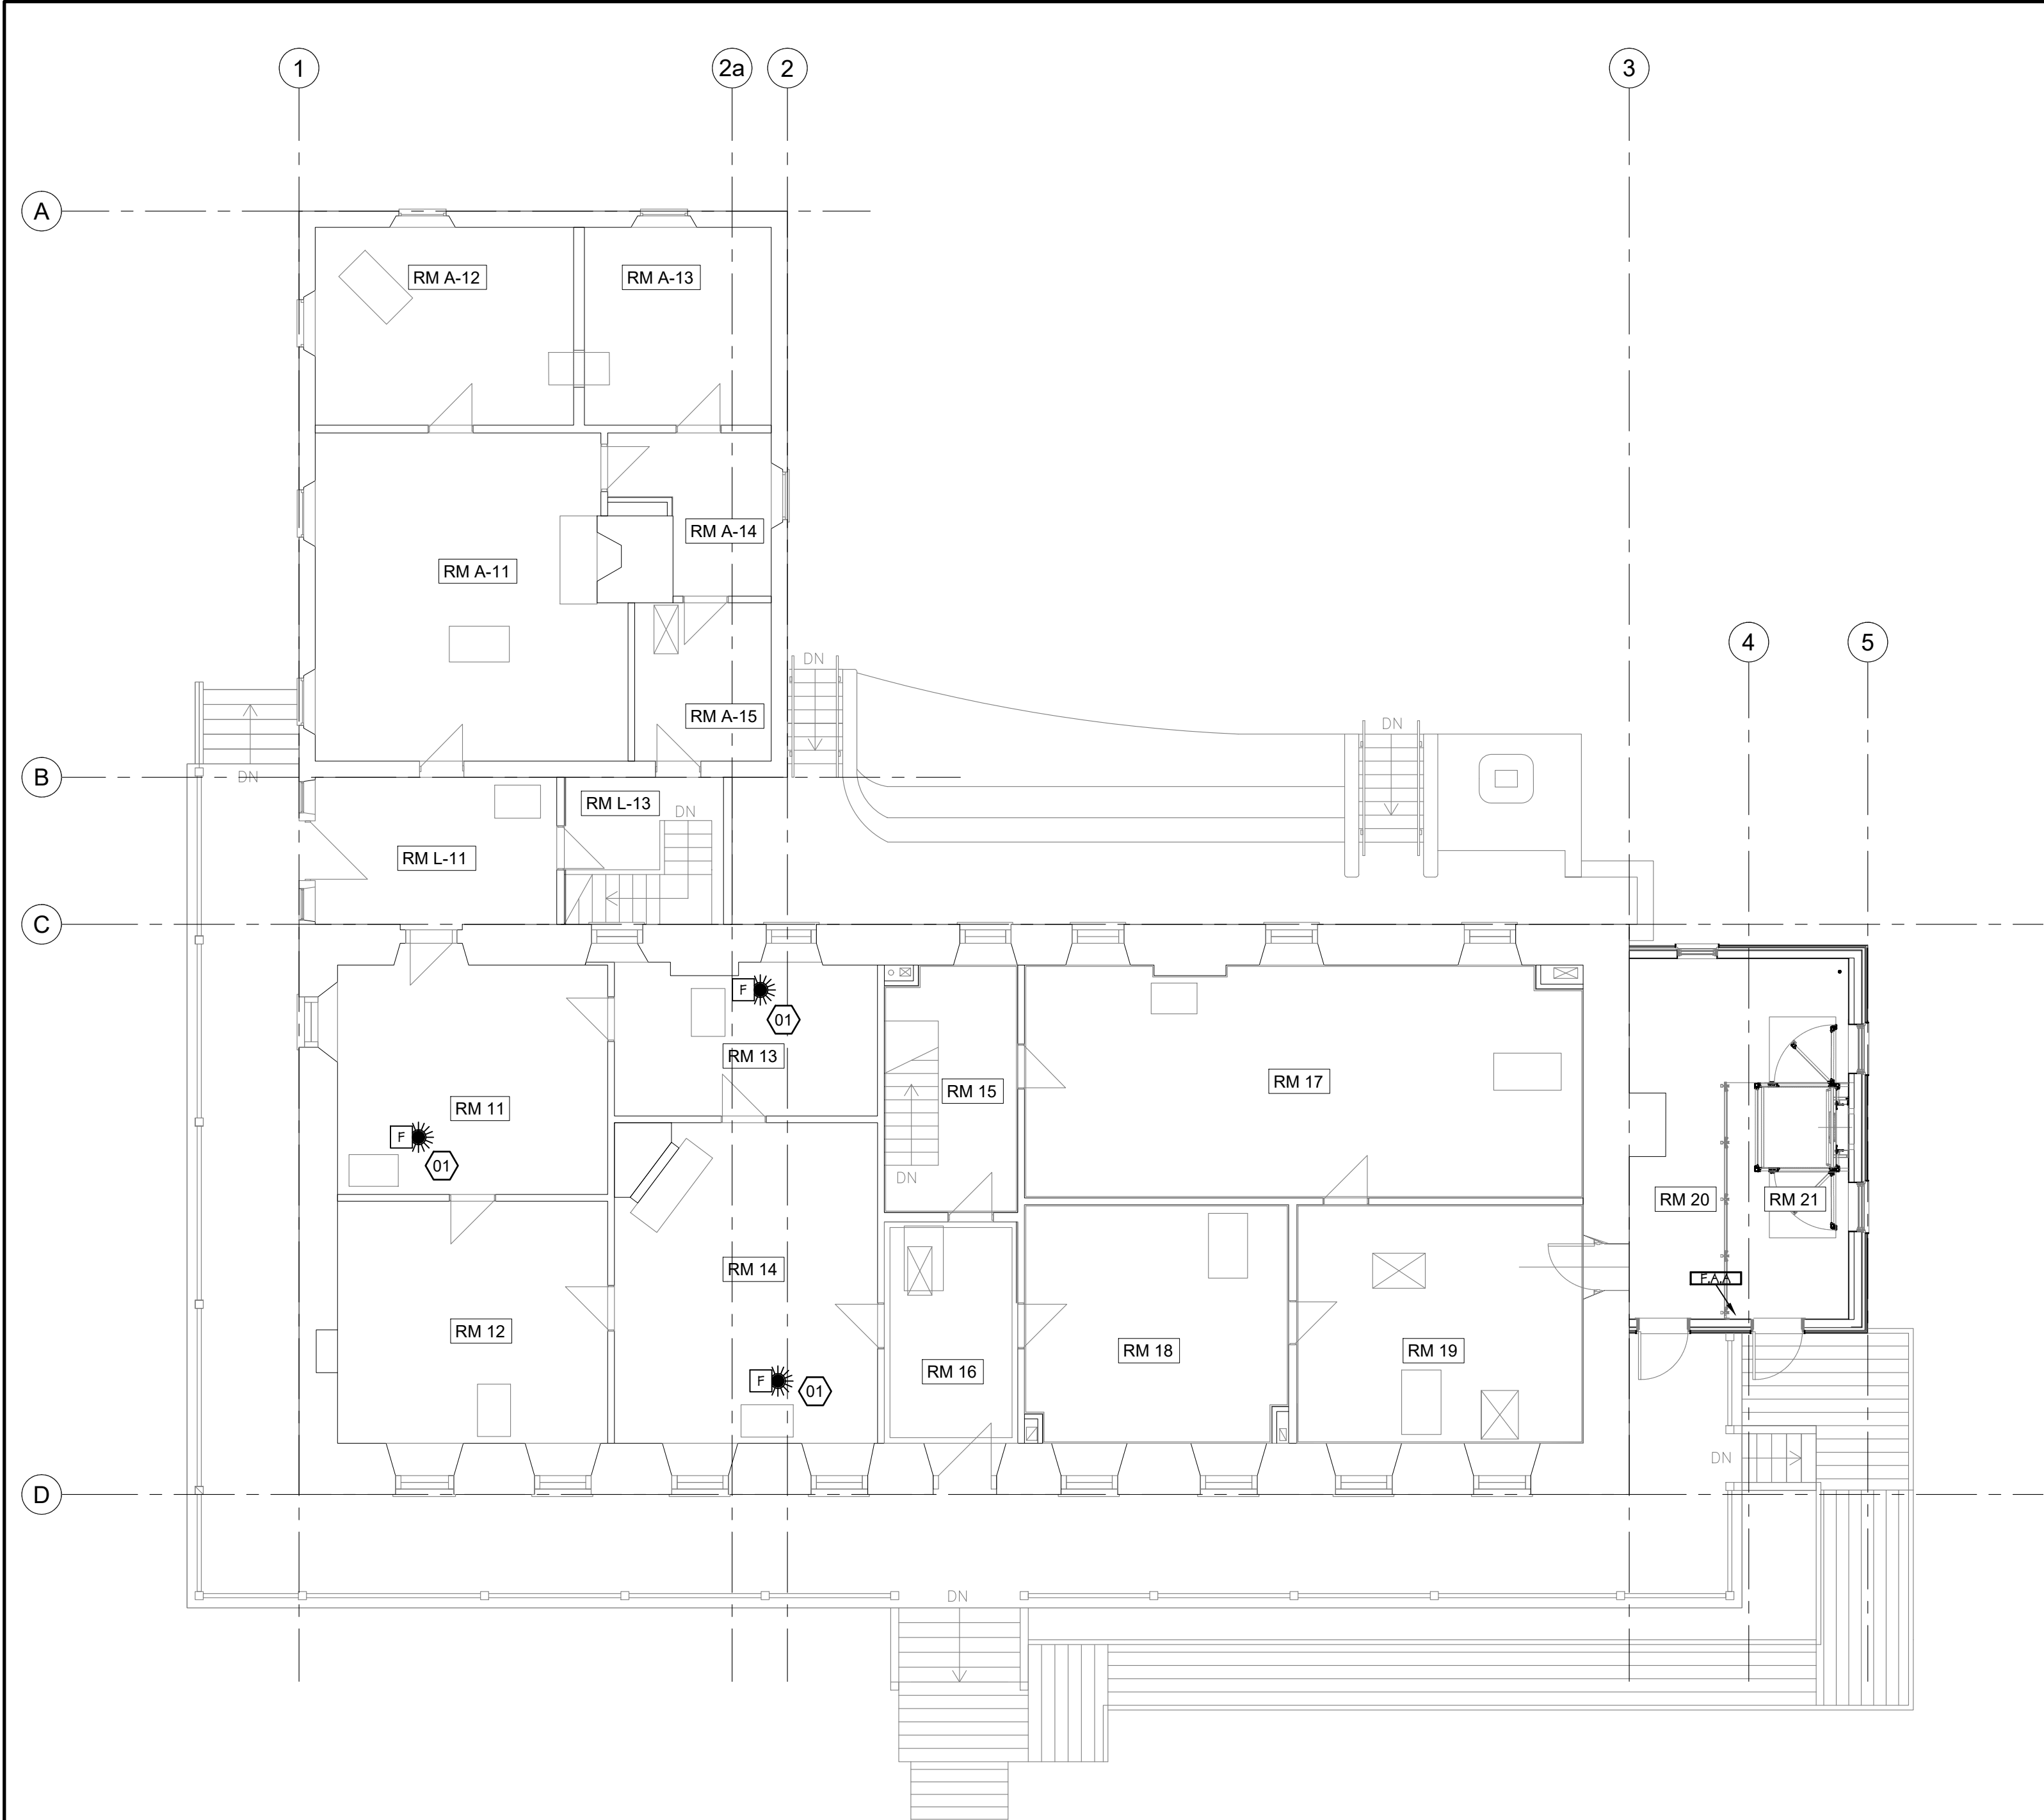

BIG HOUSE- MAIN FLOOR PLAN

1:100

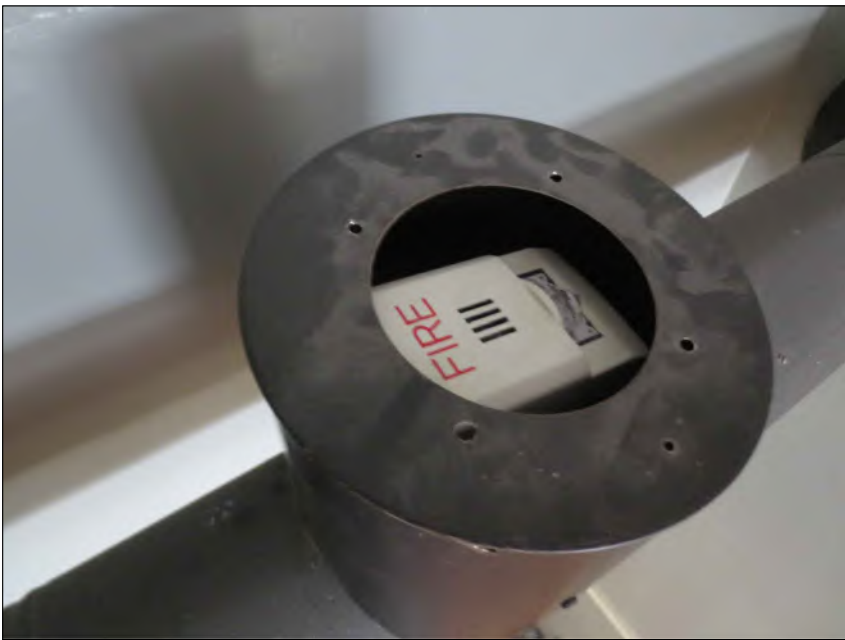

DEVICE TO BE LOCATED  
IN SHORT VERTICAL  
SECTION OF STOVE PIPE

FIGURE E2

FIRE ALARM LEGEND		
ITEM	SYMBOL	REMARKS
ANNUNCIATOR PANEL		EXISTING TO REMAIN
STROBE LIGHT WITH HORN CONCEALED IN STOVE PIPING		EXISTING TO BE REINSTALLED

BIG HOUSE CONSTRUCTION NOTES - MAIN FLOOR:	
	REINSTALL WIRING AND STROBES IN STOVE PIPES AFTER STOVE PIPES ARE INSTALLED. SEE FIGURE E2 FOR LOCATION OF DEVICE IN PIPE.

Parks Canada

Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08

Revision	Description	Date
Client		Client

PARKS CANADA AGENCY


.

.

220 4 AVE SE, SUITE 720  
CALGARY, AB. T2G 4X3

Project title	Projet	
LOWER FORT GARRY NATIONAL HISTORIC SITE ST. ANDREWS, MB.  REHABILITATION FROM WATER DAMAGE LOWER FORT GARRY		
Designed by	Conçu par	
KAS		
Drawn by	Dessiné par	
RTD		
Approved by	Approuvé par	
LL		
Project Manager	Administrateur de Projets	
CHRISTINE LeCLERC	IPSGC	
Drawing title	Titre du dessin	
BIG HOUSE FIRE ALARM SYSTEM PLAN MAIN FLOOR  . . .		
Project no./No. du projet	Project no./No. du dessin	Revised no./Révisé
5P468-21-0054	E1.2 35 OF 42	R00



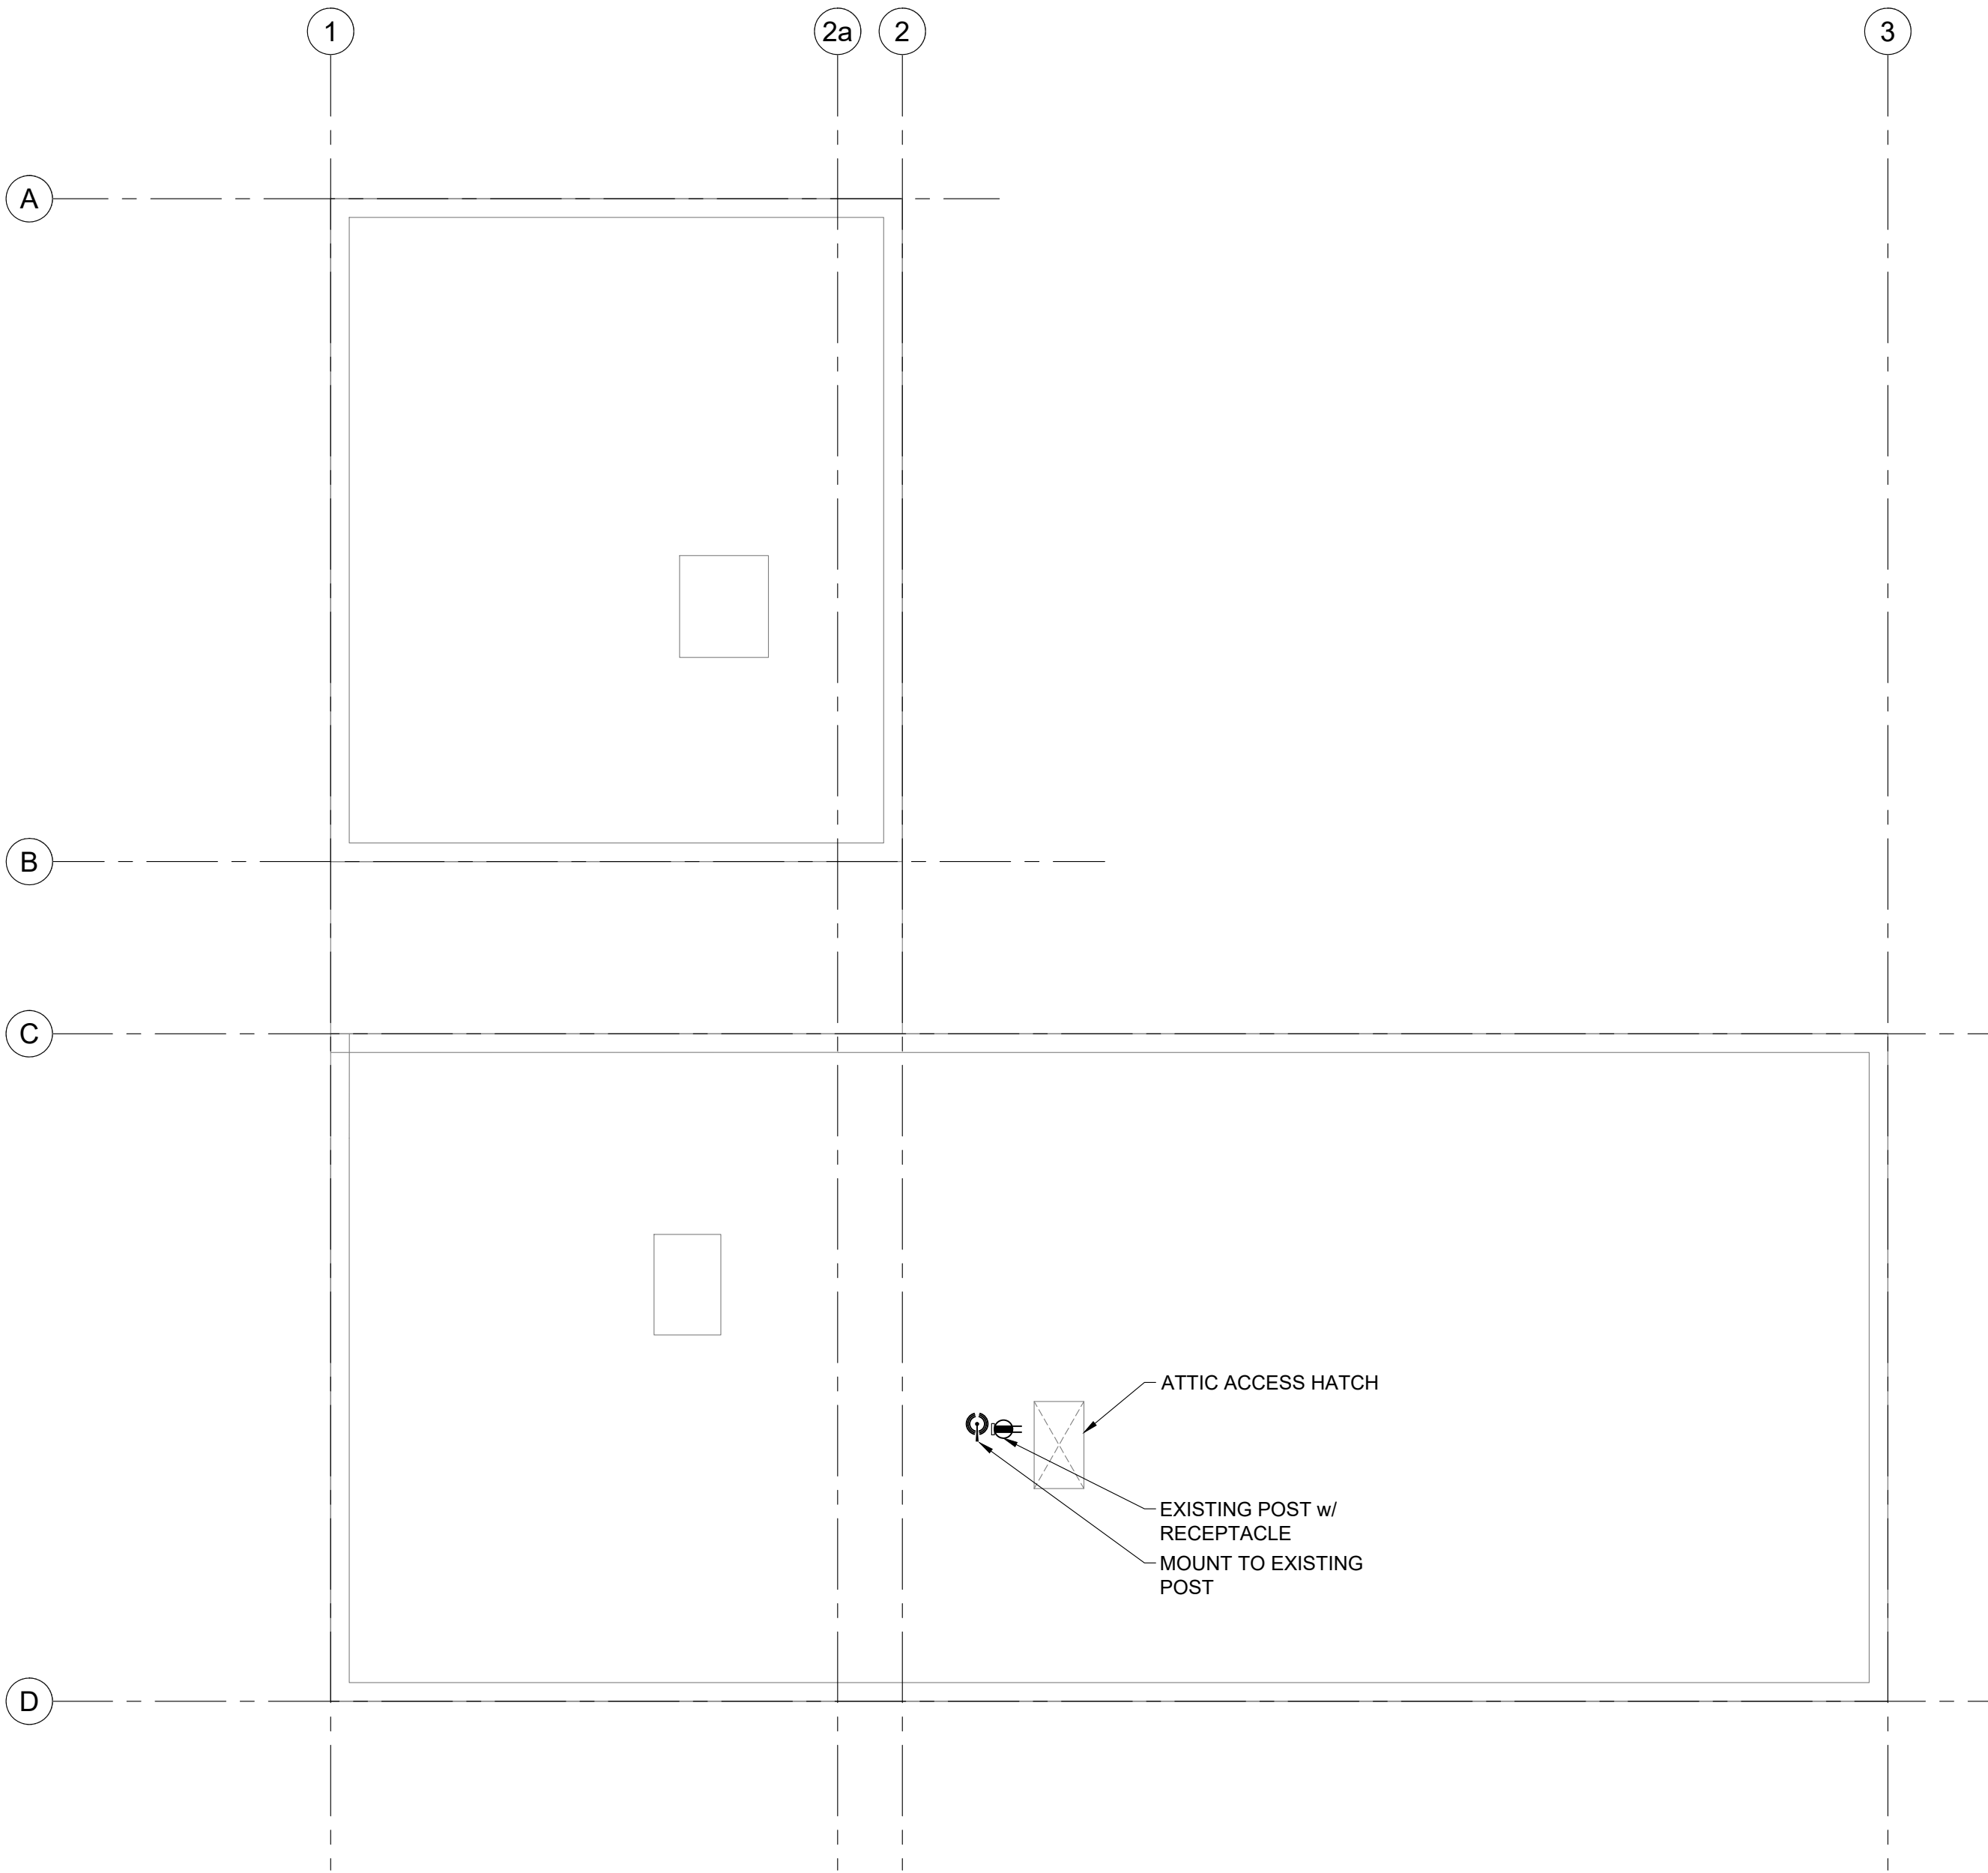

BIG HOUSE- ATTIC LEVEL

1:100

MOUNT CELL BOOSTER TO OPPOSITE SIDE OF POST

EXISTING 15A RECEPTACLE



FIGURE E3



FIGURE E4

COMMUNICATIONS LEGEND		
ITEM	SYMBOL	REMARKS
CELL PHONE BOOSTER		NEW. INTERCONNECTED w/ ALARM SYSTEM
RECEPTACLE 15A, 120V, DUPLEX		EXISTING TO REMAIN

BIG HOUSE GENERAL CONSTRUCTION NOTES:		
-	USE EXISTING 15A RECEPTACLE TO SUPPLY POWER TO CELL PHONE BOOSTER. SEE FIGURES E3 & E4.	

Parks Canada

Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest


CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard

St. Andrews MB R1A 3N5 Canada

T: 204-334-8846

www.dghengineering.com

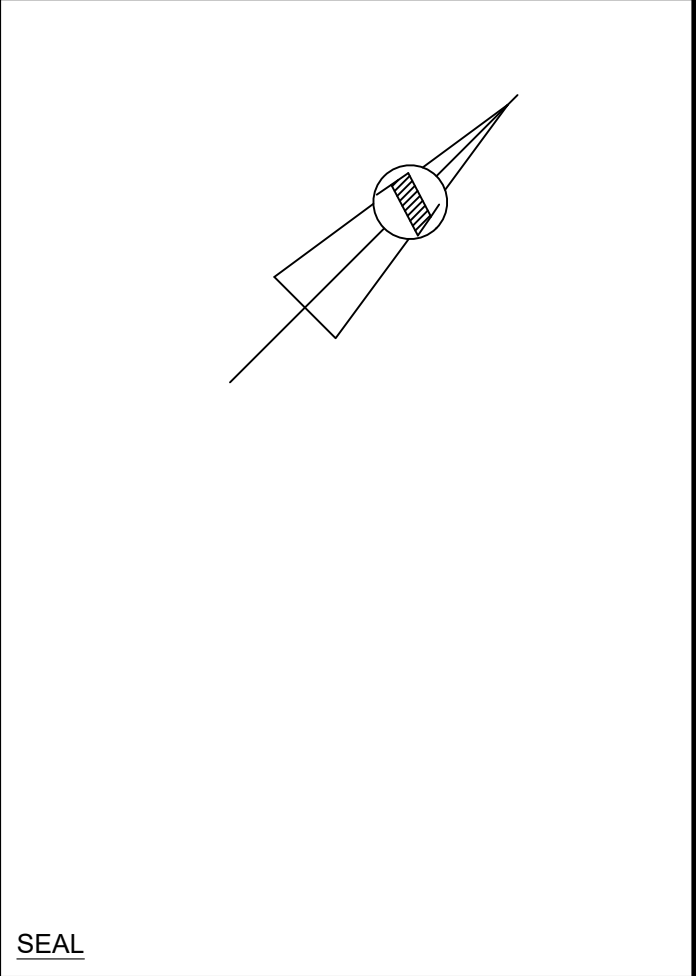

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08

Revision Client Description Date

Client Client

PARKS CANADA AGENCY

.

.

220 4 AVE SE, SUITE 720

CALGARY, AB. T2G 4X3

Project title Project

LOWER FORT GARRY

NATIONAL HISTORIC SITE

ST. ANDREWS, MB.

REHABILITATION

FROM WATER DAMAGE

LOWER FORT GARRY

Designed by	Conçu par
KAS	
Drawn by	Dessiné par
RTD	
Approved by	Approuvé par
LL	

Project Manager Administrateur de Projets

CHRISTINE LeCLERC

Drawing title Titre du dessin

BIG HOUSE

FIRE ALARM SYSTEM PLAN

ATTIC LEVEL


.

.

.

Project No./No. du projet	Revision No./No. de la Rev.	Revision
5P468-21-0054	E1.3	R00
	36 OF 42	



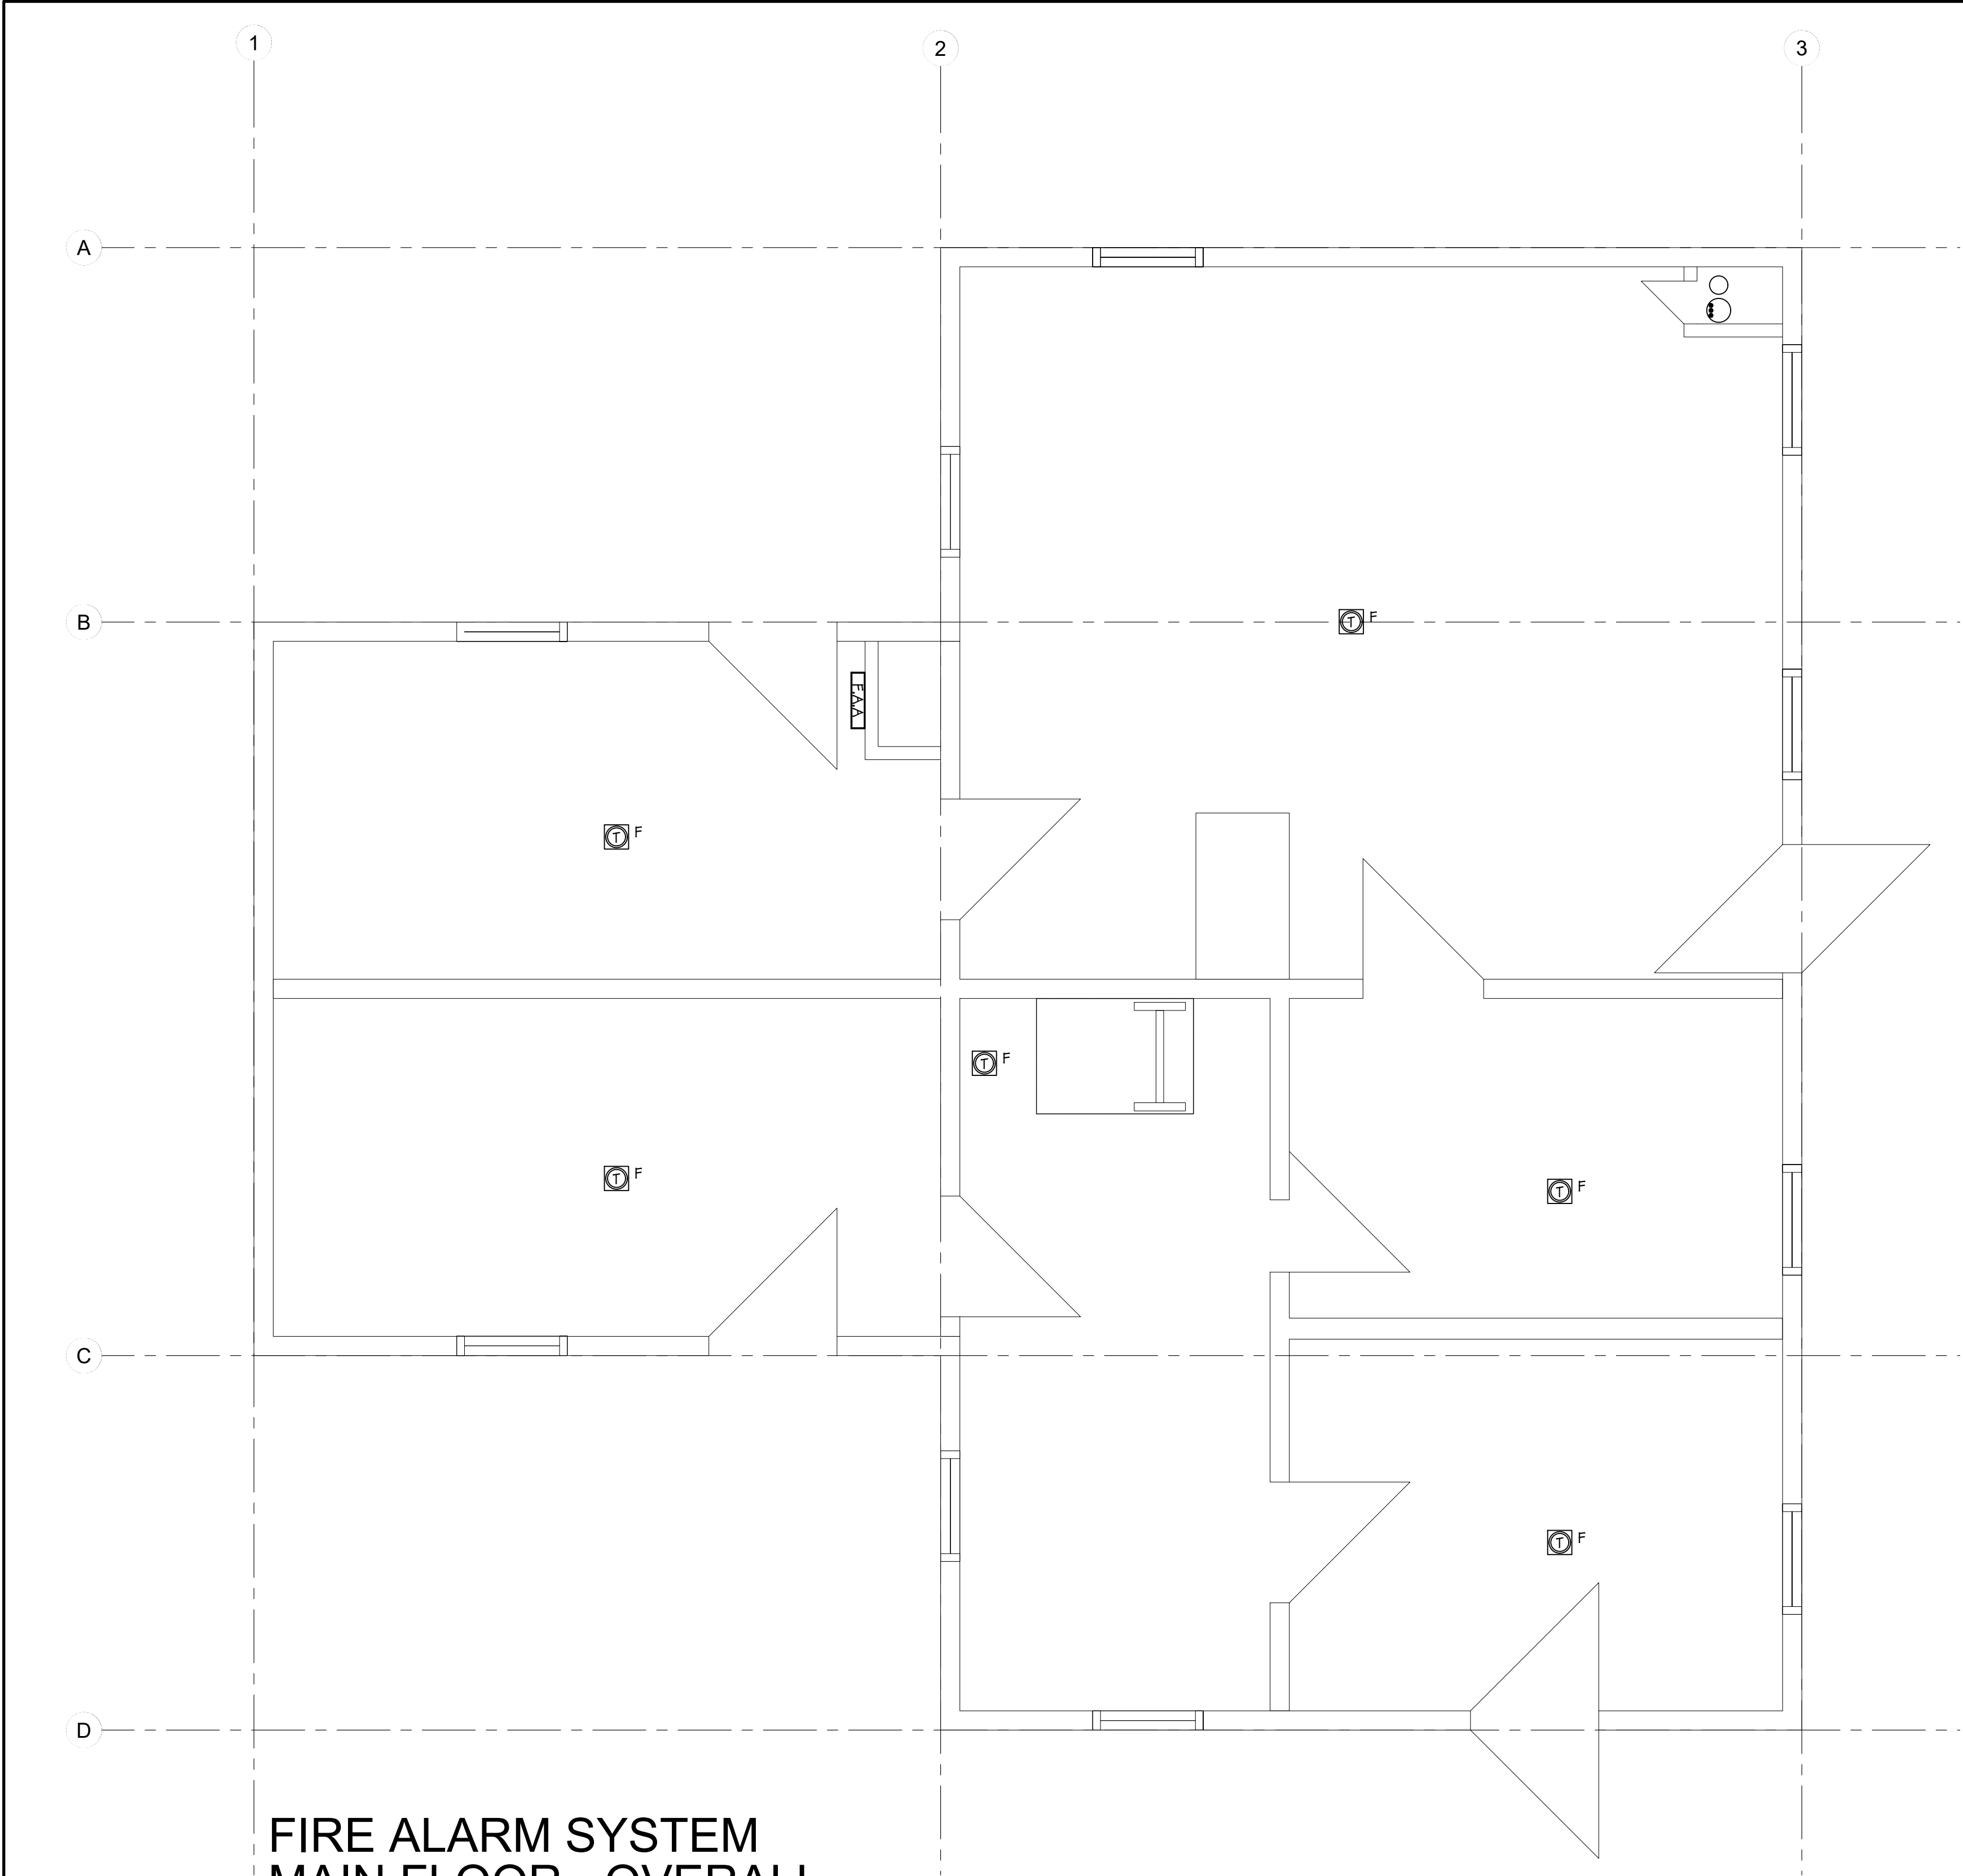

FIRE ALARM SYSTEM  
MAIN FLOOR - OVERALL

1:50

FIRE ALARM LEGEND		
ITEM	SYMBOL	REMARKS
ANNUNCIATOR PANEL	FAA	EXISTING TO REMAIN
HEAT DETECTOR (FIXED TEMPERATURE TYPE)	F	NEW DEVICE & WIRING

MEN'S HOUSE GENERAL CONSTRUCTION NOTES:	
- INSTALL NEW FIRE ALARM DEVICES AS SHOWN.	



Parks Canada



Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest




DGH  
ENGINEERING LTD.

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

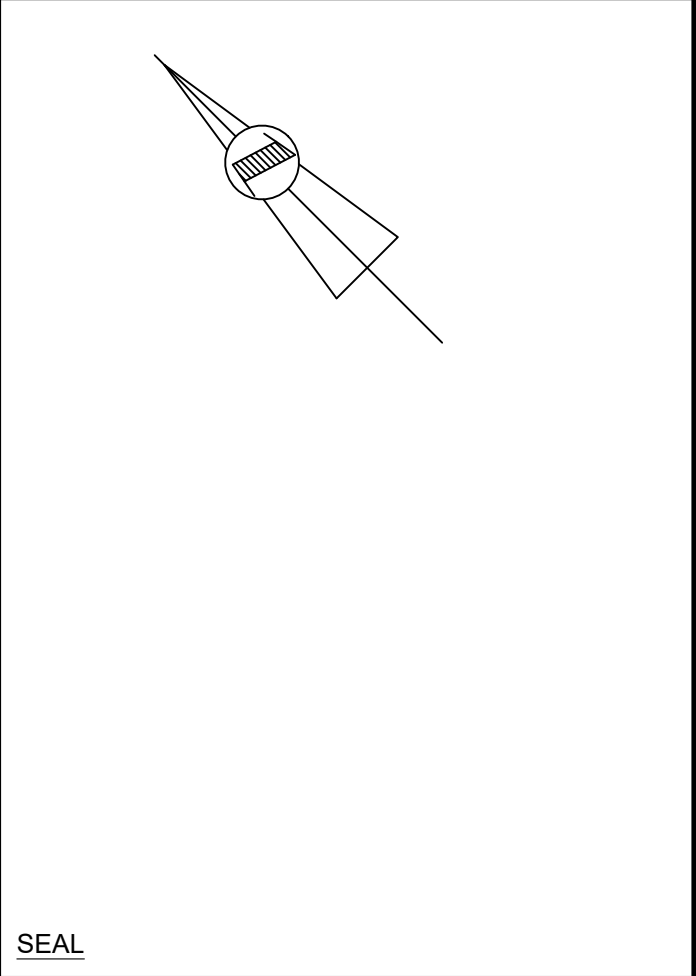

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 99% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 99% REVIEW	2021-11-08
Revision	Description	Date
Client		Client

**PARKS CANADA AGENCY**

.

220 4 AVE SE, SUITE 720  
CALGARY, AB. T2G 4X3

Project title

Projet

**LOWER FORT GARRY  
NATIONAL HISTORIC SITE  
ST. ANDREWS, MB.**

**REHABILITATION  
FROM WATER DAMAGE  
LOWER FORT GARRY**

Designed by

Conçu par

**KAS**

Drawn by

Dessiné par

**RTD**

Approved by

Approuvé par

**LL**

Project Manager

Administrateur de Projets

**CHRISTINE LeCLERC**

Drawing title

Titre du dessin

**MEN'S HOUSE  
FIRE ALARM & SERVICE SYSTEM PLAN  
MAIN FLOOR**

.

.

.

Project No./No. du projet

Project No./No. de dessin

Revised No.

**5P468-21-0054**

**E2.1**  
37 OF 42

**R00**


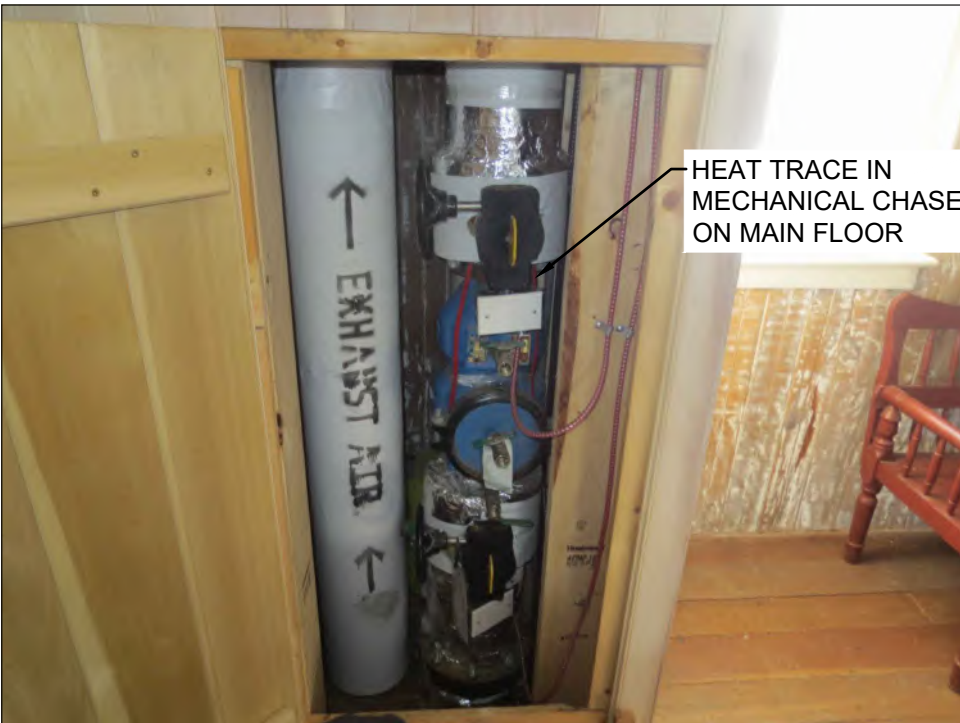


FIGURE E7



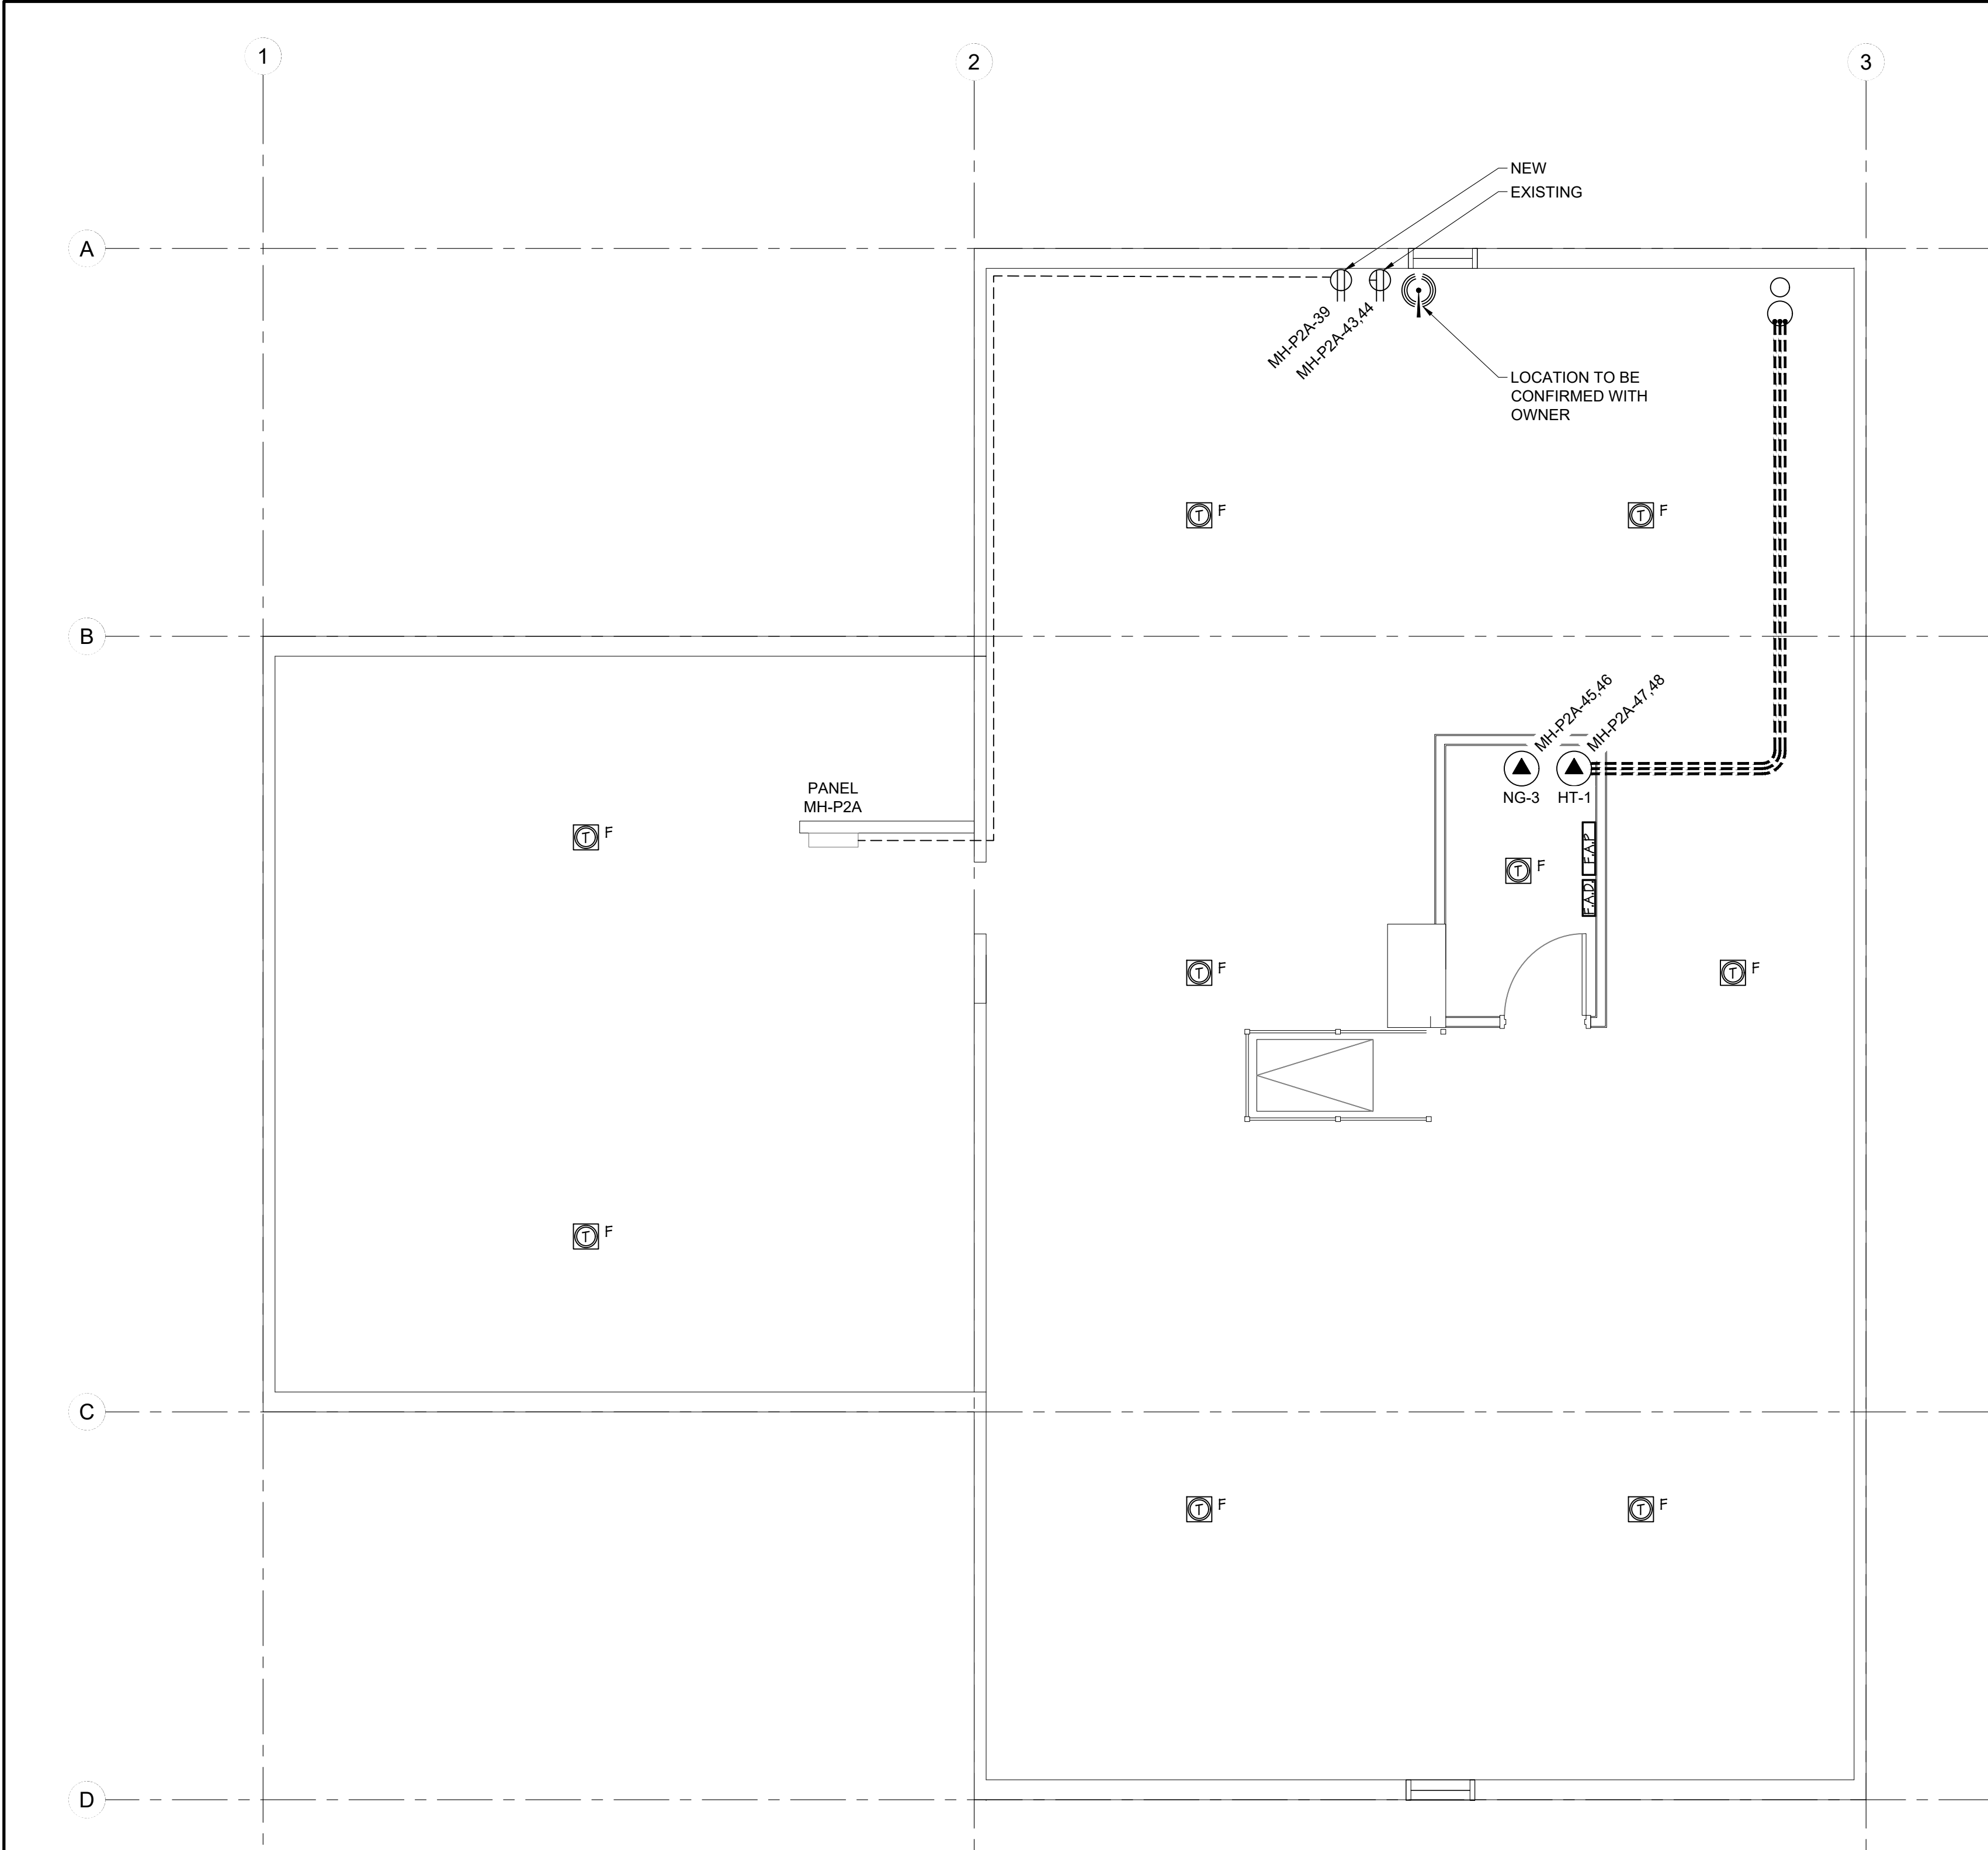

MEN'S HOUSE- ATTIC LEVEL

1:50

FIRE ALARM LEGEND		
ITEM	SYMBOL	REMARKS
FIRE ALARM CONTROL PANEL		EXISTING TO REMAIN
FIRE ALARM DEMARCATION BOX		NEW
HEAT DETECTOR (FIXED TEMPERATURE TYPE)		NEW DEVICE & WIRING

COMMUNICATIONS LEGEND		
ITEM	SYMBOL	REMARKS
CELL PHONE BOOSTER		NEW. INTERCONNECTED w/ ALARM SYSTEM
RECEPTACLE 15A, 120V, DUPLEX		NEW
RECEPTACLE 20A, 120V DUPLEX		EXISTING TO REMAIN

EQUIPMENT		
ITEM	SYMBOL	REMARKS
EQUIPMENT CONNECTION		
NITROGEN GENERATOR	NG-#	NEW
HEAT TRACE	HT-#	NEW

- MEN'S HOUSE GENERAL CONSTRUCTION NOTES:
- INSTALL NEW 15A RECEPTACLE TO SUPPLY POWER TO CELL PHONE BOOSTER. CONNECT RECEPTACLE TO PANEL MH-P2A w/ AC90 CABLE ON CIRCUIT MH-P2A-39. USE EXISTING 15A SPARE BREAKER SEE FIGURE E5.
  - INSTALL NEW FIRE ALARM DEMARCATION BOX. SEE FIGURE E6
  - INTERCONNECT HEAT TRACE ALARM OUTPUT TO FIRE ALARM SYSTEM.
  - CONNECT POWER TO NITROGEN GENERATOR.



FIGURE E5



FIGURE E6

Parks Canada

Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08

Revision	Description	Date
Client		Client

PARKS CANADA AGENCY

.


220 4 AVE SE, SUITE 720  
CALGARY, AB. T2G 4X3

Project title	Projet
LOWER FORT GARRY NATIONAL HISTORIC SITE ST. ANDREWS, MB.	
REHABILITATION FROM WATER DAMAGE LOWER FORT GARRY	
Designed by	Conçu par
KAS	
Drawn by	Dessiné par
RTD	
Approved by	Approuvé par
LL	
Project Manager	Administrateur de Projets
CHRISTINE LeCLERC	
Drawing title	Titre du dessin
MEN'S HOUSE FIRE ALARM SYSTEM PLAN ATTIC LEVEL	
.	
.	

Project No./No. du projet	Drawing No./No. du dessin	Revision No.
5P468-21-0054	E2.2	R00
	38 OF 42	

E2.2.dwg



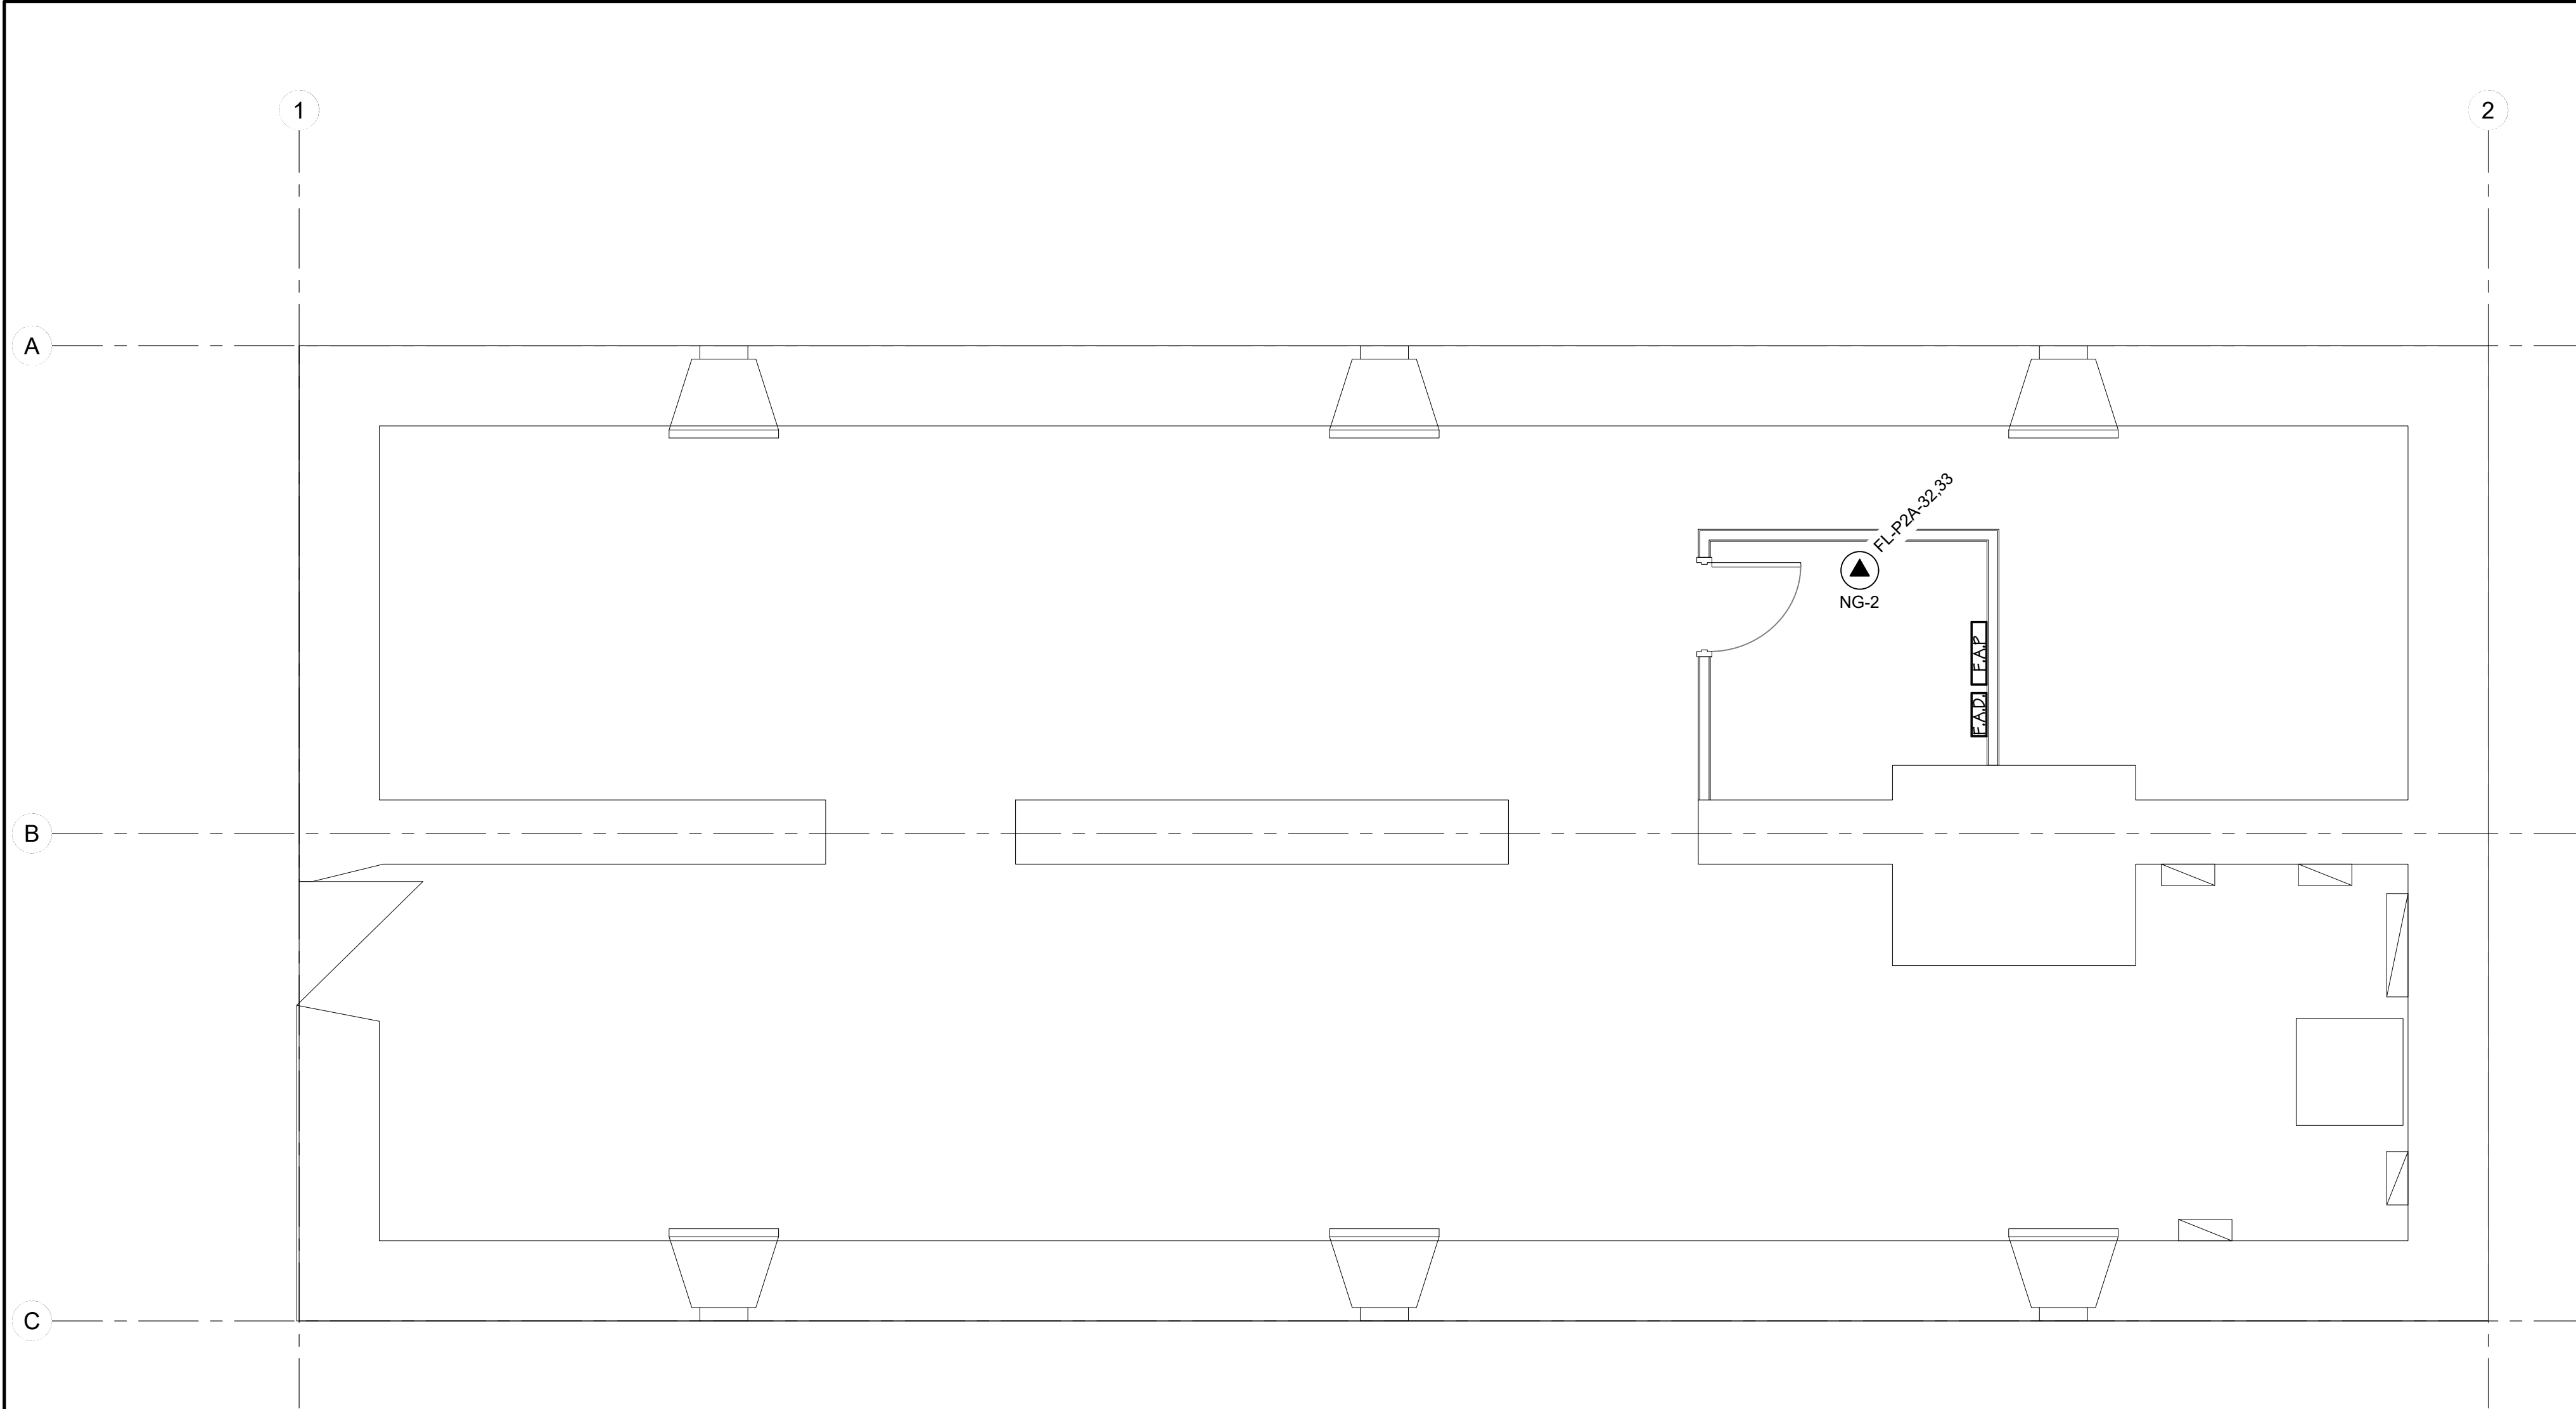

FUR LOFT- BASEMENT FLOOR

1:50

FIRE ALARM LEGEND		
ITEM	SYMBOL	REMARKS
FIRE ALARM CONTROL PANEL		EXISTING TO REMAIN
FIRE ALARM DEMARCATION BOX		NEW

EQUIPMENT		
ITEM	SYMBOL	REMARKS
EQUIPMENT CONNECTION		
NITROGEN GENERATOR	NG-#	NEW

FUR LOFT GENERAL CONSTRUCTION NOTES:	
-	INSTALL NEW FIRE ALARM DEMARCATION BOX. SEE FIGURE E8.
-	CONNECT POWER TO NITROGEN GENERATOR.



LOCATION OF NEW FIRE ALARM DEMARCATION BOX

FIGURE E8

Parks Canada

Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

SEAL

5	-	-
4	-	-
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08
Revision	Description	Date
Client		Client

PARKS CANADA AGENCY

.


.

220 4 AVE SE, SUITE 720

CALGARY, AB. T2G 4X3

Project title	Projet	
LOWER FORT GARRY NATIONAL HISTORIC SITE ST. ANDREWS, MB.		
REHABILITATION FROM WATER DAMAGE LOWER FORT GARRY		
Designed by	Conçu par	
KAS		
Drawn by	Dessiné par	
RTD		
Approved by	Approuvé par	
LL		
Project Engineer	Administrateur de Projets	
CHRISTINE LeCLERC	IPSGC	
Drawing title	Titre du dessin	
FUR LOFT FIRE ALARM SYSTEM PLAN BASEMENT FLOOR		
.		
.		
.		
Project No./No. du projet	Drawing No./No. du dessin	Revised No.
5P468-21-0054	E3.1	R00
	39 OF 42	



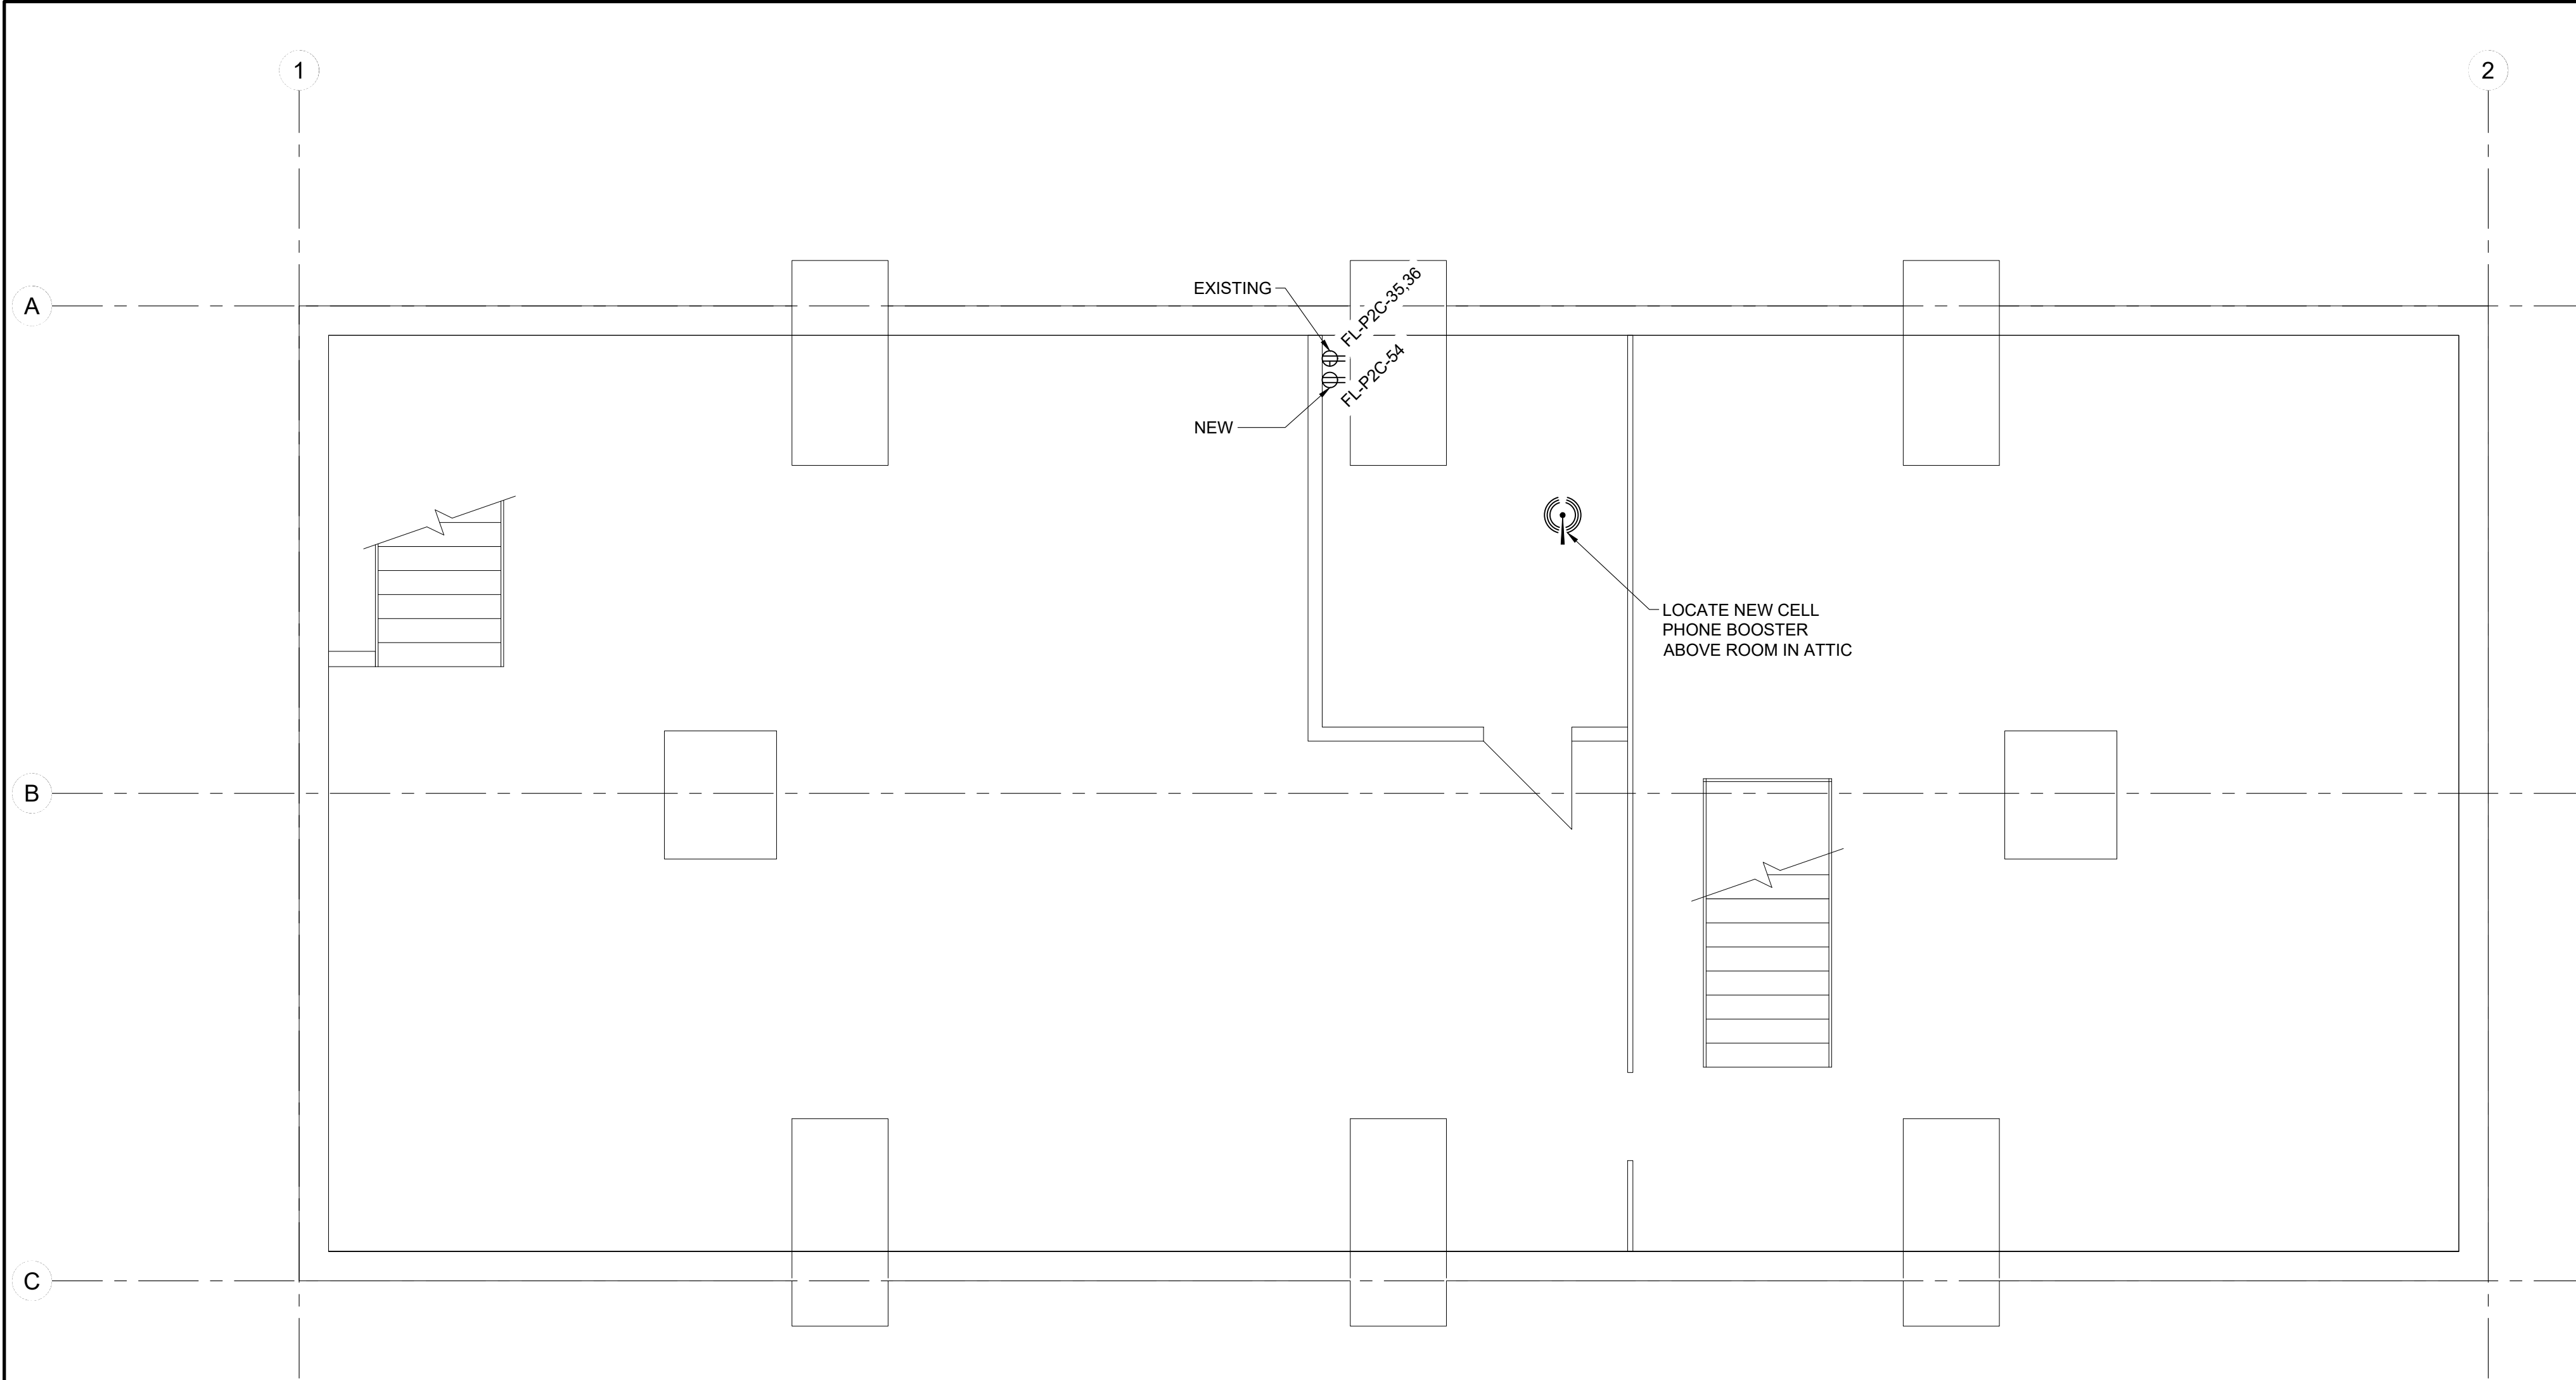

FUR LOFT- ATTIC LEVEL

1:50

COMMUNICATIONS LEGEND		
ITEM	SYMBOL	REMARKS
CELL PHONE BOOSTER		NEW. INTERCONNECTED w/ ALARM SYSTEM
RECEPTACLE 15A, 120V, DUPLEX		NEW
RECEPTACLE 20A, 120V, DUPLEX		EXISTING TO REMAIN

FUR LOFT GENERAL CONSTRUCTION NOTES:	
- INSTALL NEW 15A RECEPTACLE TO SUPPLY POWER TO CELL PHONE BOOSTER. CONNECT RECEPTACLE TO PANEL FL-P2C w/ AC90 CABLE ON CIRCUIT FL-P2C-54. CABLE TO FOLLOW SAME PATH AS CABLE FEEDING EXISTING RECEPTACLE ON CIRCUIT FL-P2C-35,36. SEE FIGURE E9.	

Parks Canada

Parcs Canada

Parks Canada

Western Region

Parcs Canada

Région de l'ouest

CIVIL | STRUCTURAL | MECHANICAL | ELECTRICAL | INDUSTRIAL

12 Aviation Boulevard  
St. Andrews MB R1A 3N5 Canada

T: 204-334-8846  
www.dghengineering.com

SEAL

5		
4		
3	TENDER READY RESUBMISSION	2022-06-29
2	TENDER READY	2022-04-11
1	ISSUED FOR 90% REVIEW RESUBMISSION	2021-12-14
0	ISSUED FOR 90% REVIEW	2021-11-08
Revision	Description	Date
Client		Client

**PARKS CANADA AGENCY**

.

.

220 4 AVE SE, SUITE 720  
CALGARY, AB. T2G 4X3

Project title

Project

**LOWER FORT GARRY  
NATIONAL HISTORIC SITE  
ST. ANDREWS, MB.**

**REHABILITATION  
FROM WATER DAMAGE  
LOWER FORT GARRY**

Designed by

Conçu par

**KAS**

Drawn by

Dessiné par

**RTD**

Approved by

Approuvé par

**LL**

Project Manager

Administrateur de Projets

**CHRISTINE LeCLERC**

Project title

Titre du dessin

**FUR LOFT  
FIRE ALARM SYSTEM PLAN  
ATTIC LEVEL**

.

.

.

Project No./No. du projet

Revision No./No. de Rev.

Revision

**5P468-21-0054**

**E3.4**  
40 OF 42

**R00**



LOCATION OF NEW 15A RECEPTACLE

FIGURE E9




LOCATE NEW CELL BOOSTER ABOVE ROOM IN ATTIC

FIGURE E10




## BIG HOUSE

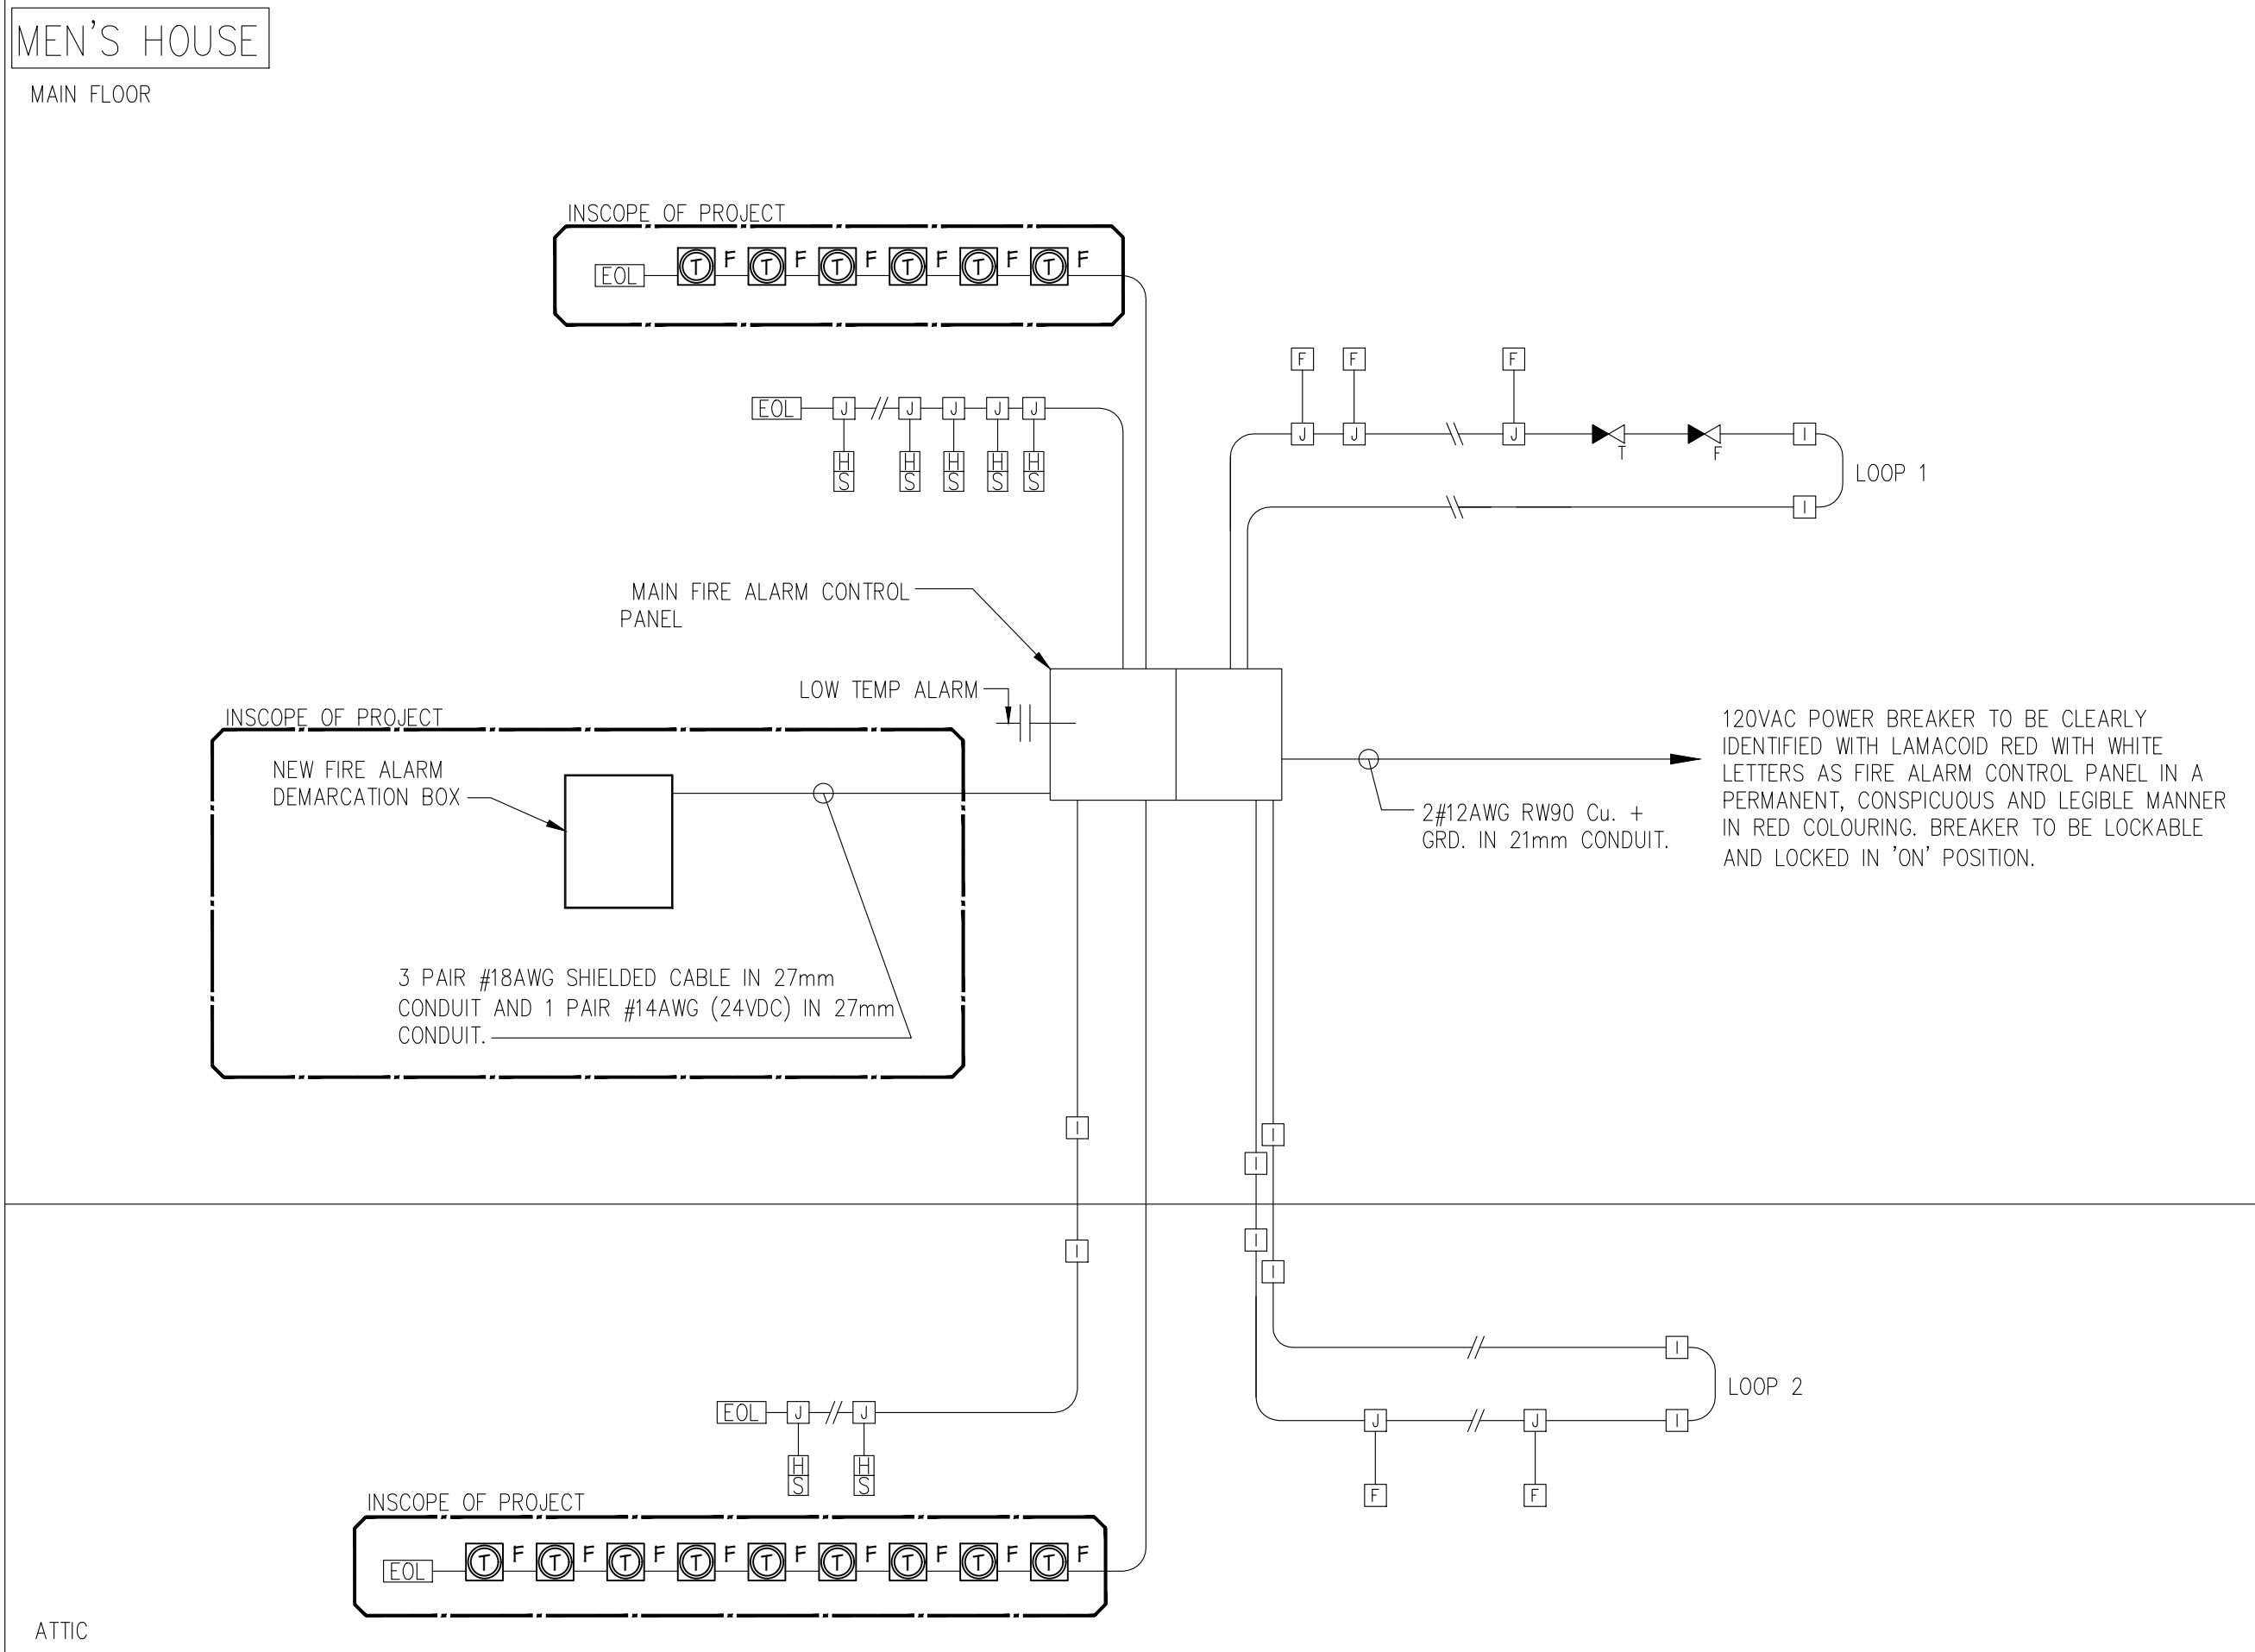


1. END-OF-LINE DEVICES TO HAVE AN IDENTIFYING LABEL SECURELY ATTACHED TO THE FRONT OF THE COVER PLATE, LISTING THE ZONE OR DEVICE SERVED. THE END-OF-LINE DEVICES TO BE LABELLED OR IDENTIFIED AS PER CAN/ULC S524-19-AM01, SENTENCE 10.3.1.
2. THE INTELLIGENT ADDRESSABLE MODULES THAT ARE USED TO MONITOR CONTACT DEVICES (LOW PRESSURE SWITCH, ALARM PRESSURE SWITCH, TAMPER SWITCHES...) AND THE FAULT ISOLATION MODULES HAVE TO BE LABELLED WITH THE DEVICES OR CIRCUITS THEY SERVE.
3. THE MONITORING OF THE FIRE ALARM SYSTEM TO BE PROVIDED IN ACCORDANCE WITH SENTENCE 3.2.4.8(4) OF THE NBCC. THIS INCLUDES THE MONITORING OF SUPERVISORY AND TROUBLE SIGNALS AND PROVIDED IN CONFORMANCE WITH CAN/ULC-S561, "INSTALLATION AND SERVICES FOR FIRE SIGNAL RECEIVING CENTRES AND SYSTEMS."
4. WIRE AND CONNECT AIR HANDLING AND MAKE-UP AIR UNITS TO FIRE ALARM PANEL FOR FAN SHUTDOWN AS REQUIRED BY CODE.
5. ELECTRICAL CONTRACTOR TO INCLUDE ALL COSTS ASSOCIATED WITH SETTING-UP, TESTING AND THE VERIFICATION OF THE FIRE ALARM SYSTEM. THE MANUFACTURER WITH THE ASSISTANCE OF THE ELECTRICAL CONTRACTOR AND THE DEPARTMENTAL REPRESENTATIVE TO PERFORM A COMPLETE FIRE ALARM VERIFICATION AFTER THE INSTALLATION HAS BEEN COMPLETED. A COPY OF THE REPORT OF REVIEW AND A COMPLETE REPORT SHALL BE SENT TO THE DEPARTMENTAL REPRESENTATIVE FOR REVIEW. THE ENTIRE FIRE ALARM SYSTEM AND INSTALLATION SHALL CARRY A ONE (1) YEAR WARRANTY FROM THE DATE OF SUBSTANTIAL COMPLETION.
6. THE ENTIRE INSTALLATION TO BE TO THE FULL SATISFACTION OF THE DEPARTMENTAL REPRESENTATIVE.

1. INTERCONNECT WIRING FROM THE FIRE ALARM CONTROL PANEL TO THE FIRE SIGNAL RECEIVING CENTRE. THIS INSTALLATION SHALL COMPLY WITH CAN/ULC-5561, STANDARD FOR INSTALLATION AND SERVICES FOR FIRE SIGNAL RECEIVING CENTRES AND SYSTEMS.
2. A DEMARCATION TERMINAL BOX FOR THE INTERCONNECTION BETWEEN THE FIRE ALARM CONTROL PANEL AND THE FIRE ALARM TRANSMITTER SHALL HAVE A MINIMUM OF 12 TERMINALS TO FACILITATE THE ELECTRICAL SUPERVISION OF FIRE ALARM, FIRE TRIGGER AND FIRE SUPERVISORY CONNECTIONS.
3. THE FIRE ALARM DEMARCATION TERMINAL BOX SHALL BE LABELLED "FIRE ALARM DEMARCATION".
4. THE FIRE ALARM DEMARCATION TERMINAL BOX SHALL BE LOCATED IN THE SAME ROOM AS THE FIRE ALARM CONTROL PANEL.
5. ALARM, TROUBLE, AND SUPERVISORY CONTACTS ARE EXTENDED FROM THE FIRE ALARM CONTROL PANEL TO THE DEMARCATION. THE FIRE ALARM CONTROL PANEL TECHNICIAN CONNECTS THE FIRE ALARM CONTROL PANEL AND THE JUNCTION BOX AND TAGS THE CONDUCTORS IN THE TERMINAL BOX.

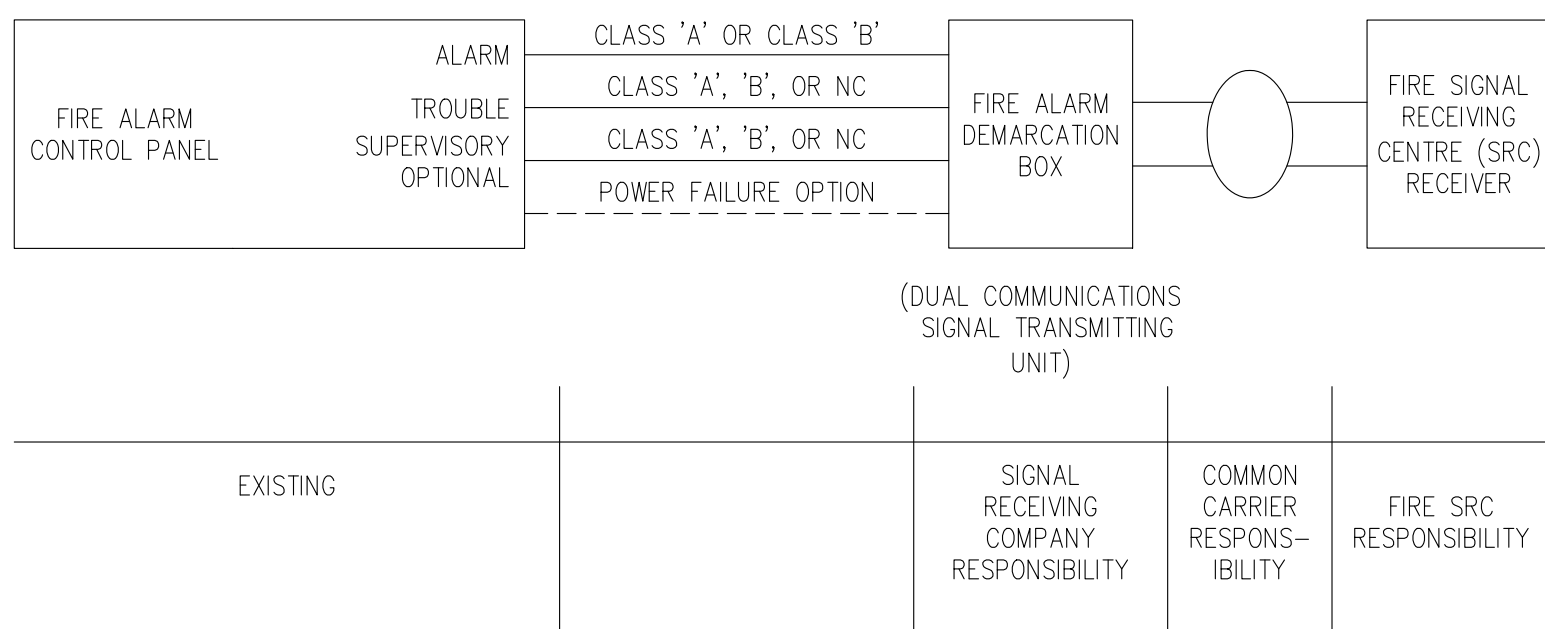

## FIRE ALARM DEMARCATION BOX DETAIL

## FURLOFT

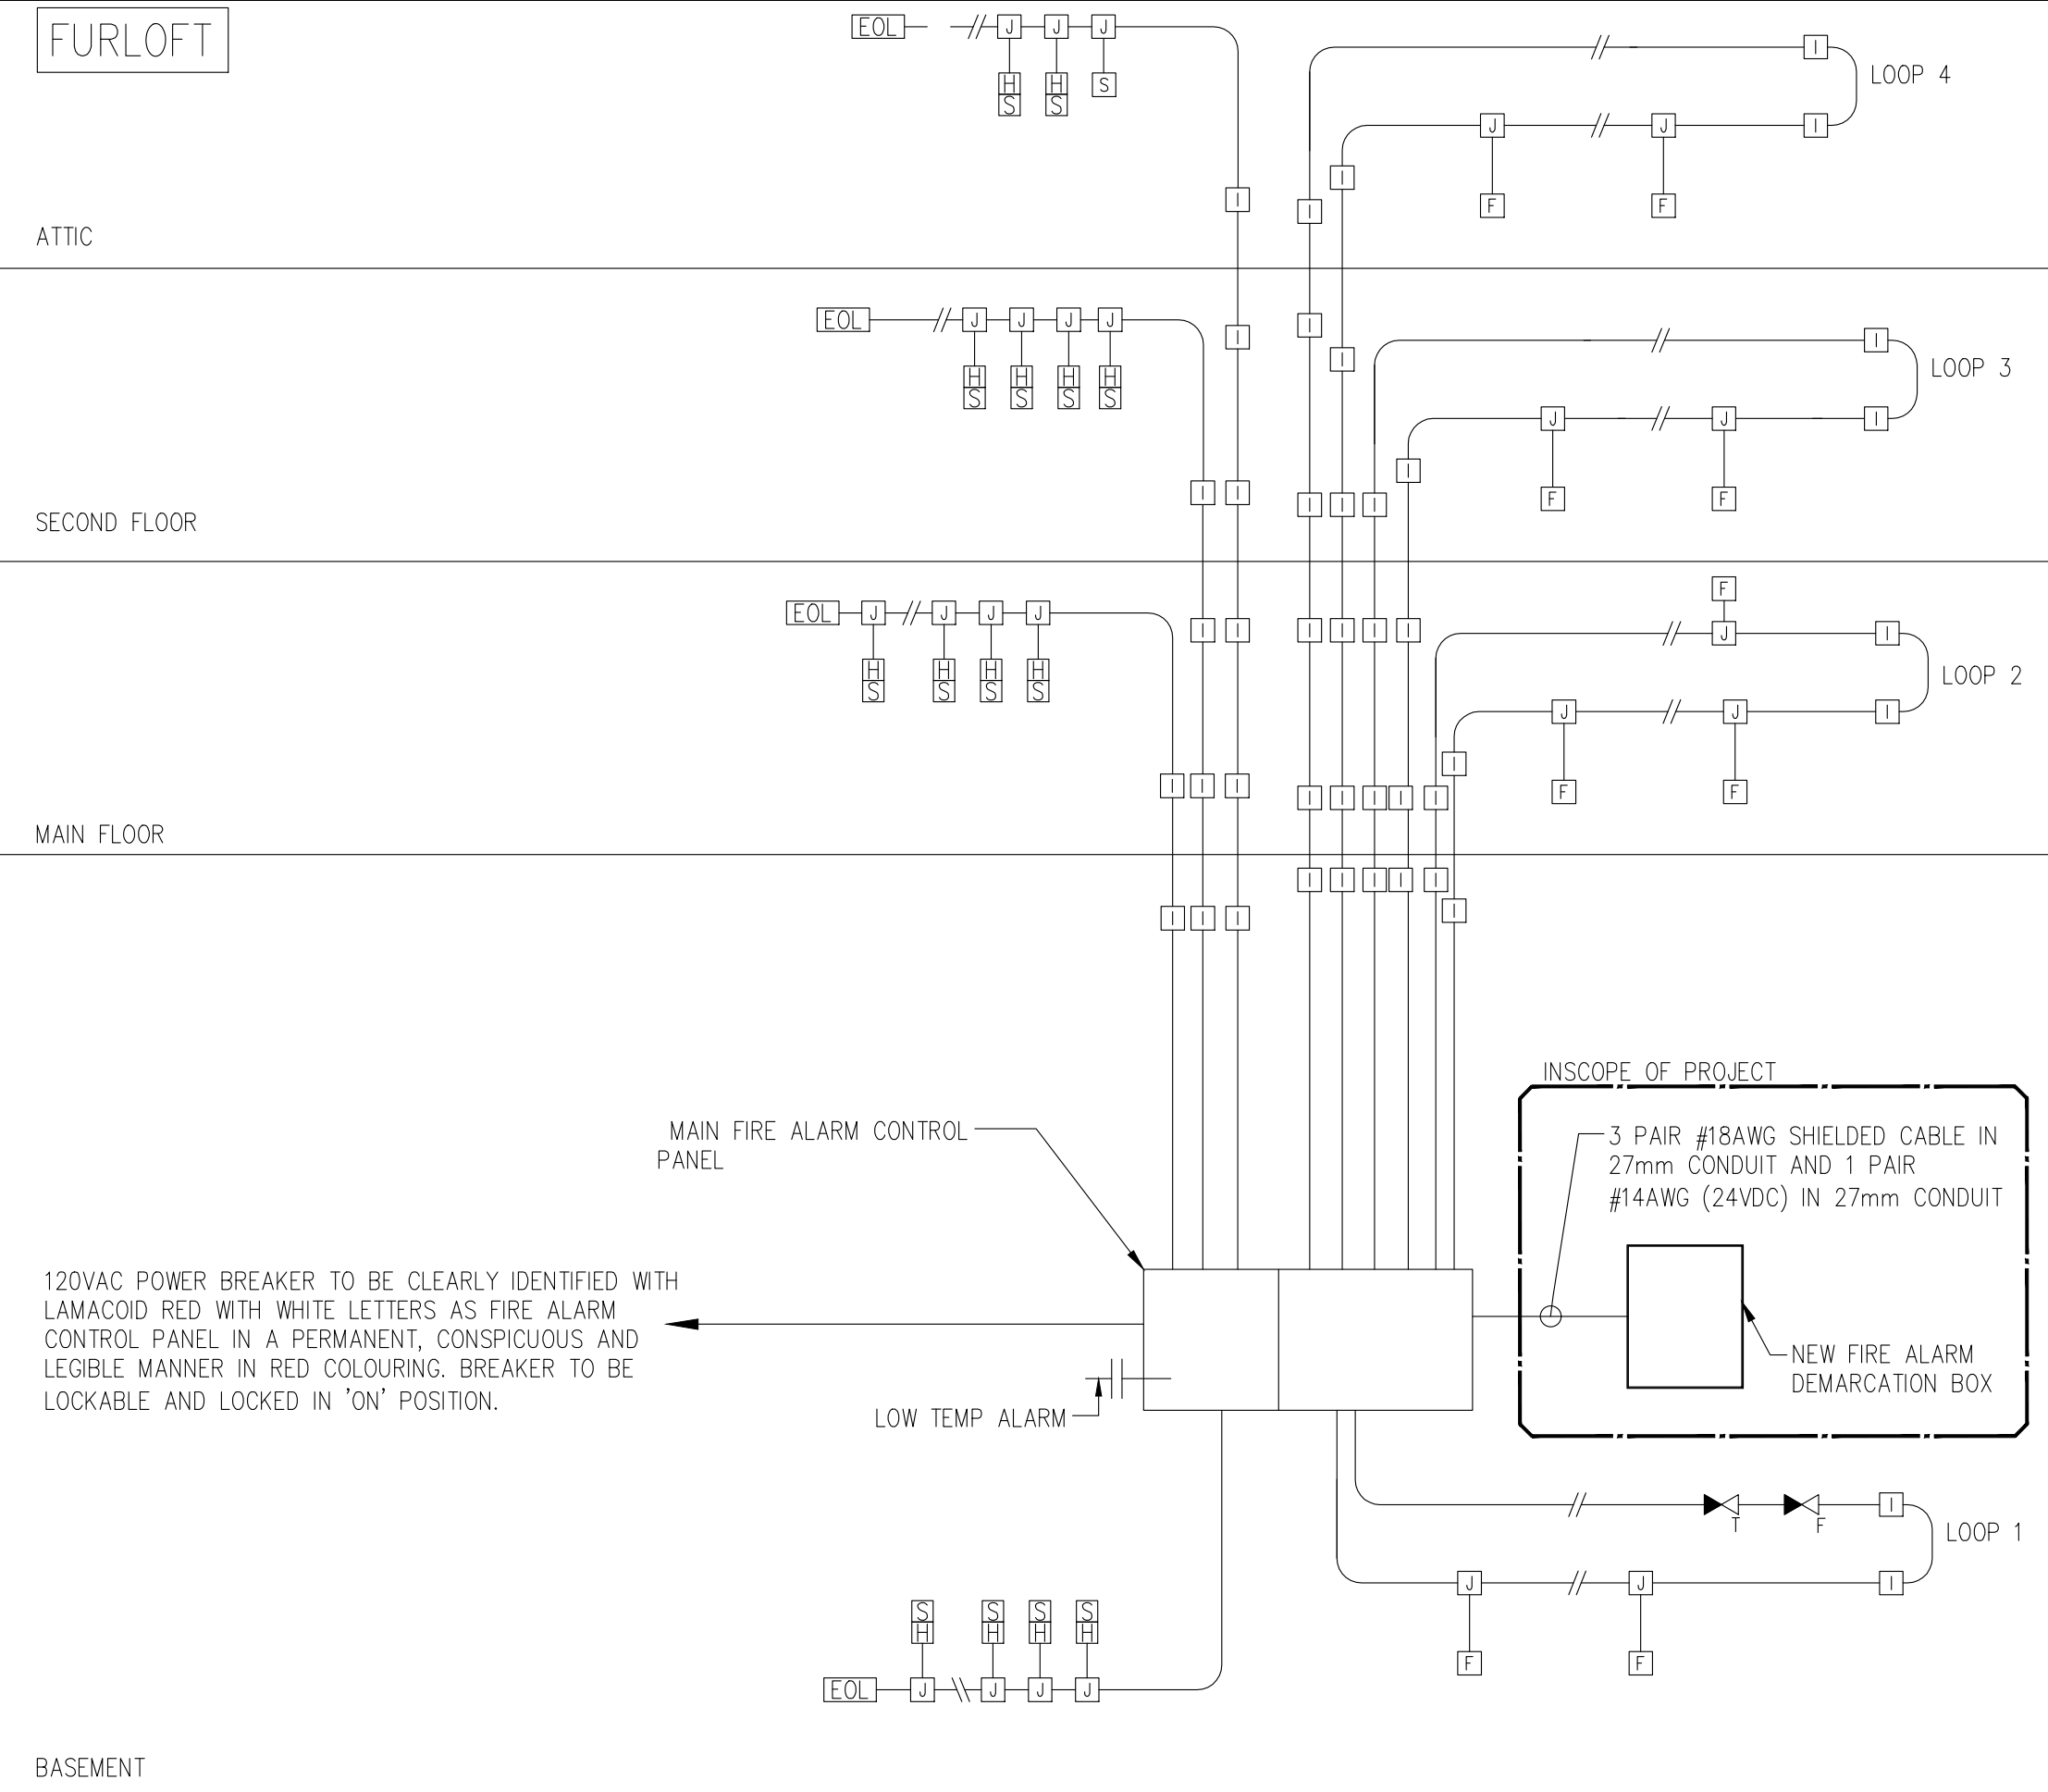



ITEM	LOAD (kW)	OCF	C	C	ITEM	LOAD (kW)	OCF
ECH-1		15A	1	37			
ECH-2		15A	2	38	ROOM 14 ELECTRIC HEATING		20A, 2P
ECH-3		15A	3	39			
HRV-1		20A	4	40	ROOM 18 ELECTRIC HEATING		20A, 2P
RHC-1		15A, 3P	5	41			
			6	42	ROOM 17 ELECTRIC HEATING		20A, 2P
			7	43			
SP-1		20A	8	44			
DHW-1		30A, 3P	9	45	ROOM 17 ELECTRIC HEATING		20A, 2P
			10	46			
			11	47	ROOM 19 ELECTRIC HEATING		20A, 2P
ROOM AB1 ELECTRIC HEATING		20A, 2P	12	48			
			13	49	ROOM 19 ELECTRIC HEATING		20A, 2P
ROOM AB1 ELECTRIC HEATING		20A, 2P	14	50			
			15	51	ROOM 15 + 16 ELECTRIC HEATING		20A, 2P
ROOM LB1 ELECTRIC HEATING		20A, 2P	16	52			
			17	53	ROOM L11 ELECTRIC HEATING		20A, 2P
ROOM B3 ELECTRIC HEATING		20A, 2P	18	54			
			19	55	ROOM 11 ELECTRIC HEATING		20A, 2P
ROOM B3 ELECTRIC HEATING		20A, 2P	20	56			
			21	57	ROOM 12 ELECTRIC HEATING		20A, 2P
ROOM A-12 ELECTRIC HEATING		20A, 2P	22	58			
			23	59	ROOM 14 ELECTRIC HEATING		20A, 2P
ROOM A-13 ELECTRIC HEATING		20A, 2P	24	60			
			25	61			
ROOM A-11 ELECTRIC HEATING		20A, 2P	26	62	NG-1		15A, 2P
			27	63			
ROOM A-11 ELECTRIC HEATING		20A, 2P	28	64	EF-1		15A
			29	65	SP-2		15A
ROOM A-15 + 16 ELECTRIC HEATING		20A, 2P	30	66			15A
			31	67	ROOM B3 ELECTRIC HEATING	2.25	15A, 2P
ROOM L13 ELECTRIC HEATING		20A, 2P	32	68			
			33	69	ROOM B3 ELECTRIC HEATING	2.25	15A, 2P
ROOM 13 ELECTRIC HEATING		20A, 2P	34	70			
			35	71	ROOM B4 ELECTRIC HEATING	2.00	15A, 2P
			36	72			
					MOUNTING: SURFACE RATING:		

PANELBOARD DIRECTORY 'BH-P2B' FOR BIG HOUSE							
ITEM	LOAD (kW)	OCF	C	C	ITEM	LOAD (kW)	OCF
ROOM AB-1 RECEPTACLE		20A	1	31	LIGHTING R20, R21		15A
ROOM LB-1 RECEPTACLE		20A	2	32	LIGHTING R24		15A
ROOM B-1 RECEPTACLE		20A	3	33	LIGHTING R25		15A
ROOM B-8 RECEPTACLE		20A	4	34	LIGHTING R26		15A
BASEMENT CLOSET RECEPTACLE		20A	5	35	LTG WASHROOMS, KIT., ELEC, MECH		15A
ROOM B3 RECEPTACLE		20A	6	36	INVERTER ELI-B		15A
ROOM A12 RECEPTACLE		20A	7	37	INVERTER ELI-M		15A
ROOM A11 RECEPTACLE		20A	8	38	IAP		15A
ROOM A15 RECEPTACLE		20A	9	39	LIFT GFI		15A
ROOM A14 RECEPTACLE		20A	10	40	LIFT HEATING AND LIGHTING		20A 2P
ROOM A13 RECEPTACLE		20A	11	41			
ROOM L13 RECEPTACLE		20A	12	42	FIRE ALARM (RED + LOCKING)		15A
ROOM L11 RECEPTACLE		20A	13	43			
ROOM 11 RECEPTACLE		20A	14	44			
ROOM 12 RECEPTACLE		20A	15	45			
ROOM 14 RECEPTACLE		20A	16	46			
ROOM 13 RECEPTACLE		20A	17	47			
ROOM 17 RECEPTACLE		20A	18	48			
ROOM 18 RECEPTACLE		20A	19	49			
ROOM 19 RECEPTACLE		20A	20	50			
DOOR OPERATOR		15A	21	51			
DOOR OPERATOR		15A	22	52			
DOOR OPERATOR		15A	23	53			
LIFT		20A	24	54			
LIGHTING R1, R2		15A	25	55			
LIGHTING R3, R4, R5, R6		15A	26	56			
LIGHTING R7, 8, 9		15A	27	57			
LIGHTING R10, R11, R12, R16, R17		15A	28	58			
LIGHTING R13, R14, R15		15A	29	59			
LIGHTING R18, R19, R22, R23		15A	30	60			
NOTES:					MOUNTING: SURFACE		
PROVIDE LOCKING DEVICE FOR CIRCUITS 36, 37 AND 38					RATING: SEE SINGLE LINE DISTRIBUTION DIAGRAM		

PANELBOARD DIRECTORY 'MH-P2A' FOR MEN'S HOUSE							
ITEM	LOAD (kW)	OCF	C	C	ITEM	LOAD (kW)	OCF
STOVE		40A, 2P	1	31	IAP		15A
COUNTER RECEPTACLES		15A	2	32	240V HEATER ATTIC		20A, 2P
HIDDEN RECEPTACLES		20A	3	33	SPARE		15A
HIDDEN RECEPTACLES		20A	4	34	SPARE		15A
240V HIDDEN RECEPTACLES		20A, 2P	5	35	SPARE		15A
			6	36	SPARE		15A
			7	37	SPARE		15A
240V HIDDEN RECEPTACLES		20A, 2P	8	38	SPARE		15A
			9	39	ATTIC RECEPTACLE	1.00	15A
240V HIDDEN RECEPTACLES		20A, 2P	10	40	SPARE		15A
			11	41	EBB-MH-1 (LOCKING)		20A
240V HIDDEN RECEPTACLES		20A, 2P	12	42	FIRE ALARM (RED+ LOCKING)		15A, 2P
			13	43			
240V HIDDEN RECEPTACLES		20A, 2P	14	44	240V HEATER ATTIC		20A, 2P
			15	45			
240V HIDDEN RECEPTACLES		20A, 2P	16	46	NG-3		15A, 2
			17	47			
240V HIDDEN RECEPTACLES		20A, 2P	18	48	HEAT TRACE CONTROLLERS (x2)		15A 2P
			19	49	SPARE		15A
240V HIDDEN RECEPTACLES		20A, 2P	20	50	SPARE		15A
			21	51	SPARE		15A
240V HIDDEN RECEPTACLES		20A, 2P	22	52	SPARE		15A
			23	53	SPARE		15A
240V HEATER ATTIC		20A, 2P	24	54	SPARE		15A
			25	55	SPARE		15A
240V HEATER ATTIC		20A, 2P	26	56	SPARE		15A
			27	57	SPARE		15A
240V HEATER ATTIC		20A, 2P	28	58	SPARE		15A
			29	59	SPARE		15A
EBB-MH-1		15A	30	60	SPARE		15A
NOTES: PROVIDE LOCKING DEVICE FOR CIRCUITS 30 AND 31					MOUNTING: RATING: SEE SINGLE LINE DISTRIBUTION DIAGRAM		

PANELBOARD DIRECTORY 'FL-P2A' FOR FURLOFT									
ITEM	LOAD (kW)	OCB	C	C	ITEM	LOAD (kW)	OCB		
BASEMENT RECEPTACLE		20A	1	22	SPARE		20A		
BASEMENT RECEPTACLE		20A	2	23	SECOND FLOOR RECEPTACLE		20A		
BASEMENT RECEPTACLE		20A	3	24	SPARE		20A		
BASEMENT RECEPTACLE		20A	4	25	SECOND FLOOR RECEPTACLE		20A		
BASEMENT RECEPTACLE		20A	5	26	SECOND FLOOR RECEPTACLE		20A		
FL-UH-1		30A,2P	6	27	SECOND FLOOR RECEPTACLE		20A		
			7	28	SECOND FLOOR RECEPTACLE		20A		
MAIN FLOOR REC'S (x4) DUPLEX		20A	8	29	SECOND FLOOR RECEPTACLE		20A		
EBB-FL-1		15A	9	30	SECOND FLOOR RECEPTACLE		20A		
EBB-FL-2		15A	10	31	ATTIC RECEPTACLE		20A		
EBB-FL-3		15A	11	32	NG-2		15A, 2		
EBB-FL-4		15A	12	33					
MAIN FLOOR REC'S (x5) DUPLEX		20A	13	34					
IAP		15A	14	35					
SPARE		20A	15	36					
SPARE		20A	16	37					
SPARE		20A	17	38					
SPARE		20A	18	39					
SECOND FLOOR RECEPTACLE		20A	19	40					
SPARE		20A	20	41	FIRE ALARM (RED + LOCKING)		15A		
SECOND FLOOR RECEPTACLE		20A	21	42					
NOTES:					MOUNTING:				
PROVIDE LOCKING DEVICE FOR CIRCUITS 9, 10, 11, 12, 14 AND 41					RATING: SEE SINGLE LINE DISTRIBUTION DIAGRAM				

NOTE:

ELECTRICAL REQUIREMENTS FOR NEW NITROGEN GENERATORS  
w/ INTERNAL COMPRESSOR TO BE CONFIRMED.

ITEM	LOAD (kW)	OCF	C	C	ITEM	LOAD (kW)	OCF
208 HEATER SECOND FLOOR		20A, 2P	1	37	208 HEATER ATTIC		20A, 2P
			2	38			
208 HEATER SECOND FLOOR		20A, 2P	3	39	208 HEATER ATTIC		20A, 2P
			4	40			
208 HEATER SECOND FLOOR		20A, 2P	5	41	208 HEATER SECOND FLOOR		20A, 2P
			6	42			
208 HEATER SECOND FLOOR		20A, 2P	7	43	208 HEATER ATTIC		20A, 2P
			8	44			
208 HEATER SECOND FLOOR		20A, 2P	9	45	ATTIC RECEPTACLE	1.00	15A
			10	46			
208 HEATER SECOND FLOOR		20A, 2P	11	47	208 HEATER ATTIC		20A, 2P
			12	48			
208 HEATER SECOND FLOOR		20A, 2P	13	49	OUTSIDE PLUG		
			14	50	OUTSIDE PLUG		
208 HEATER SECOND FLOOR		20A, 2P	15	51	208 HEATER ATTIC		20A, 2P
			16	52			
208 HEATER SECOND FLOOR		20A, 2P	17	53	ATTIC PLUG		
			18	54			
208 HEATER SECOND FLOOR		20A, 2P	19	55	208 HEATER ATTIC		20A, 2P
			20	56			
208 HEATER SECOND FLOOR		20A, 2P	21	57			
			22	58			
208 HEATER ATTIC		20A, 2P	23	59	208 HEATER ATTIC		20A, 2P
			24	60			
208 HEATER ATTIC		20A, 2P	25	61	BATHROOM PANEL		20A, 2P
			26	62			
208 HEATER ATTIC		20A, 2P	27	63			
			28	64			
208 HEATER ATTIC		20A, 2P	29	65			
			30	66			
208 HEATER ATTIC		20A, 2P	31	67			
			32	68			
208 HEATER ATTIC		20A, 2P	33	69			
			34	70			
208 HEATER ATTIC		20A, 2P	35	71			
			36	72			
					MOUNTING: SURFACE		
					RATING:		