



WATER BOXES (BY NORRIS WARMING)
 ON THERMOSTATS (BY NORRIS WARMING)

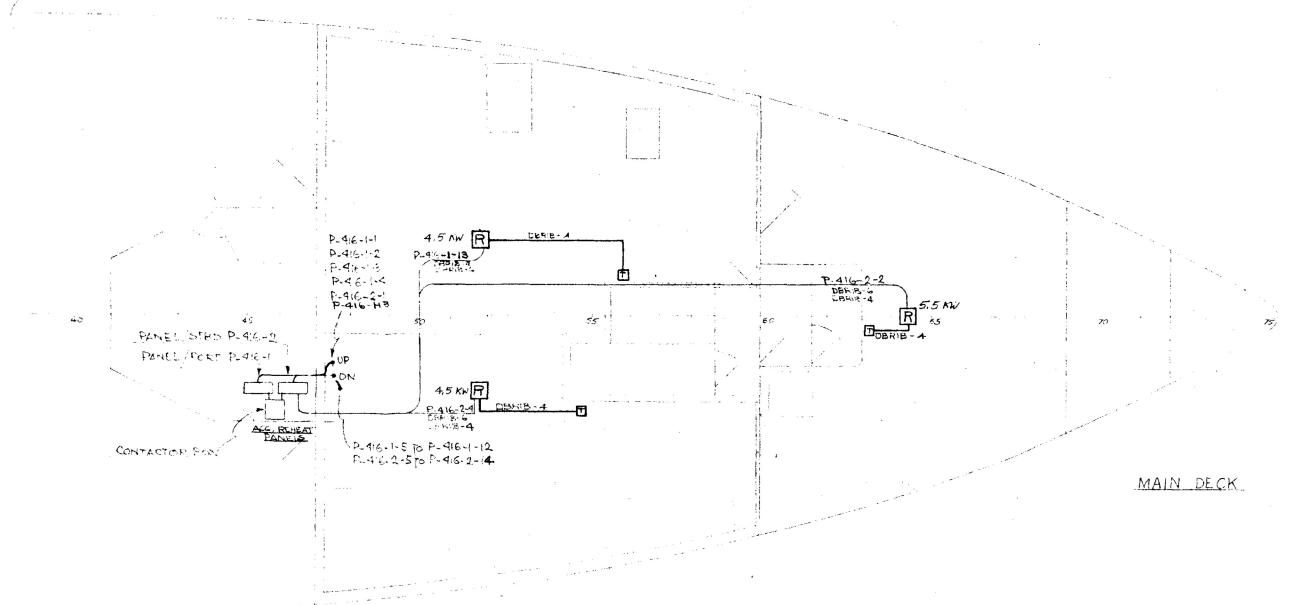

MAIN DECK

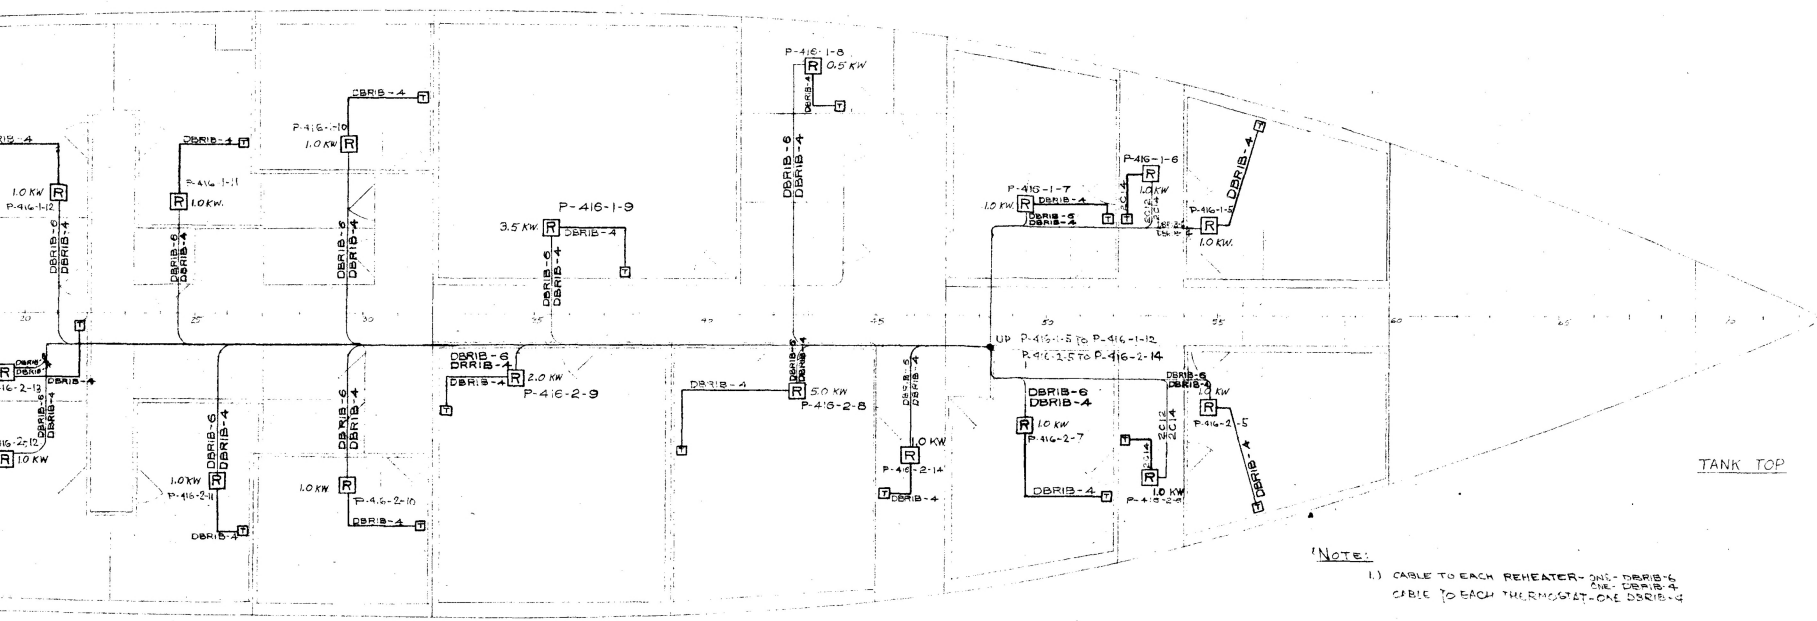

TANK TOP

NOTE:
 1.) CABLE TO EACH REHEATER - ONE DBRIB-4
 ONE DBRIB-6
 CABLE TO EACH THERMOSTAT - ONE DBRIB-4

B	ADDED REHEATER P-416-1-13 & P-416-2-4
A	GENERAL REVISION
No.	DESCRIPTION
	REVISION
ELECTRIC HEATING HULL PORT WELLS ST. CATHARINES	
BLENKHORN & PROFESSIONAL ST. CATHARINES	
SCALE	1/4"=1'-0"
DRAWN	[Signature] 02/11/67
CHECKED	[Signature] 12/10/67
APPROVED	[Signature] 2/2/67