



WINDOW SCHEDULE			
SYMBOL	WIDTH	HEIGHT	DESCRIPTION
<b>[W1]</b>	1800mm	2414mm	ALUMINUM ENTRANCE – WINDOW AND ALUMINUM PANEL
<b>[W2]</b>	1400mm	2414mm	ALUMINUM ENTRANCE – WINDOW AND ALUMINUM PANEL
<b>[W3]</b>	1017mm	2414mm	ALUMINUM ENTRANCE – WINDOW AND ALUMINUM PANEL
<b>[W4]</b>	1000mm	1814mm	THERMALLY BROKEN ALUMINUM WINDOW, FIXED

DOOR SCHEDULE							
DOOR #	FROM	TO	DOOR TYPE	WIDTH	HEIGHT	DESCRIPTION	HARDWARE
D1.1	01	EXT.	D1	915mm	2134mm	ALUMINUM CURTAIN WALL ENTRANCE DOOR	H-1
D1.2	01	EXT.	D1	915mm	2134mm	ALUMINUM CURTAIN WALL ENTRANCE DOOR	H-1
D2.1	02	EXT.	D1	915mm	2134mm	ALUMINUM CURTAIN WALL ENTRANCE DOOR	H-1
D3.1	02	03	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-3
D4.1	02	04	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-3
D5.1	02	05	D2	915mm	2438mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-3
D6.1	02	06	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-3
D7.1	02	07	D2B	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-4
D8.1	02	08	D2B	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-5
D9.1	02	09	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-6
D10.1	02	10	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-6
D11.1	EXT.	11	D3	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME – RATED FIR 1h MECH. ROOM	H-7
D12.1	01	12	D4	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-8
D13.1	01	13	D2	915mm	2134mm	INSULATED METAL DOOR / PRESSED STEEL FRAME	H-13
D14.1	EXT.	14	D1	915mm	2134mm	ALUMINUM CURTAIN WALL ENTRANCE DOOR	H-2
D14.2	EXT.	14	D5	915mm	2438mm	ALUMINUM OPERABLE DOORS	H-9

NOTE: SEE FLOOR PLAN FOR DOOR SWING. REFER TO SPECIFICATION FOR HARDWARE SCHEDULE FOR EACH ROOM/DOOR REQUIREMENTS.

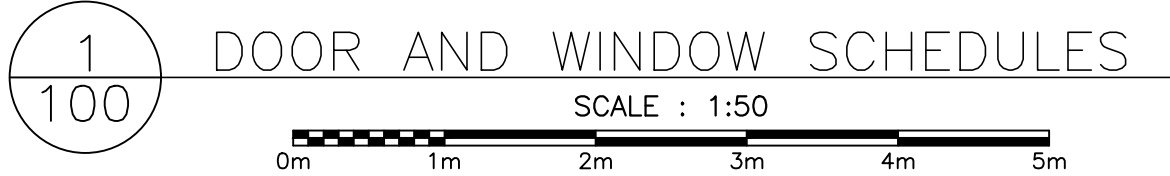


NOTE: COORDINATE TOP OF FRAMING WITH UNDERSIDE OF DROP CEILING. ADJUST TOP OF FRAME HEIGHT ACCORDINGLY. COORDINATE WITH ALL SERVICES TO VERIFY UNDERSIDE OF DROP CEILING. NOTIFY DEPARTMENTAL REPRESENTATIVE OF ANY SIGNIFICANT DISCREPANCY OR ADJUSTMENTS REQUIRED.

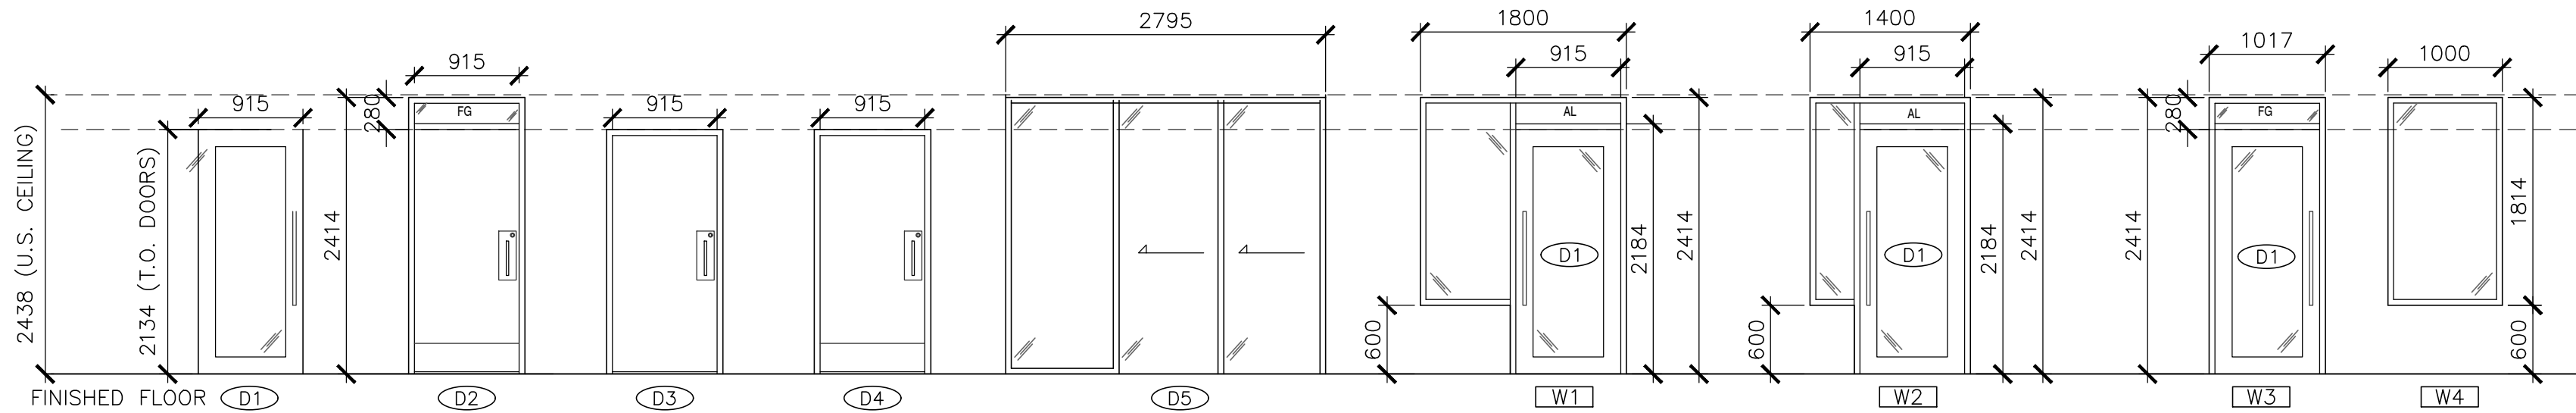

DOOR & WINDOW LEGEND	
SYMBOL	DESCRIPTION
FG	FROSTED PRIVACY GLASS
AL	ANODIZED ALUMINUM PANEL

CONSTRUCTION ASSEMBLIES LEGEND – REFER TO DRAWING A-104 FOR INTERIOR FINISHES

WALL ASSEMBLIES	ROOF ASSEMBLIES	INTERIOR PARTITIONS
<b>[WT1]</b> <b>WT1 EXTERIOR WALL ASSEMBLY – TYPICAL</b> <ul style="list-style-type: none"><li>– METAL CLADDING W/ HIDDEN FASTENERS</li><li>– STRAPPING / METAL FURRING BARS</li><li>– 19mm AIRSPACE</li><li>– 25mm MINERAL WOOL INSULATION</li><li>– WEATHER RESISTIVE VAPOR PERMEABLE AIR BARRIER</li><li>– EXTERIOR GRADE SHEATHING</li><li>– 38mm x 140mm WOOD STUDS</li><li>– MINERAL WOOL INSULATION</li><li>– VAPOUR BARRIER</li><li>– 5/8" GYPSUM WALL BOARD, PAINTED</li></ul> <b>*** NOTE: NO INTERIOR GWB WHERE WT1 ABUTS P2 INTERIOR PLUMBING PARTITION</b>	<b>[R1]</b> <b>ROOF ASSEMBLY – TYPICAL</b> <ul style="list-style-type: none"><li>– METAL ROOF W/ HIDDEN FASTENER</li><li>– VENTILATION/DRAINAGE MAT</li><li>– UNDERLAYMENT LAYER</li><li>– 16MM ROOF SHEATHING</li><li>– R-52 BATT INSULATION</li><li>– ENGINEERED ROOF TRUSSES</li><li>– CEILING STRAPPING</li><li>– VAPOR BARRIER</li><li>– 16MM TYPE-X GYPSUM CEILING BOARD</li></ul> <b>*** NOTE: ALL GYPSUM BOARD AT WASHROOMS AND SHOWER LOCATIONS TO BE WATERPROOF</b>	SEE DRAWING A-102 FOR INTERIOR FINISHES <b>[P1A]</b> <b>INTERIOR PARTITION – TYPICAL</b> <ul style="list-style-type: none"><li>– 16mm GYPSUM WALL BOARD</li><li>– 38mm x 140mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION; FULL CAVITY</li><li>– 16mm GYPSUM WALL BOARD</li></ul> <b>*** ALL WALLS TO BE P1A UNLESS OTHERWISE NOTED. ALL GYPSUM WALL BOARD IN WASHROOMS TO BE WATER RESISTIVE. WALL TILES OVER GYPSUM WALL BOARD– REFER TO FINISH PLAN A-102 FOR LOCATIONS.</b>
<b>[WT2]</b> <b>WT2 EXTERIOR WALL ASSEMBLY – TYPICAL</b> <ul style="list-style-type: none"><li>– 19mm EASTERN WHITE CEDAR WOOD SIDING</li><li>– HORIZONTAL ORIENTATION</li><li>– BLIND NAIL</li><li>– STAIN AND UV CLEAR</li><li>– 19mm VERTICAL STRAPPING / AIRSPACE</li><li>– 25mm RIGID INSULATION</li><li>– WEATHER RESISTIVE VAPOR PERMEABLE AIR BARRIER</li><li>– EXTERIOR GRADE SHEATHING</li><li>– 38mm x 140mm WOOD STUDS</li><li>– MINERAL WOOL INSULATION</li><li>– VAPOUR BARRIER</li><li>– 16mm ABUSE RESISTANT GYPSUM BOARD</li></ul>	<b>[S1]</b> <b>ROOF ASSEMBLY – TYPICAL</b> <ul style="list-style-type: none"><li>– U.S. OF WOOD TRUSS</li><li>– 12.5mm FIRE RATED PLYWOOD</li><li>– WEATHER RESISTIVE VAPOR PERMEABLE AIR BARRIER</li><li>– 19mm STRAPPING / AIR SPACE</li><li>– 19 mm EASTERN WHITE CEDAR SOFFIT (BLIND NAIL)</li></ul>	<b>[P1B]</b> <b>INTERIOR PARTITION – CORRIDOR / SHOWERS</b> <ul style="list-style-type: none"><li>– 16mm GYPSUM WALL BOARD</li><li>– 38mm x 140mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION</li><li>– VAPOUR BARRIER</li><li>– 16mm SCHLUTER WATERPROOF KERDI-BOARD</li></ul>
<b>GYPSUM BOARD NOTES:</b> <ul style="list-style-type: none"><li>– ALL GYPSUM WALL BOARD BEHIND PT1 TO BE ABUSE-RESISTIVE. REFER TO A-102 FINISH PLAN FOR FINISH LOCATIONS. GYPSUM BOARDS TO BE FIRE-RESISTIVE WHERE CALLED FOR IN ASSEMBLY.</li><li>– ALL GYPSUM BOARD FOR WASHROOM WALLS AND CEILINGS TO BE WATER RESISTIVE.</li><li>– ALL CEILINGS TO BE FIRE-RESISTIVE</li></ul>	<b>FLOOR TYPES / ASSEMBLIES</b> <b>[FT1]</b> <b>FT1 FLOOR ASSEMBLY – TYPICAL</b> <ul style="list-style-type: none"><li>– FINISHED CONCRETE SLAB</li><li>– UNDER SLAB VAPOR BARRIER</li><li>– UNDER-SLAB RIGID INSULATION</li><li>– DRAINAGE GRAVEL</li></ul> <b>[FT2]</b> <b>FLOOR ASSEMBLY – WASHROOMS</b> <ul style="list-style-type: none"><li>– SLOPED CONCRETE SLAB</li><li>– UNDER SLAB VAPOR BARRIER</li><li>– UNDER-SLAB RIGID INSULATION</li><li>– DRAINAGE GRAVEL</li></ul> <b>[FT3]</b> <b>FLOOR ASSEMBLY – SHOWERS</b> <ul style="list-style-type: none"><li>– WATERPROOF UNDER-LAYMENT</li><li>– SLOPED CONCRETE SLAB</li><li>– UNDER SLAB VAPOR BARRIER</li><li>– UNDER-SLAB RIGID INSULATION</li><li>– DRAINAGE GRAVEL</li></ul>	<b>[P1C]</b> <b>INTERIOR PARTITION – SHOWERS</b> <ul style="list-style-type: none"><li>– 16mm SCHLUTER WATERPROOF KERDI-BOARD</li><li>– 38mm x 140mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION</li><li>– VAPOUR BARRIER</li><li>– 16mm SCHLUTER WATERPROOF KERDI-BOARD</li></ul> <b>[P1D]</b> <b>INTERIOR PARTITION 1h F.R.R.</b> <ul style="list-style-type: none"><li>– 2 LAYERS 16mm TYPE X GYPSUM WALL BOARD</li><li>– 38mm x 140mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION</li><li>– 2 LAYERS 16mm TYPE X GYPSUM WALL BOARD</li></ul> <b>[P2A]</b> <b>INTERIOR PARTITION – PLUMBING WALL</b> <ul style="list-style-type: none"><li>– 38mm x 90mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION</li><li>– 16mm GYPSUM WALL BOARD</li></ul> <b>[P2B]</b> <b>INTERIOR PARTITION – PLUMBING WALL</b> <ul style="list-style-type: none"><li>– 38mm x 90mm WOOD STUDS @ 400mm O.C.</li><li>– MINERAL WOOL INSULATION</li><li>– 16mm SCHLUTER WATERPROOF KERDI-BOARD</li></ul>

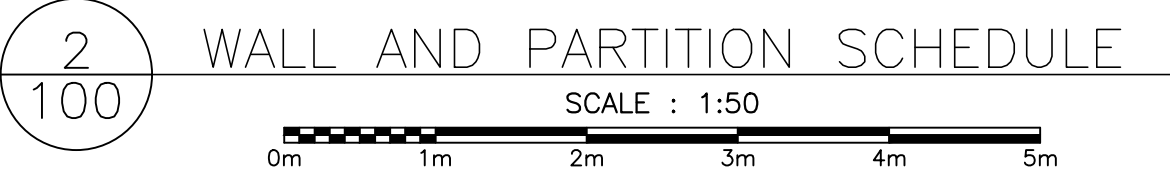

fathomstudio.ca  
1 Starr Lane  
Dartmouth, NS  
B2Y 4V7

fathom

02	REISSUED FOR TENDER	2022 09/08
01	ISSUED FOR TENDER	2022 03/31
revisions		date
project		projet

PARKS CANADA  
CAPE BRETON HIGHLANDS  
NATIONAL PARK,  
INGONISH BEACH  
WASHROOM AND KIOSK

drawing  
dessin

NOTES & SCHEDULES

designed date	C.C. J.B. H.H.	conçu
drawn date	J.B. A.P. K.H. 2021	dessiné
approved date		approuvé
Tender Project Manager	DUGGAN KENNEDY	Soumission Administrateur de projets
project number		no. du projet
drawing no.		no. du dessin

A-100