


UV ROOM FLOOR PLAN

SCALE : 1:25
0mm 500mm 1000mm 1500mm 2000mm 2500mm

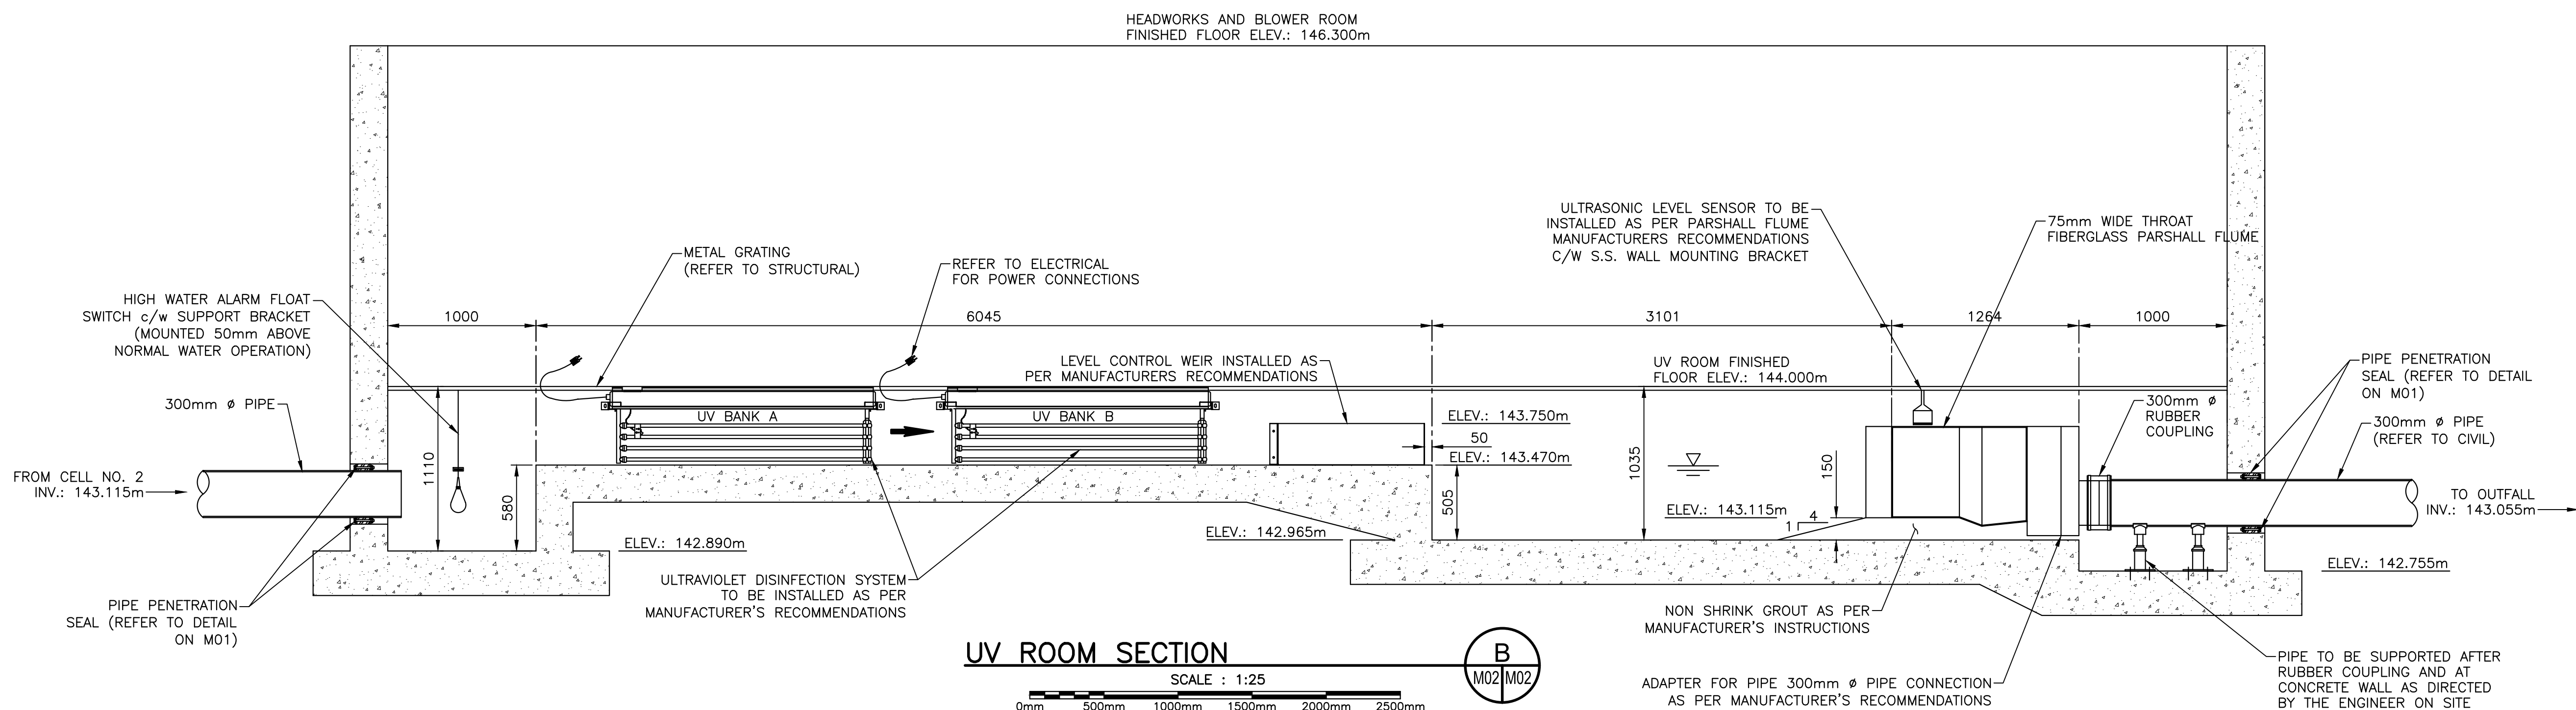

UV ROOM SECTION

SCALE : 1:25
0mm 500mm 1000mm 1500mm 2000mm 2500mm

- NOTE:
1. CONTRACTOR TO REVIEW EQUIPMENT INSTALLATION MANUALS PRIOR TO THE START OF CONSTRUCTION TO CONFIRM ON-SITE REQUIREMENTS.
 2. EXACT LOCATION AND DIMENSIONS OF CORE DRILLED HOLES SHALL BE CONFIRMED BY THE CONTRACTOR TO ENSURE PROPER INSTALLATION OF PIPE PENETRATION SEALS.
 3. FOLLOW MANUFACTURER'S INSTRUCTIONS FOR EQUIPMENT OFF LOADING, STORAGE AND INSTALLATION, REFER TO SPECIFICATIONS.
 4. EXACT LOCATION OF ULTRASONIC LEVEL SENSOR SHALL BE AS RECOMMENDED BY PARSHALL FLUME MANUFACTURER.
 5. EACH 38mm Ø UNDERGROUND CONDUIT TO INCLUDE A 9mm Ø SAMPLING TUBING WITH PIPE SEALANT, AS PER MANUFACTURER'S RECOMMENDATIONS. SPARE TUBING TO BE COILED AT EACH ENDS AND CAPPED TO PREVENT DEBRIS FROM ENTERING. TUBING TO BE FASTENED TO CHANNEL WALL AS REQUIRED (REFER TO SPECIFICATIONS).
 6. EACH 38mm Ø UNDERGROUND CONDUIT TO BE INSTALLED 600mm FROM FINISHED FLOOR ELEVATION.

3	ISSUED FOR TENDER	04/14 2022
2	ISSUED FOR RS4 99% SUBMISSION	10/30 2020
1	ISSUED FOR RS4 66% SUBMISSION	02-28 2020
0	ISSUED FOR RS3 SUBMISSION	08-17 2018

revisions	date
-----------	------

project	project
---------	---------

SEWAGE TREATMENT UPGRADES
SPRINGHILL INSTITUTION
SPRINGHILL, NS

drawing design

UV ROOM
PLAN AND SECTION

designed SML conçu

date 2022-04-14

drawn SML dessiné

date 2022-04-14

approved pp approuvé

date 2022-04-14

Tender Soumission

PWGS Project Manager Administrateur de projets TPSGC

project number no. du projet

R.061876.001

drawing no. no. du dessin

M02