
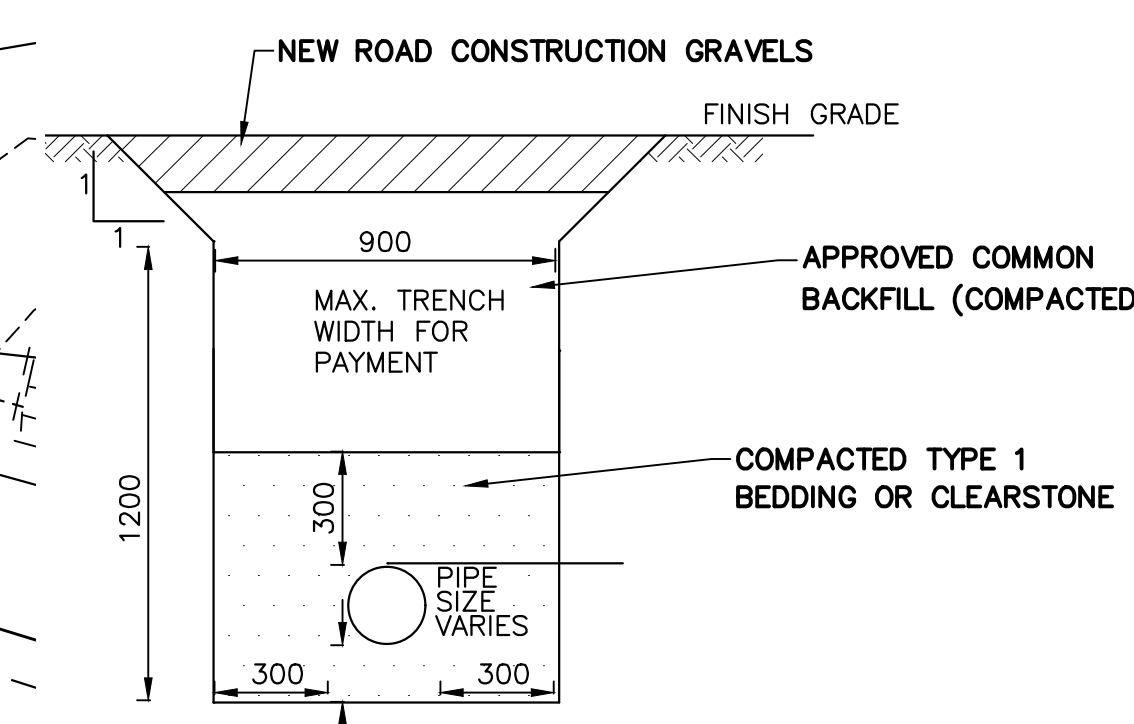


GENERAL NOTES:


1. NEW WATERMAIN AND PRESSURE SEWER LINES TO BE INSTALLED USING DIRECTIONAL DRILLING METHOD OF CONSTRUCTION.
2. REFERENCE BH01 & BH02 IN GEOTECHNICAL REPORT, APPENDIX TO SPECIFICATIONS FOR INFORMATION ON SUBSURFACE CONDITIONS FOR THE DIRECTIONAL DRILLING.
3. PROVIDE SHOP DRAWINGS FOR ALL TRANSITION COUPLINGS FOR CONNECTION OF EXISTING LINE TO NEW HDPE LINES.
4. INSTALL NEW LINES WITHIN ROADWAY TO SINGLE PIPE DETAIL 1.

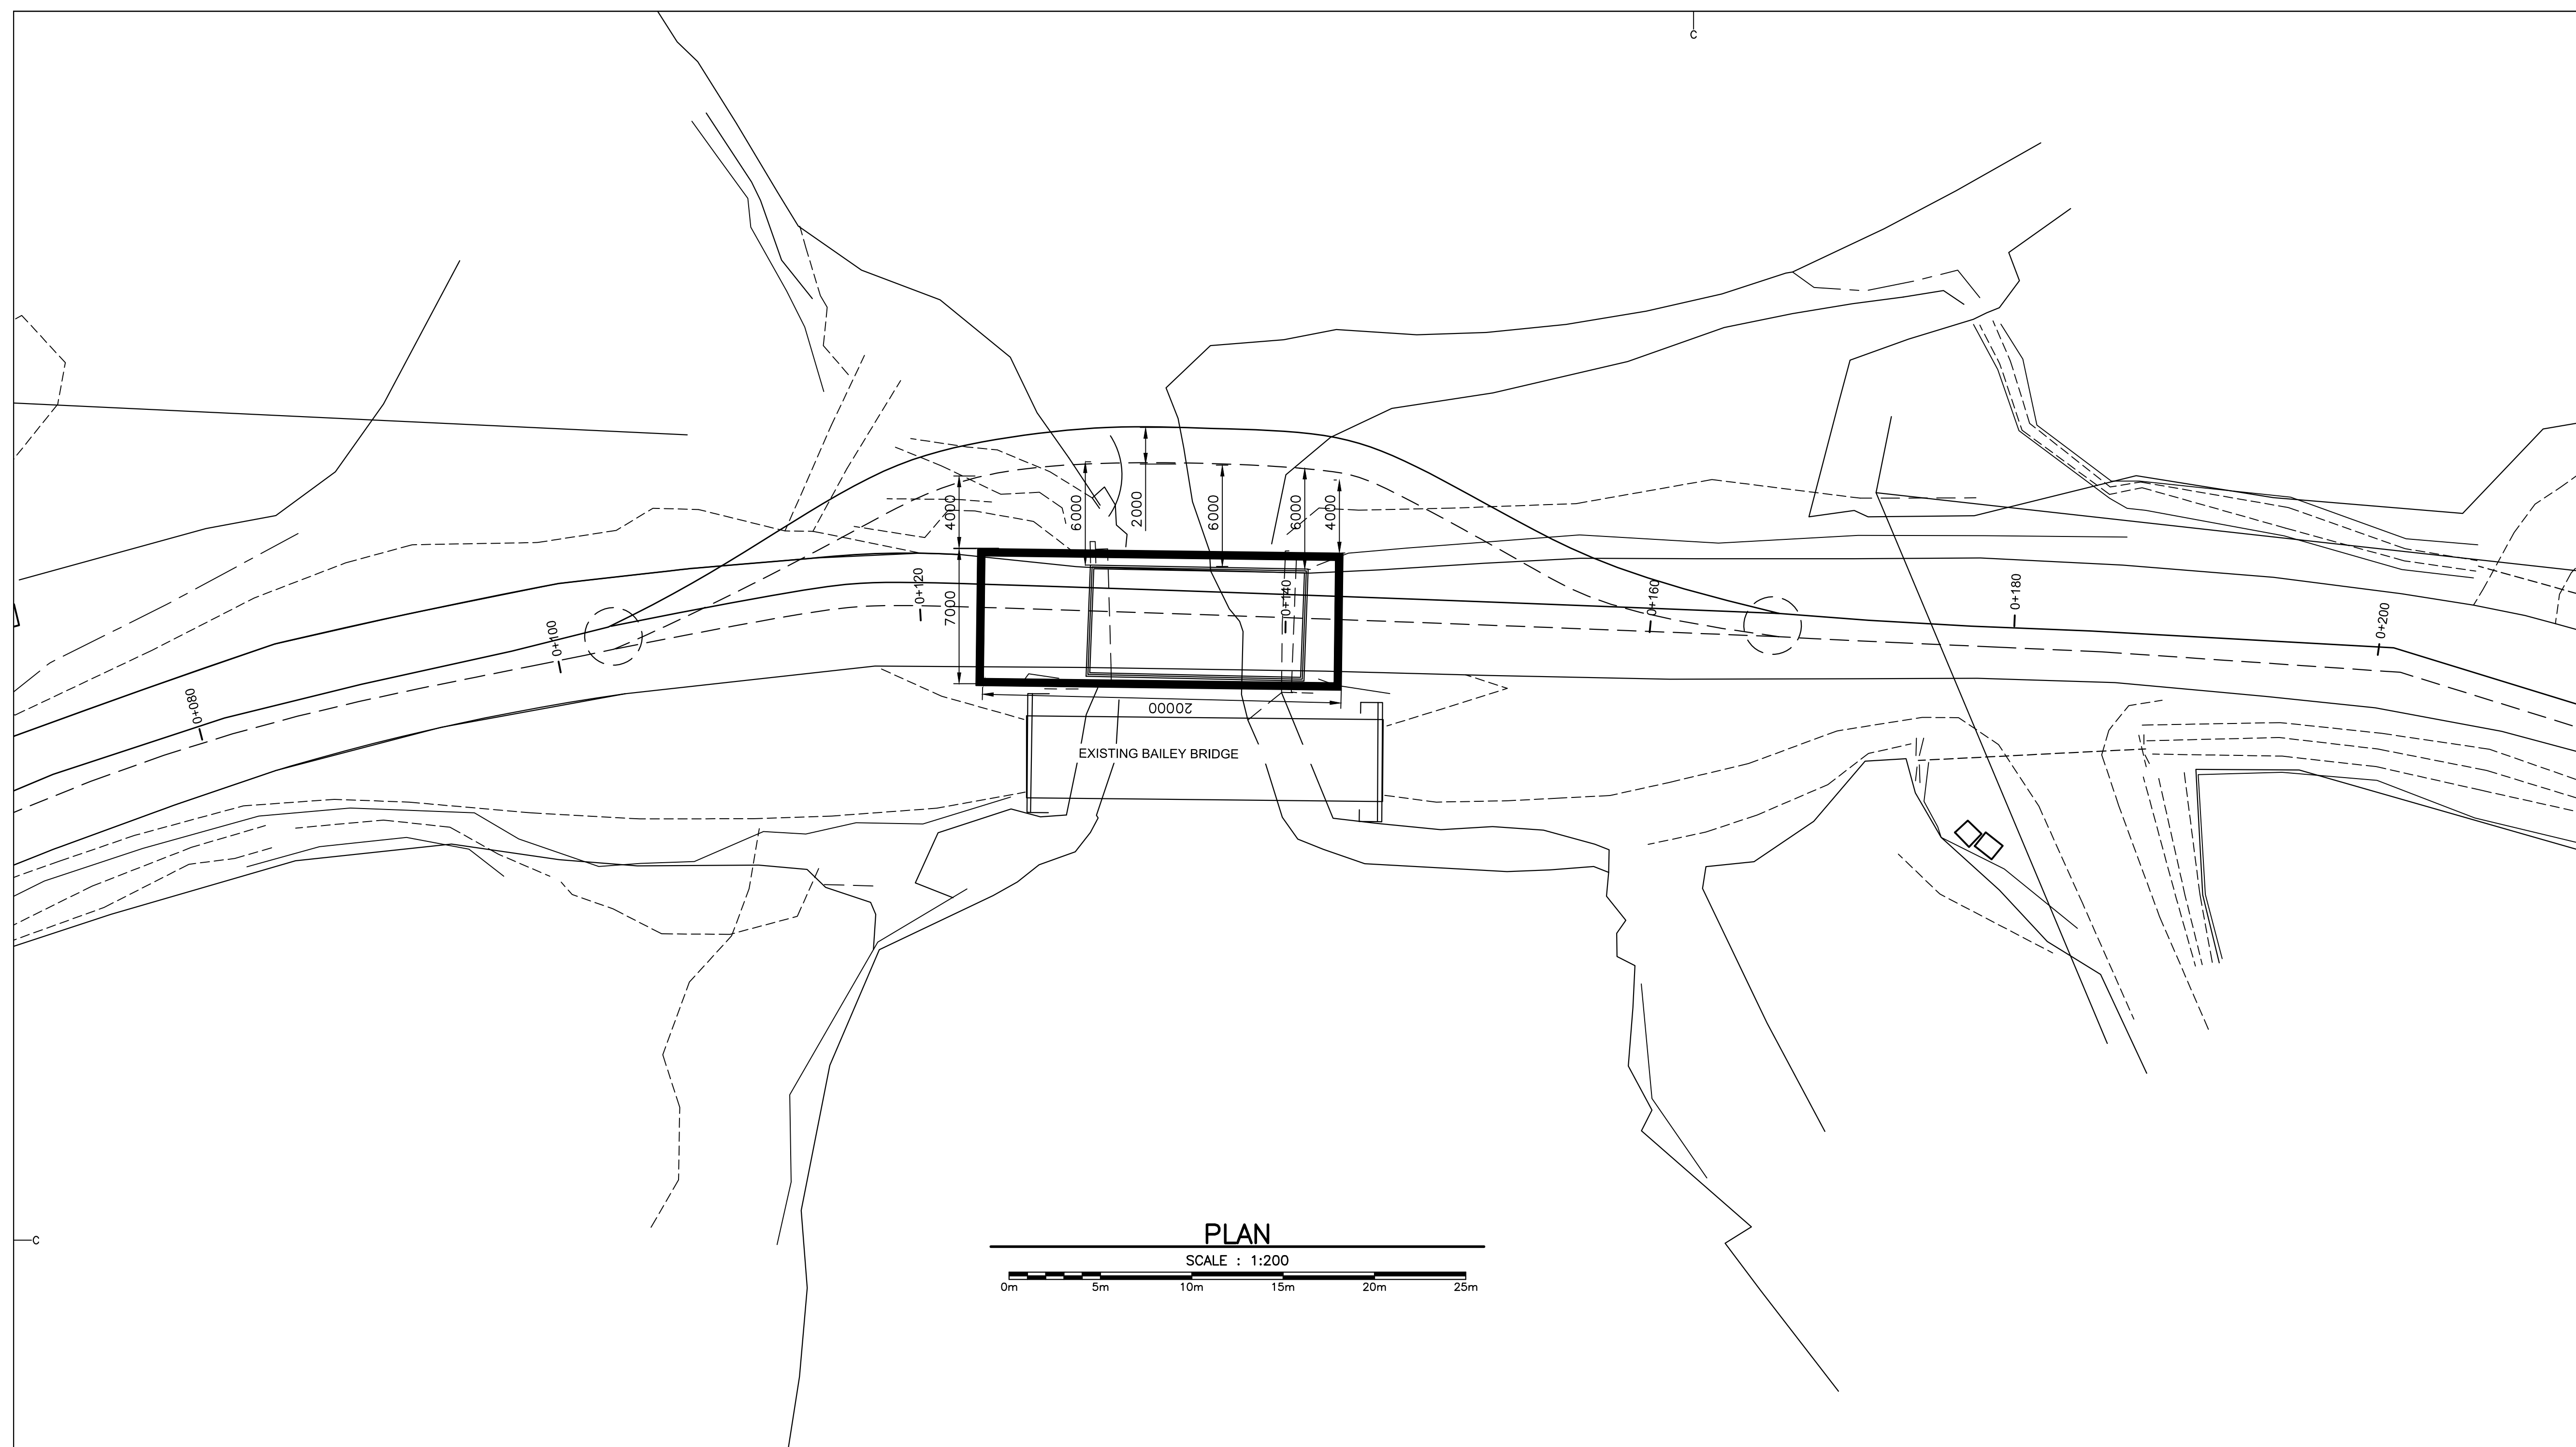

TYPICAL TRENCH DETAIL 1
200/200

LEGEND

- NEW 100mmØ HDPE DR11 WATERMAIN
- - - EXISTING 100mmØ PVC WATERMAIN
- - - NEW 50mmØ HDPE DR11 PRESSURE SEWER
- - - EXISTING 50mmØ PVC PRESSURE SEWER

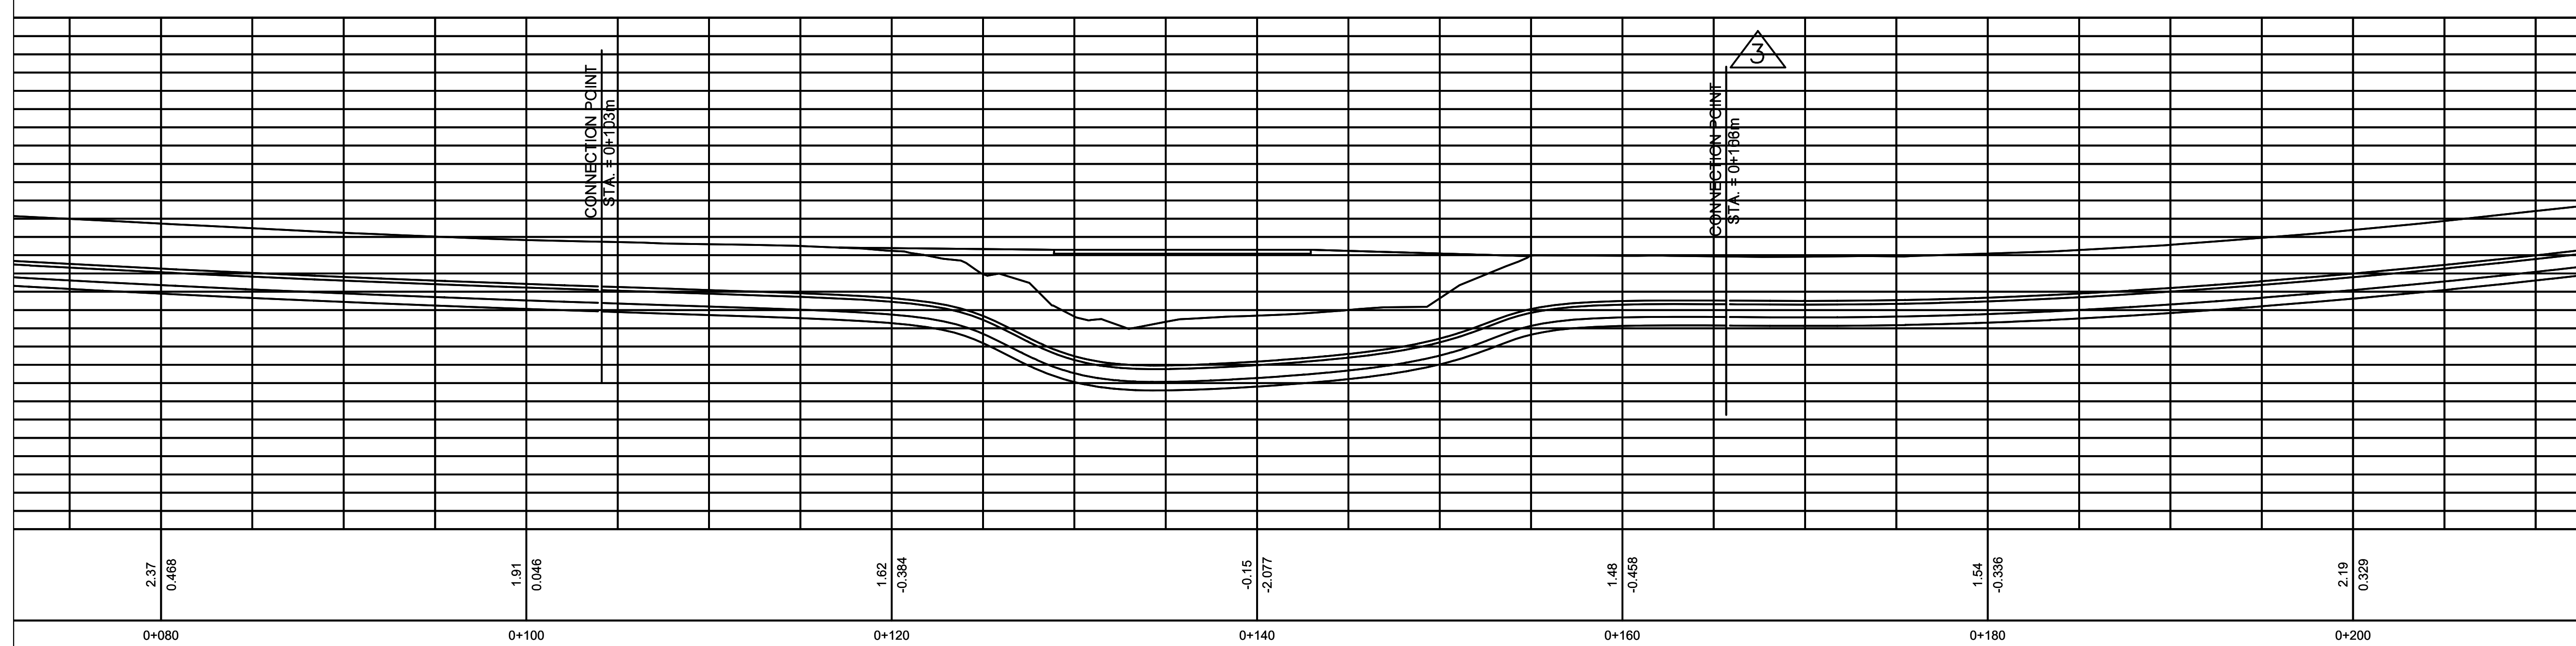

revisions	date
3	OCT.25 2022
2	OCT.14 2022
1	JUN. 23 2022

project
**JOHN PAUL LANE
BRIDGE REPLACEMENT**
ESKASONI, NOVA SCOTIA

drawing
PLAN & PROFILE
desin

designed	G.URQUHART	conçu
date	JUN 2022	
drawn	T.ROGERS	dessiné
date	JUN 2022	
approved	G.URQUHART	approuvé
date	JUN 2022	
Tender		Soumission

PWGSC Project Manager Administrateur de projets TPSCC
project number no. du projet
22-52

drawing no. no. du dessin
200